


SA600

Compact controller for central units with Compressor Inverter and EEV driver management for domestic heat pumps

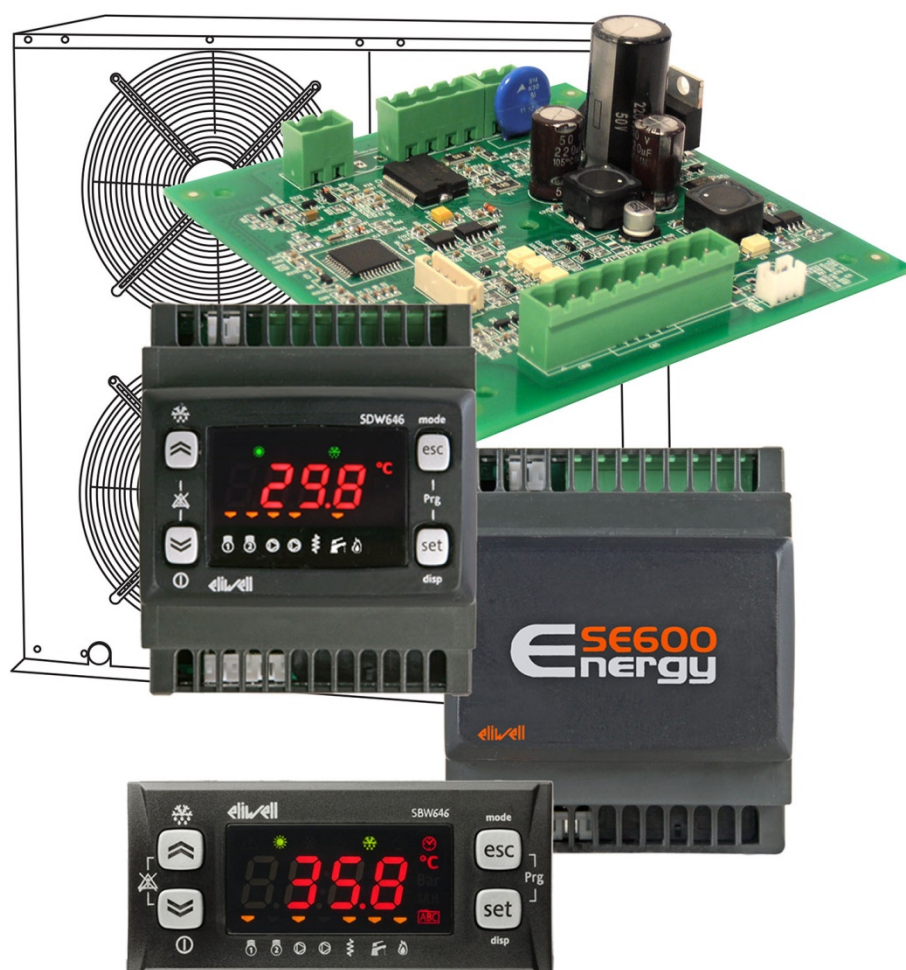

CONTENTS

1	Introduction	8
1.1	General description	8
1.1.1	Typical applications:	8
1.1.2	Specifications:	9
1.1.3	Main functions:	9
1.2	Models and Features	9
2	Mechanical Installation.....	10
2.1	Mechanical dimensions	12
3	Electrical connections.....	13
3.1	General warnings.....	13
3.1.1	Power supply.....	13
3.1.2	Power supply - High voltage inputs (relay)	13
3.1.3	TRIAC.....	13
3.1.4	Analogue Inputs-Probes.....	13
3.1.5	Serial connections (TTL).....	13
3.2	Wiring diagrams.....	14
3.2.1	Wiring diagrams.....	15
3.2.2	Example of low voltage input/output connection	19
3.2.2.1	Example of current/voltage input connection	19
3.2.3	Example of NTC/DI input connection	19
3.2.3.2	Example of AO1 / AO2 connection	20
3.2.3.3	Example of AO3 - AO4 connection	20
3.2.3.4	Example of AO5 connection.....	21
3.2.3.5	Example of DO5 connection.....	21
3.2.4	Example of connection of high voltage outputs.....	22
3.3	Network connection examples.....	23
3.3.1	Example of connection SB600 – SE600.....	23
3.3.2	Example of connection SD600/SC600 – SE600.....	23
3.3.3	Example of connection SC600 – SKP 10.....	23
3.3.4	SKW22(L) Remote, wall-mounted LCD terminal.....	24
3.3.5	SKP22(L) Remote, panel-mounted LCD terminal.....	25
3.3.6	Example of connection SC600 – SE600 – SKP10 – LCD terminal	25
3.3.7	SKP20 Terminal.....	26
3.3.8	3.3.8 Example of connection SC600 – SE600 – SKP10 – LCD terminal SKP20	26
4	Technical data	27
4.1	General Specifications.....	27
4.2	I/O features.....	28
4.3	Mechanical technical data	30
4.4	Display and LEDs	30
4.5	Serial ports.....	30
4.6	Transformer	30
4.7	Mechanical dimensions	30
4.8	Permitted use	31
4.9	Improper Use	31
4.10	Disclaimer.....	31
4.11	Disposal.....	31
5	System configuration (folder PAr/CL)	32
5.1	Configuration of analogue inputs.....	32
5.1.1	Configuration of SE600 expansion analogue inputs	32
5.1.2	Configuration of Terminals Analogue Inputs SKW22(L)/SKP22(L).....	32
5.2	Digital Input Configuration.....	35
5.3	Digital output configuration.....	37
5.4	Configuration of analogue outputs.....	38
6	User Interface (folder PAr/UI).....	41
6.1	Keys.....	41

6.1.1	Description of keys and associated functions.....	41
6.1.2	Stand-by.....	42
6.1.3	Description of keys – combined action.....	42
6.1.3.1	Manual alarm acknowledgement and reset.....	43
6.2	LEDs and Display	43
6.2.1	LED: States and Operating Modes.....	43
6.2.2	LEDs: values and units of measurement.....	44
6.2.3	LED: utilities	44
6.3	First switch-on.....	45
6.4	Access to folders - Menu structure	45
6.4.1	Main display Menu	45
6.4.2	“Operating Mode” Menu	46
6.4.3	‘States’ Menu.....	47
6.4.3.1	Inputs/Outputs Display (AiL, diL, tCL1/AOL, dOL).....	47
6.4.3.2	Setting the clock (CL)	48
6.4.3.3	Alarm display (AL)	49
6.4.3.4	Example of how to set the setpoint (SP)	50
6.4.3.5	Display and reset compressor/pump hours	51
6.4.4	Programming menu.....	52
6.4.4.6	Parameters (PAr folder)	52
6.4.5	Setting a password (Par/PASS folder)	53
6.4.6	Alarm Events (Par/EU folder).....	53
7	Operating modes - Temperature control (folder PAr/tr).....	55
7.1	Temperature controller setpoint and hysteresis.....	55
7.1.1	Setpoint and hysteresis from parameter value	55
7.1.2	Real setpoints and hysteresis.....	55
7.1.2.1	Setpoint differential: dynamic differential.....	56
7.1.2.2	Setpoint differential: Economy differential.....	56
7.1.2.3	Setpoint and hysteresis differentials: Adaptive function.....	56
7.2	Temperature controller	57
7.2.1	Temperature control probes	57
7.2.2	Proportional temperature control	58
7.2.3	Proportional power step temperature control in Cool / Heat mode.....	58
7.2.4	INVERTER temperature control in Cool / Heat mode.....	59
7.2.5	Notes on inverter Management.....	60
7.2.6	Activation of the XVD electronic expansion valve driver.....	63
7.3	ENVELOPE control.....	63
7.3.1	Discharge temperature limitation	63
7.3.2	Compression ratio control	65
7.3.3	Oil recovery	65
7.3.4	ENVELOPE control regulation priority	65
7.3.5	Temperature control differential	66
7.3.5.1	Differential temperature control in Cool / Heat mode	66
7.3.6	Digital temperature control.....	67
8	Operating states (folder PAr/St)	68
8.1	Automatic mode changeover	69
8.1.1	Example of automatic changeover based on water temperature.....	69
8.1.2	Example of automatic changeover based on external air temperature.....	69
8.2	Operating states table.....	70
8.3	Reversing valve management.....	71
8.3.1	Changeover from Cool to Heat and vice versa	71
8.3.2	Changeover from Cool to Antifreeze and vice versa.....	73
8.3.3	Heat – defrost mode changeover	74
8.3.4	Circuit pressure release.....	75
8.4	Cycle inversion and changeover of operating mode in XVD drivers.....	75
9	Compressors (folder PAr/CP)	76
9.1	Types of compressor	76
9.1.1	Non-power stage compressors (CP00 = 0)	76
9.1.2	Power stage compressors (CP00 = 1,2)	77
9.2	Compressor configuration	77
9.3	Compressor timing	78
9.3.1	Minimum time between switching off/on for a given compressor.....	78
9.3.2	Minimum time between switching on/on for a given compressor	78

9.3.3	Minimum compressor on time	79
9.3.4	Minimum on/on time for same compressor.....	79
9.3.5	Minimum off/off time for different compressors	79
9.3.6	Minimum compressor on time per splitting increment.....	80
9.3.7	Minimum compressor on time per splitting decrease	80
9.3.8	Defrost compressor/step delay minimum	80
9.3.9	Pump Down	81
9.3.10	Other timings.....	81
9.4	Compressor on/off sequence	82
9.4.1	Availability of resources.....	82
9.4.2	Managing resources	82
9.4.3	Resource selection criterion	83
9.4.4	Selecting the circuit/evaporator	83
9.4.5	Selecting the compressor or power stage	84
10	Internal circuit pump (folder PAr/PI).....	85
10.1	Configuration of internal circuit water pump	85
10.1.1	Control of the second pump	86
10.2	Continuous operation	86
10.2.1.1	Internal circuit pump digital control in Cool / Heat.....	86
10.2.1.2	Internal circuit pump analogue control in Cool / Heat.....	87
10.3	Operation in response to request.....	88
10.3.1.1	Internal circuit pump digital control in Cool / Heat.....	88
10.3.1.2	Internal circuit pump analogue control in Cool / Heat.....	88
10.3.1.3	Operation on call: periodic pump activation.....	88
10.4	Pump anti-lock (anti-sticking) mode.....	89
10.5	Antifreeze operation with pump.....	90
11	Ventilation fan (folder PAr/FI).....	91
11.1.1	Continuous operation	91
11.1.2	Operation in response to request	91
11.1.2.1	Recirculation fan in Heating / Cooling.....	92
11.2	Post-ventilation.....	92
12	External exchanger fan (folder PAr/FE).....	93
12.1.1	Continuous operation	94
12.1.1.1	External exchanger fan digital control in Cool / Heat.....	94
12.1.1.2	External exchanger fan analogue control in Cool / Heat.....	95
12.1.2	Operation in response to request	96
12.1.2.3	External exchanger fan digital control in Cool / Heat.....	96
12.1.2.4	External exchanger fan analogue control in Cool	98
12.1.2.5	External exchanger fan analogue control in Heat	98
12.2	Fan control in defrost	98
12.3	Fan control with single condensation.....	99
13	External circuit pump (folder PAr/PE)	100
13.1	Working modes	100
13.1.1	Continuous operation	100
13.1.2	In response to a request from the temperature controller.....	100
13.1.3	Operation synchronised with external exchanger fans	101
13.2	Pump anti-lock (anti-sticking) mode.....	101
13.3	Antifreeze operation with pump.....	102
14	Internal exchanger electrical heaters (folder PAr/HI).....	103
14.1	Internal antifreeze heater	103
14.1.1	Internal circuit antifreeze heater control	104
14.2	Configuration of integration heaters	105
14.2.1	Integration heater differential.....	105
14.2.2	Integration heater regulation.....	107
14.3	Heaters in defrost mode	108
15	External exchanger electrical heaters (folder PAr/HE)	109
16	Auxiliary output (folder PAr/HA)	111
16.1.1	Auxiliary output regulation conditional on defrosting.....	111
17	Boiler (folder PAr/br).....	112
17.1	Boiler configuration.....	112

17.1.1	Boiler differential.....	113
17.1.2	Boiler regulation.....	115
17.1.3	Boiler regulation, second digital output.....	115
18	Defrost (folder PAr/dF)	116
18.1	Defrost.....	117
18.1.1	Defrost start.....	117
18.1.2	Defrosting cycle.....	118
18.1.3	End defrost and coil drainage.....	118
18.2	Start defrost setpoint.....	119
18.3	Defrost alarm management.....	120
18.4	Manual defrost.....	120
18.5	Power failure during defrost.....	120
19	Dynamic Setpoint (folder PAr/dS)	121
19.1	Modification (decalibration) of the setpoint as a function of the dynamic setpoint input.....	121
19.1.1	Modification (decalibration) of the setpoint as a function of the dynamic setpoint input with positive offset.....	121
19.1.2	Modification (decalibration) of the setpoint based on the dynamic setpoint input with negative offset.....	122
19.2	Modification (decalibration) of the setpoint based on the external temperature.....	122
19.2.1	Modification (decalibration) of the setpoint based on the external temperature (dS00=1).....	122
19.2.2	Fixed modification (decalibration) of the setpoint (dS00=2).....	123
20	Adaptive Control (folder PAr/Ad).....	124
20.1	Adaptive function with setpoint modification	124
20.2	Adaptive function with hysteresis modification.....	126
20.3	Adaptive function with setpoint and hysteresis modification.....	126
20.4	Setpoint regression.....	126
20.5	Protection.....	127
21	Antifreeze with heat pump (folder PAr/AF).....	128
22	Sanitary water and Anti-legionnaire's disease (folder PAr/AS)	130
22.1	Sanitary Water in HEAT mode.....	131
22.1.1	Sanitary water heater in Heat/Cool mode*	133
22.2	Sanitary Water, Cool mode	133
22.2.1	Dynamic ACS setpoint.....	135
22.3	Sanitary water regulation, AS mode.....	136
22.4	Anti-Legionnaire's Disease	136
22.4.1	ACS Heater for Anti-Legionnaire's Disease.....	139
22.5	Sanitary Water Antifreeze.....	139
23	Block heat pump (folder PAr/HP).....	140
23.1.1	Heat pump 1 lock - setpoint.....	141
23.1.2	Heat pump lock from digital input	141
24	Forced power stage (folder PAr/PL).....	142
24.1	Working modes	142
24.2	Power limitation - by external temperature (Cool and Heat)	143
24.3	Power limitation - by temperature (Cool and Heat)	144
24.4	Power limitation - by high pressure probe (Cool and Heat)	145
24.5	Power limitation - by low pressure probe (Cool and Heat).....	146
24.6	Power limitation to 50%.....	147
25	Time Bands (folder PAr/tE).....	148
26	Alarms and Troubleshooting (folder Par/AL).....	150
26.1.1	Digital alarms.....	151
26.1.1.1	Flow switch alarm	152
26.1.2	Analogue alarms	154
26.1.3	Vacuum alarm	155
26.1.4	Alarms Table	156
26.1.5	XVD driver alarms	160
26.1.5.2	XVD driver probe errors	161
26.1.5.3	XVD driver alarms.....	162
26.2	Alarm log.....	165
27	Parameters (PAr)	166

27.1.1	Local I/O configuration parameters (CL) - Configuration Local	167
27.1.2	Configuration parameters for XVD driver 1 (1r / 1F / 1L / 1E).....	169
27.1.3	Configuration parameters for XVD driver 2 (2r / 2F / 2L / 2E).....	169
27.1.4	User interface parameters (UI) – User Interface.....	170
27.2	Parameters / visibility table, folder visibility table and client table	172
27.2.1	Parameters / visibility table	174
27.2.2	Configuration parameters for XVD driver 1 (1r / 1F / 1L / 1E).....	201
27.2.3	Configuration parameters for XVD driver 2 (2r / 2F / 2L / 2E).....	201
27.2.4	Folder visibility table	208
27.2.5	Client Table	210
28	Functions (folder FnC)	219
28.1	Manual defrost activation (folder dEF)	219
28.2	Manual Reset (tA folder)	220
28.3	Change On/OFF state (folder St)	220
28.4	Multi Function key	220
28.4.1	Download from reset	221
28.5	Reset alarm log (folder EUr)	222
29	DeviceManager	223
29.1.1	Device Manager software component	223
29.1.2	Device Manager interface component.....	223
29.1.3	Multi Function Key Component.....	223
30	Monitoring.....	224
30.1	Configuration with Modbus RTU	224
30.1.1	Data format (RTU).....	224
30.1.2	Modbus commands available and data areas	225
30.2	Configuration of device address	228
30.2.1	Configuration of parameter addresses.....	228
30.2.2	Configuration of variable addresses / states	228
31	Appendix- XVD Driver	229
31.1	General Description XVD	229
31.1.1	Main functions:	229
31.2	Models and Features	229
31.3	XVD Open Assembly	230
31.4	XVD 4 DIN mounting	231
31.5	Electrical connections	232
31.5.1	General warnings.....	232
31.5.2	Power supply.....	232
31.5.2.1	Analogue Inputs-Probes.....	232
31.5.2.2	Serial connections.....	232
31.6	Wiring diagrams.....	233
31.6.1	XVD Open wiring diagram	233
31.6.2	XVD 4 DIN wiring diagram.....	234
31.6.3	Compatible valve connection	235
31.6.4	Example of XVD / Energy Flex connection	235
31.7	Technical Data.....	236
31.7.1	General technical specifications.....	236
31.8	I/O features.....	236
31.9	Serial.....	236
31.10	Transformer.....	236
31.10.1	Mechanical dimensions.....	237
31.11	MFK	237
31.11.1	Download from reset.....	237
31.12	Operation.....	238
31.13	XVD applications.....	239
31.13.1.1	Digital Inputs regulation.....	239
31.13.2	Example of 1 circuit heat pump application	239
31.13.3	Example of 2 circuit heat pump.....	240
31.14	Alarms.....	240
31.15	Configuration with Modbus RTU	240
31.15.1	Data format (RTU).....	240

31.15.2	Modbus commands available and data areas	241
31.16	Configuration of device address.....	241
31.16.1	Configuration of parameter addresses.....	241
31.16.2	Configuration of variable addresses / states	241
31.17	Table of XVD parameters	241
31.17.1	Table A	246
31.17.2	Table B.....	248
32	Models and Accessories	251
32.1	Model	251
32.1.1	Models SB • SD • SC	251
32.1.2	Expansion modules	251
32.1.3	Models XVD	252
32.1.4	List of compatible valves.....	252
32.1.5	Terminals	253
32.2	Accessories.....	254

1 INTRODUCTION

For quick, easy reference, the manual has been designed with the following features:

References

References column:

A column to the left of the text contains references to subjects discussed in the text to help you locate the information you need quickly and easily.

Highlighting icons:

Some text passages are marked by icons in the references column, which have the following meanings:



Important! :

highlights information that users must be aware of to prevent any damage to the system or hazards for people, devices, data, etc. Users MUST read and take note of these sections.



Note / highlight:

further information on the topic in question that the user should be aware of



Tip:

a suggestion that could help the user to understand and make better use of the information provided

1.1 General description

Eliwell, the leading manufacturer of controllers for small and medium air conditioning plants, presents SBA600 in the Energy Flex product family, a compact heat pump controller with advanced functions (sanitary hot water and anti-legionnaire's disease in a dedicated accumulator) for domestic applications.

Control of centralized air-conditioning systems with up to 2 circuits and a maximum of 4 compressors (steps) such as:

- Chillers:
 - o air-air
 - o air-water
 - o water-water
- Heat pumps:
 - o air-air
 - o air-water
 - o water-water with gas reversal
 - o water-water with water reversal
- Condenser units
 - o Air chillers
 - o Air heat pumps
 - o Water chillers
 - o Water heat pumps

1.1.1 Typical applications:

- Minimarkets
- Industrial plants
- Offices
- Hotels
- Homes

1.1.2 Specifications:

Energy SBA600 has 2 models providing 6 digital inputs, up to 5 relay outputs, a TRIAC output, 2 PWM analogue outputs, 3 configurable 0...10 V/0...20 mA/4...20 mA analogue outputs and an Open Collector digital output for an external relay. The standard Eliwell 32x74mm format ensures versatility and ease of installation.

Energy SDA - SCA - SE 600 features various models which can be used to obtain 6 digital inputs, up to 5 relay outputs, up to 2 TRIAC outputs, up to 2 PWM analogue outputs, up to 3 configurable 0...10 V/0...20 mA/4...20 mA analogue outputs and up to 2 Open Collector digital outputs for external relays. The 4DIN format guarantees maximum flexibility and easy installation.

All inputs and outputs are independent and configurable to maximise the units' adaptability to any system. It runs on 12-24V~ or 12-24V~/24V= power supplies.

1.1.3 Main functions:

- Sanitary hot water with auto-adaptive setpoint
- Sanitary Water and Anti-legionnaire's Disease with weekly programming
- Inverter management for BLDCM compressors
- User interface with configurable keys
- Menus with configurable displays
- Parameter settings via keyboard or P
- Alarm log
- Multi Function Key (MFK) to download or upload parameter maps
- Terminal (up to 100m) that can be connected directly with no serial interface
- Configurable NTC inputs, 4...20mA, 0...1V, 0...5V, 0...10V, or digital inputs configurable from parameters
- Temperature control via input or output probe depending on configuration and installation
- Automatic change-over
- Dynamic setpoint
- Digital/analogue condensation control without external devices up to 2A
- Boiler or supplementary electrical heater control for heating
- Electrical heater for hot sanitary water
- Control of 1 or 2 stepper motor electronic expansion valves via
 - XVD Open driver (on LAN serial port)
 - third-party drivers (on suitably configured digital inputs)
- Internal ventilation control
- Control of semi-hermetically sealed, scroll and screw compressors with one or two power steps
- Control of a single circuit with up to 4 compressors or 1 compressor with 4 power stages
- Control of double circuits up to a maximum of two compressors/power stages per circuit
- Management of cycle inversion valve (including valve temporary inversion)
- External circuit pump extended management
- Pump down in startup and shutdown
- 'vacuum' alarm
- 'dynamic' defrost



1.2 Models and Features

-->See Appendix A - Models and Accessories, and Technical Data section

2 MECHANICAL INSTALLATION

SB series • SKP 10

The instrument is intended for panel mounting (see diagram).


Drill a 29x71 mm hole and insert the device; secure it with the special brackets provided.

Do not install the device in places subject to high humidity and/or dirt; it is intended for use in sites with ordinary or normal levels of pollution.


Keep the area around the device cooling slots adequately ventilated.

The TTL serial is located on the left side of the device.

**Example of panel-mounted
SB series • SKP 10**

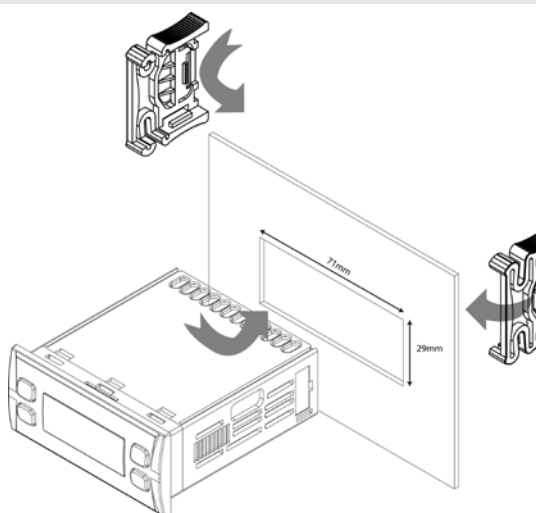


**Panel-mounted
SB series • SKP 10**

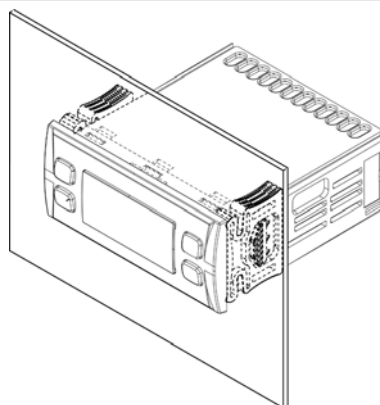


The images refer to SB

**Panel mounting example – side view
SB series • SKP 10**

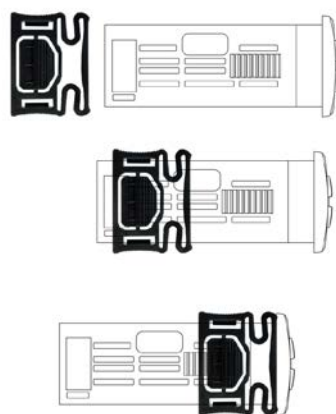

**Example of removal of instrument from panel – side view
SB series • SKP 10**

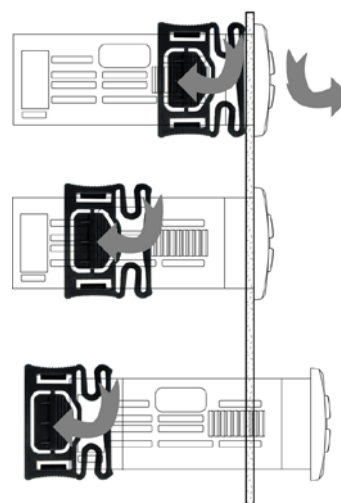


SD – SC – SE Series

The instrument is intended for DIN rail mounting.


Follow the instructions below to install the BASE on DIN RAIL:

- Move the two “spring docking devices” to their standby position (use a screwdriver to press against the relative compartments).
- Install the device on the DIN RAIL, pressing on the “spring docking devices” with your fingers to put them into the locked position.


SD – SC – SE Series
Example of DIN rail installation - Side view

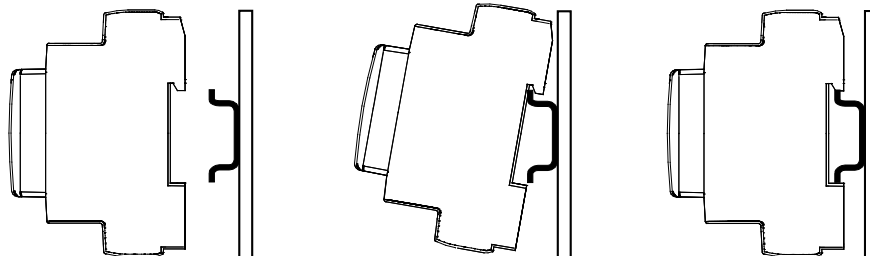

SD – SC – SE Series
DIN guide mounting example – rear view

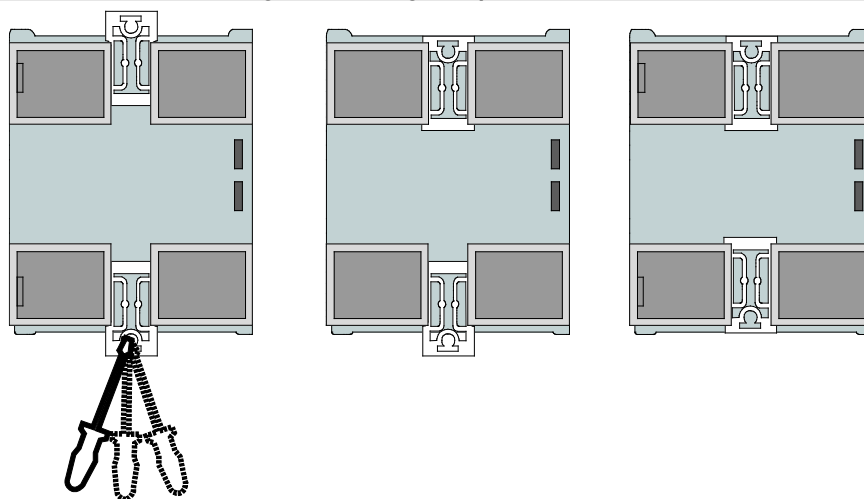


SD – SC – SE Series
Example of DIN rail installation - 3/4 view

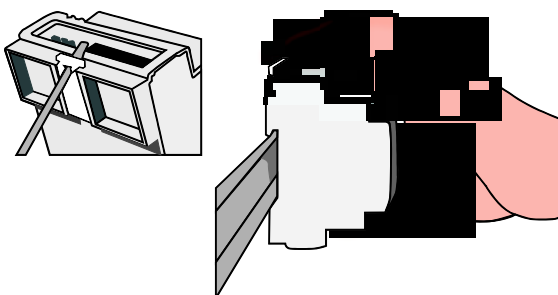


2.1 Mechanical dimensions


SB

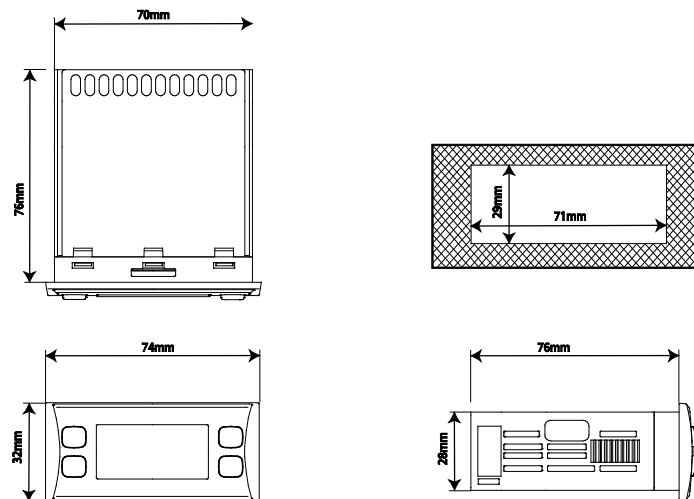

SKP 10

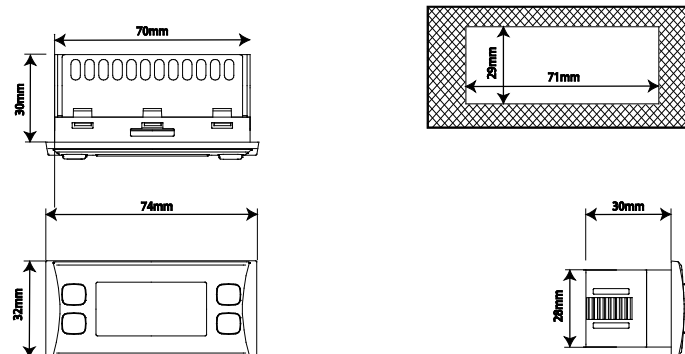

SD/SC – SE6xx

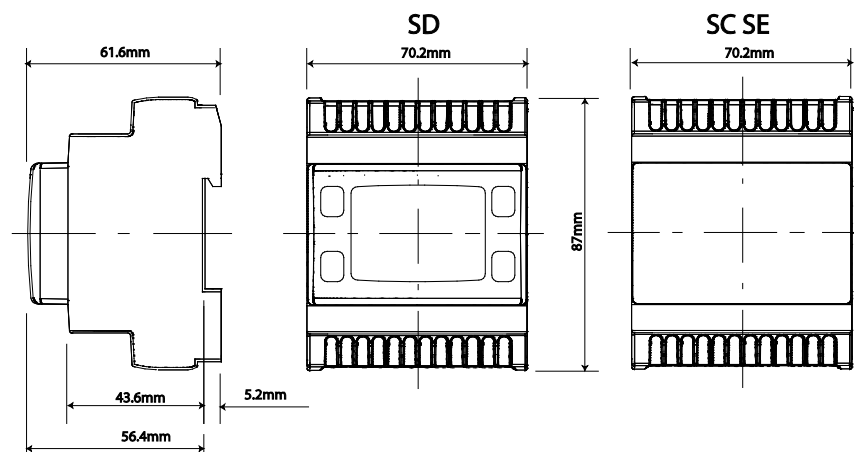

3 ELECTRICAL CONNECTIONS



3.1 General warnings

IMPORTANT!

Make sure the appliance is switched off before working on the electrical connections. All operations must be carried out by qualified personnel. To ensure proper connections, comply with the following:

- Power supplies other than those specified can seriously damage the system.
- Use cables of suitable section for the terminals.
- Separate the cables of probes and digital inputs from inductive loads and high voltage connections to prevent any electromagnetic interference. Do not place the probe cables near other electrical equipment (switches, meters, etc.).
- Make connections as short as possible and do not wind them around electrically connected parts.
- To avoid causing static discharges, do not touch the electronic components on the boards.
- Eliwell supplies the high voltage cables to connect the device to loads - see Accessories chapter.
- Eliwell supplies the signal cables to connect the power supply, probes, digital inputs, etc. - see Accessories Chapter.
- The device must be connected to a suitable transformer that complies with the specifications provided in the Specifications chapter.
- Take special care if the power supply module and/or transformer is connected to earth or is used for other devices. This may create unexpected electrical circuits with risks of malfunction and damage to the controller and to the devices themselves.

3.1.1 Power supply

NON-insulated power supply

If the same power supply module/transformer is also used for other devices and/or connected to earth, there are significant risks of malfunctions or damage to the controller/actuator.



3.1.2 Power supply - High voltage inputs (relay)

Do not exceed the maximum permitted current; for higher loads, use a contactor with sufficient power capacity.

Important!

Make certain that the power supply voltage matches the rated voltage of the device.

3.1.3 TRIAC

The TRIAC TC1 output (TC1, TC2 ☐ ☐ **36xx models**), when partialized, suppresses the half-wave at the zero-crossing.

3.1.4 Analogue Inputs-Probes

Probes have no connection polarity and can be extended using a normal bipolar cable (note that the extension of the probes influences the instrument's EMC electromagnetic compatibility: take great care with the wiring).

Important!

Pressure probes have a specific insertion polarity which must be observed.

Signal cables (temperature/pressure probes, digital inputs, TTL serial) must be wired separately from high voltage cables. Eliwell-supplied probes are recommended. Contact Eliwell Sales Office for item availability.

Temperature
probes



Pressure probes

3.1.5 Serial connections (TTL)

Use a 5-wire TTL cable up to 30cm in length.

An Eliwell-supplied TTL cable is recommended. Contact Eliwell Sales Office for item availability.

TTL (COM 1)



3.2 Wiring diagrams

Circuit diagram key

• SUPPLY	SB • SD • SC 63x 64x Power supply 12-24V~
• SUPPLY	SB • SD • SC 65x Power supply 12-24V~ / 24V~
• 5 ~	5Vdc 20mA max. auxiliary supply
• 12 ~	12Vdc auxiliary supply
• DO1...DO4, DO6	High-voltage relay outputs 2A - 250Vac
• DO1...DO3	SD • SC 636 High-voltage relay outputs 2A - 250Vac
• N	Neutral
• TC1	TRIAC 2A 250Vac high-voltage output
• TC1, TC2	SD • SC 636 TRIAC 3A 250Vac high voltage output
• AO1 AO2	Low voltage (SELV (§)) PWM analogue outputs
• AO3 AO4	Low voltage (SELV (§)) 0...10V analogue outputs
• AO5	Low voltage (SELV (§)) 0...20mA / 4...20mA analogue outputs
• DO4, DO5	SD • SC 636 Open Collector low voltage output (SELV (§))
• DO5	Open Collector low voltage output (SELV (§))
• DI1...DI6	No voltage digital inputs (°)
• AI1...AI2, AI5	Configurable analogue inputs NTC* / Digital Input***
• AI3...AI4	NTC */ voltage, current** / Digital Input*** configurable analogue inputs
• GND	Ground
• LAN	Serial for terminal / SE600 (max. 100m)
• TTL	TTL serial for connection to Multi Function Key / Device Manager
• RS-485	RS-485 Serial for connection to supervision systems

-
- *SEMITEC 103AT type (10K Ω / 25°C)
 - **4...20mA current or 0...5V / 0...10V / 0...1V voltage input or no-voltage digital input
 - ***no voltage digital input
 - (°) closing current for 0.5mA ground
 - (§) **SELV**: (SAFETY EXTRA LOW VOLTAGE)

3.2.1 Wiring diagrams

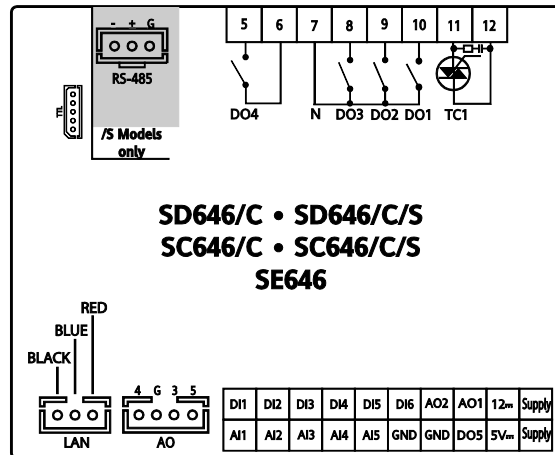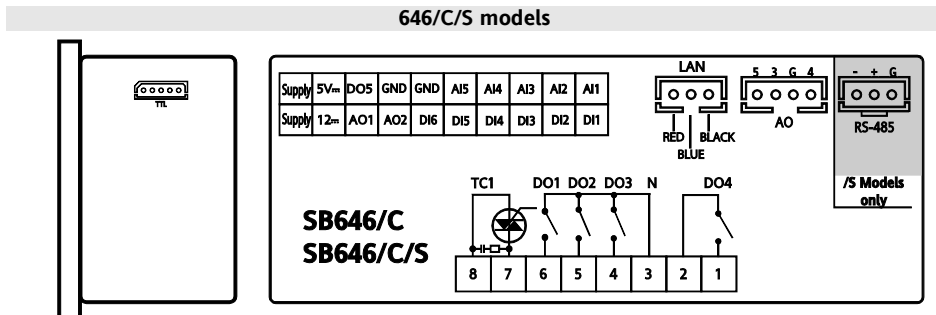


- 6 digital inputs [DI1...DI6] • DI
- 4 high voltage digital outputs 2A 250Vac • DO
- 6 analogue outputs • AO:
 - o 1 high voltage [TC1] 2A 250Vac analogue output
 - o 2 PWM analogue outputs [AO1, AO2]
 - o 3 low voltage (SELV (§)) analogue outputs
 - 2 outputs [AO3-4] 0-10V
 - 1 output [AO5] 4...20mA/0...20mA
- 5 analogue inputs [AI1...AI5]
- 1 low voltage digital output (SELV (§)) [DO5]
 - o Open Collector

Model /S RS-485 on board

- /C RTC supplied as standard
- Serial LAN Connection to terminal / SE6xx (max. 100m)
- TTL serial to connect to Multi Function Key
- (§) SELV: (SAFETY EXTRA LOW VOLTAGE)

655/C/S models

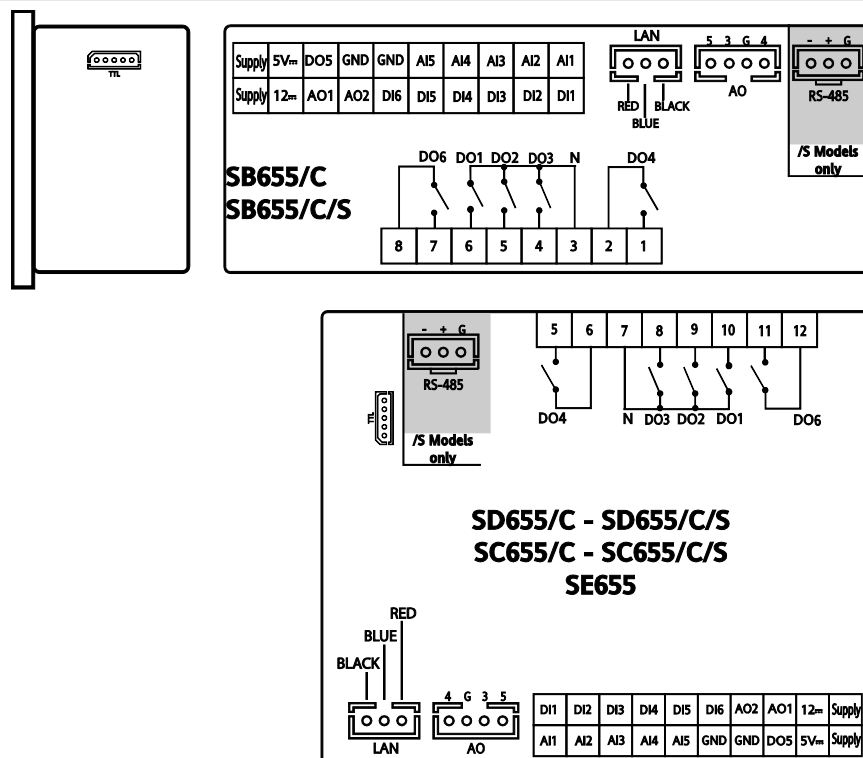


- 6 digital inputs [DI1...DI6] • DI
- 5 high voltage digital outputs 2A 250Vac • DO
- 5 analogue outputs • AO:
 - o 2 PWM analogue outputs [AO1, AO2]
 - o 3 low voltage (SELV (§)) analogue outputs
 - 2 outputs [AO3-4] 0-10V
 - 1 output [AO5] 4...20mA/0...20mA
- 5 analogue inputs [AI1...AI5]
- 1 low voltage digital output (SELV (§)) [DO5]
 - o Open Collector

Model /S RS-485 on board

- /C RTC supplied as standard
- Serial LAN Connection to terminal / SE6xx (max. 100m)
- TTL serial to connect to Multi Function Key
- (§) SELV: (SAFETY EXTRA LOW VOLTAGE)


636/C/S models

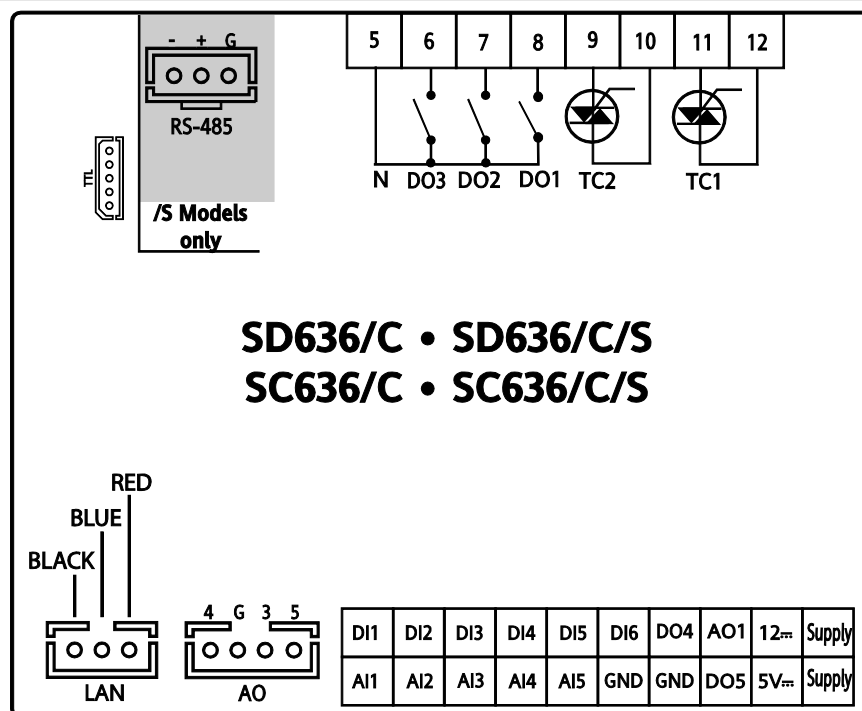

- 6 digital inputs [DI1...DI6] • DI
- 3 high voltage digital outputs 2A 250Vac • DO
- 6 analogue outputs • AO:
 - o 2 high voltage [TC1, TC2] 3A 250Vac analogue outputs
 - o 1 PWM analogue output [AO1]
 - o 3 low voltage (SELV (§)) analogue outputs
 - 2 outputs [AO3-4] 0-10V
 - 1 output [AO5] 4...20mA/0...20mA
- 5 analogue inputs [AI1...AI5]
- 2 low voltage digital outputs (SELV (§)) [DO4, DO5]
 - o Open Collector

Model /S RS-485 on board


- /C RTC supplied as standard
- Serial LAN Connection to terminal / SE6xx (max. 100m)
- TTL serial to connect to Multi Function Key
- (§) SELV: (SAFETY EXTRA LOW VOLTAGE)

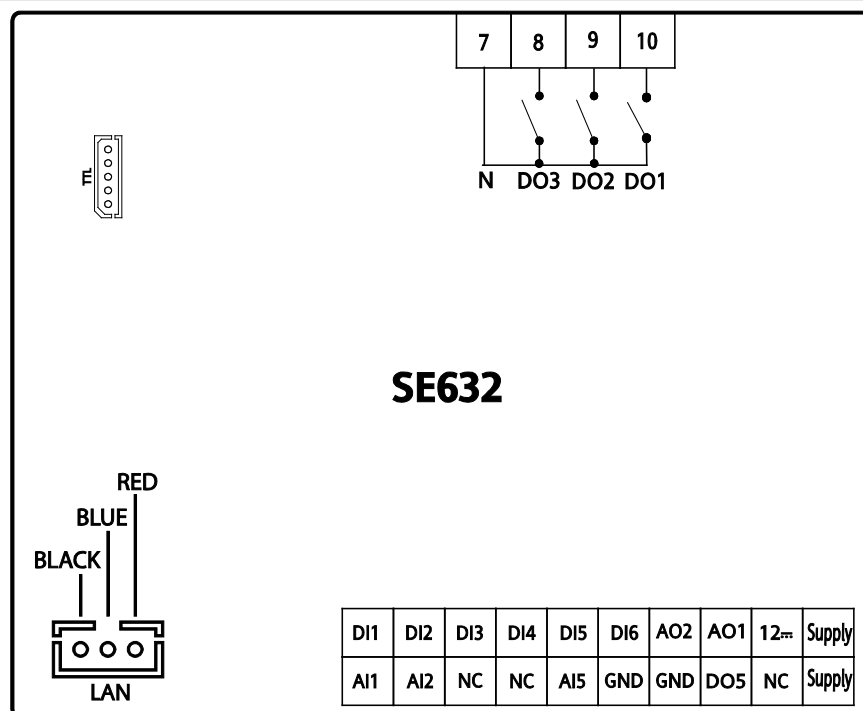


- 6 digital inputs [DI1...DI6] • DI
 - 3 high voltage digital outputs 2A 250Vac • DO
 - 2 analogue outputs • AO:
 - o 2 PWM analogue outputs [AO1, AO2]
 - 3 analogue inputs [AI1, AI2, AI5]
 - 1 low voltage digital output (SELV (§)) [DO5]
 - o Open Collector
- Serial LAN Connection to terminal / SE6xx (max. 100m)
 - TTL serial to connect to Multi Function Key

3.2.2 Example of low voltage input/output connection

3.2.2.1 Example of current/voltage input connection

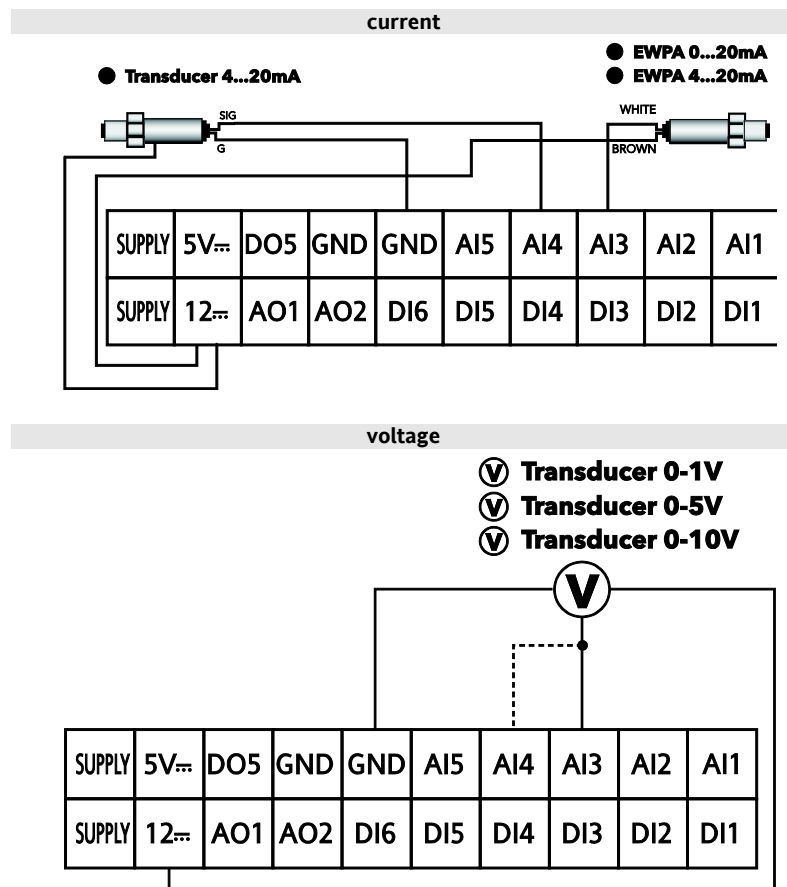


3.2.3 Example of NTC/DI input connection

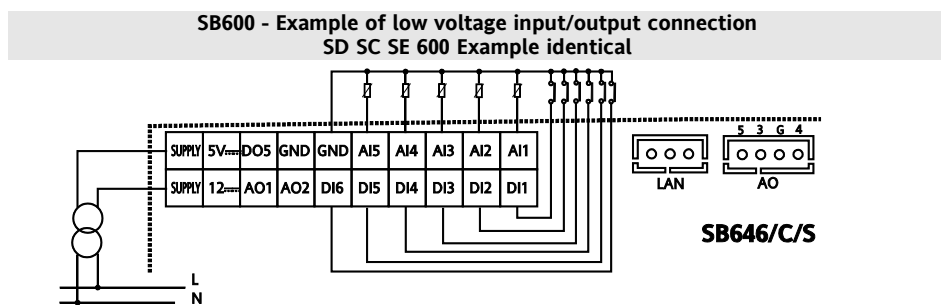


Analogue outputs AO see chapter System configuration (folder Par/CF) paragraph Configuration of analogue outputs
DO5 digital output see Digital Output Configuration
LAN: see remote keypad/SE600 connection

3.2.3.2 Example of AO1 / AO2 connection

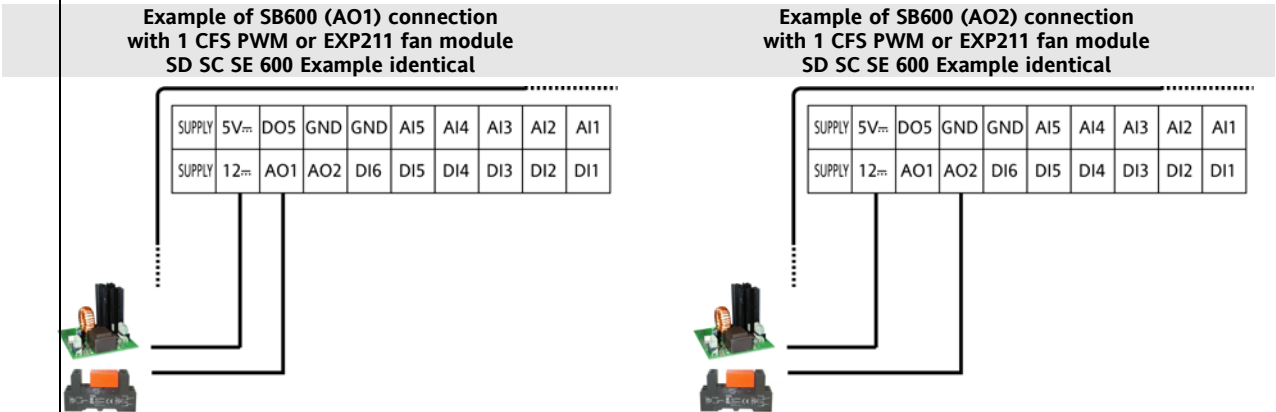


3.2.3.3 Example of AO3 - AO4 connection

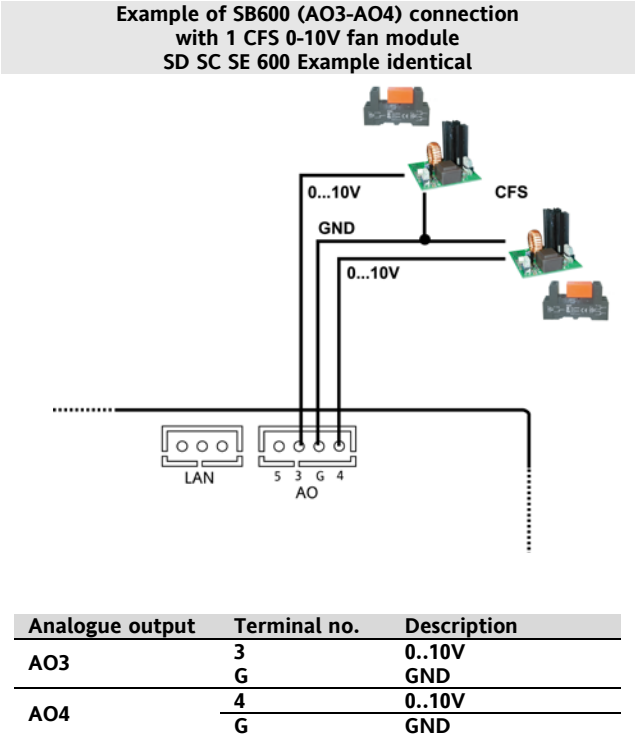


3.2.3.4 Example of AO5 connection

Example of SB600 (AO5) connection
with 1 fan module CFS 0...20mA / 4...20mA
SD SC SE 600 Example identical

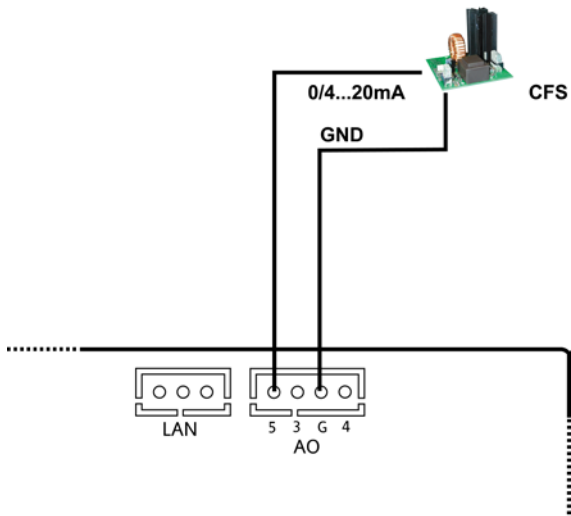


Analogue output	Terminal no.	Description
AO5	5	0...20mA / 4...20mA
	G	GND

3.2.3.5 Example of DO5 connection

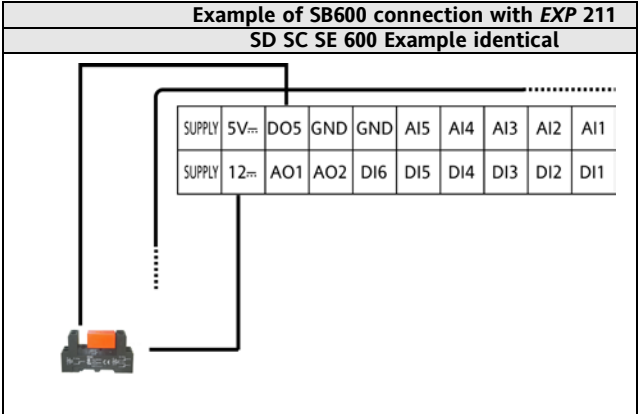


3.2.4 Example of connection of high voltage outputs

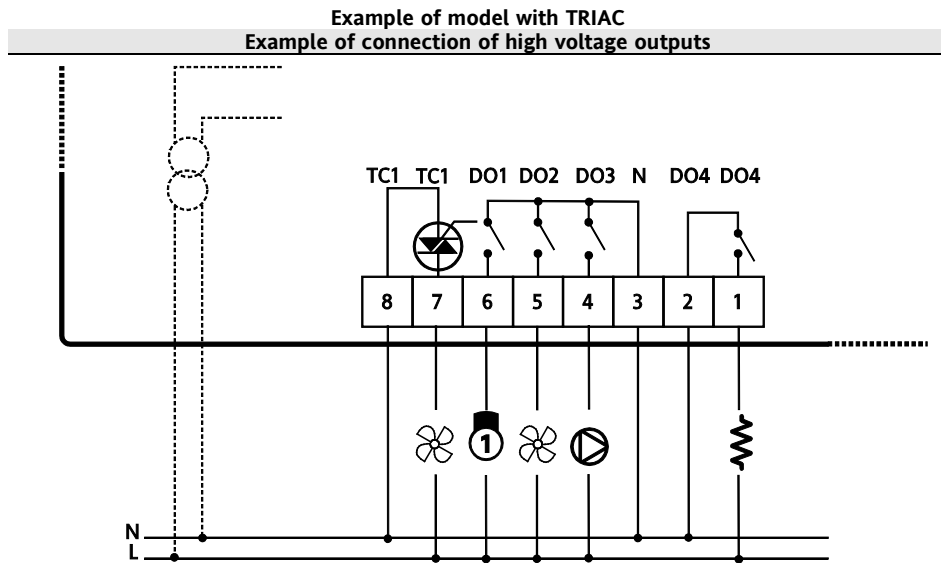

3.3 Network connection examples


3.3.1 Example of connection SB600 – SE600

SB600 → SE600

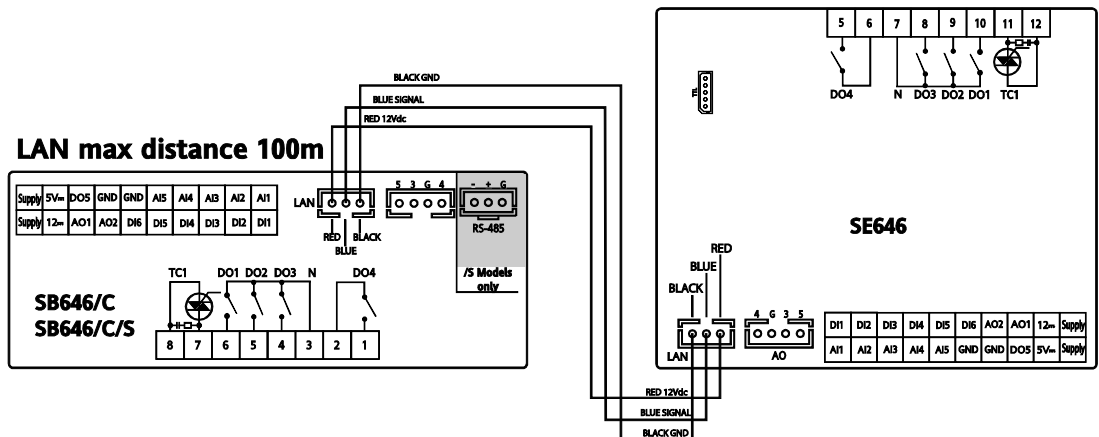


3.3.2 Example of connection SD600/SC600 – SE600

SD600 / SC600 → SE600

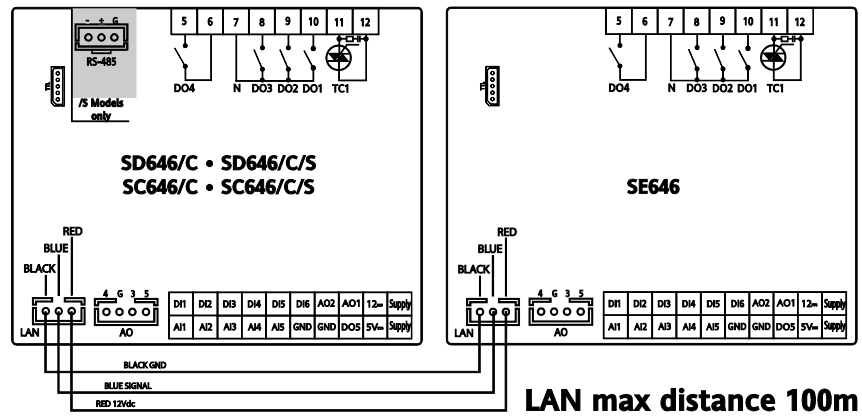


3.3.3 Example of connection SC600 – SKP 10

SC600 → SKP 10

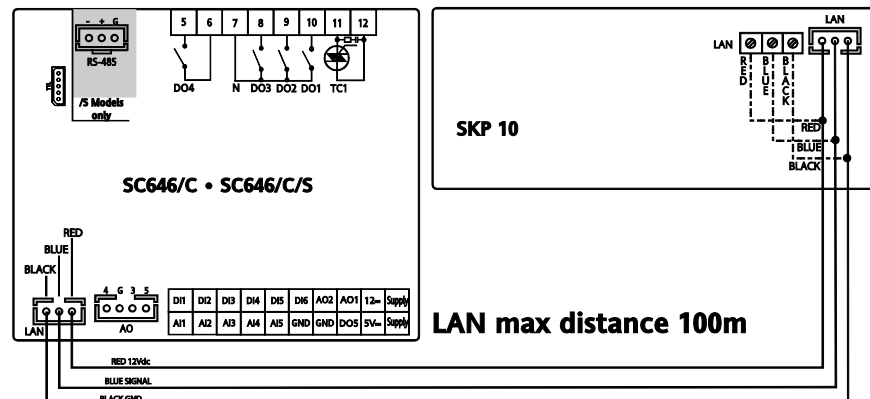

Description
GND / black
Signal / blue
12Vdc power supply from base module


3.3.4 SKW22(L) Remote, wall-mounted LCD terminal

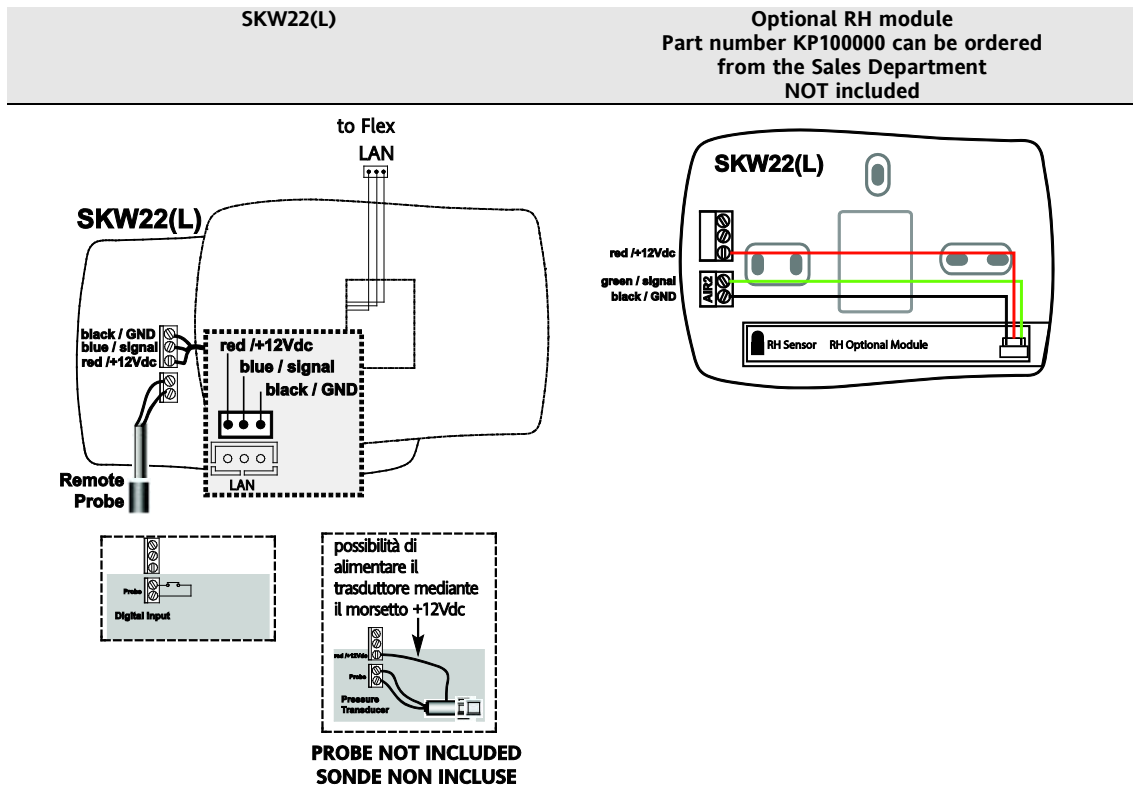

Flex	SKW22(L)	Description
AIR1	GND / black Signal / Blue +12Vdc / red**	NTC on-board analogue input GND / black Signal / blue 12Vdc power supply from Flex
AIR2	Remote Probe	Probe AIR2 remote analogue input configurable as NTC* / 4...20mA / DI

**The transducer can be powered from the +12Vdc terminal.

3.3.5 SKP22(L) Remote, panel-mounted LCD terminal

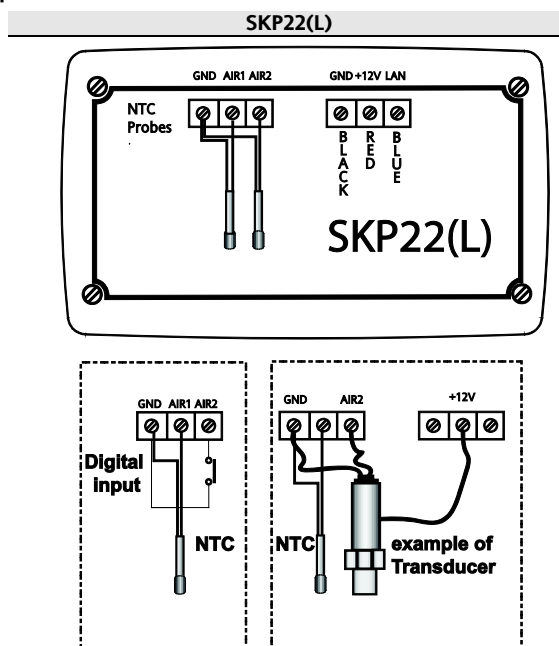


Flex	SKP222(L)	Description
AIR1	AIR1	NTC/DI integrated analogue input
AIR2	Remote Probe	Remote analogue input configurable as NTC*/ 4...20mA / DI
	GND	Ground
	GND / black	GND / black
	Signal / Blue	Signal / blue
	+12Vdc /red**	12Vdc power supply from Flex


****The transducer can be powered from the +12Vdc terminal.**

3.3.6 Example of connection SC600 – SE600 – SKP10 – LCD terminal


connection SC600 - SE600 - SKP10 – LCD terminal

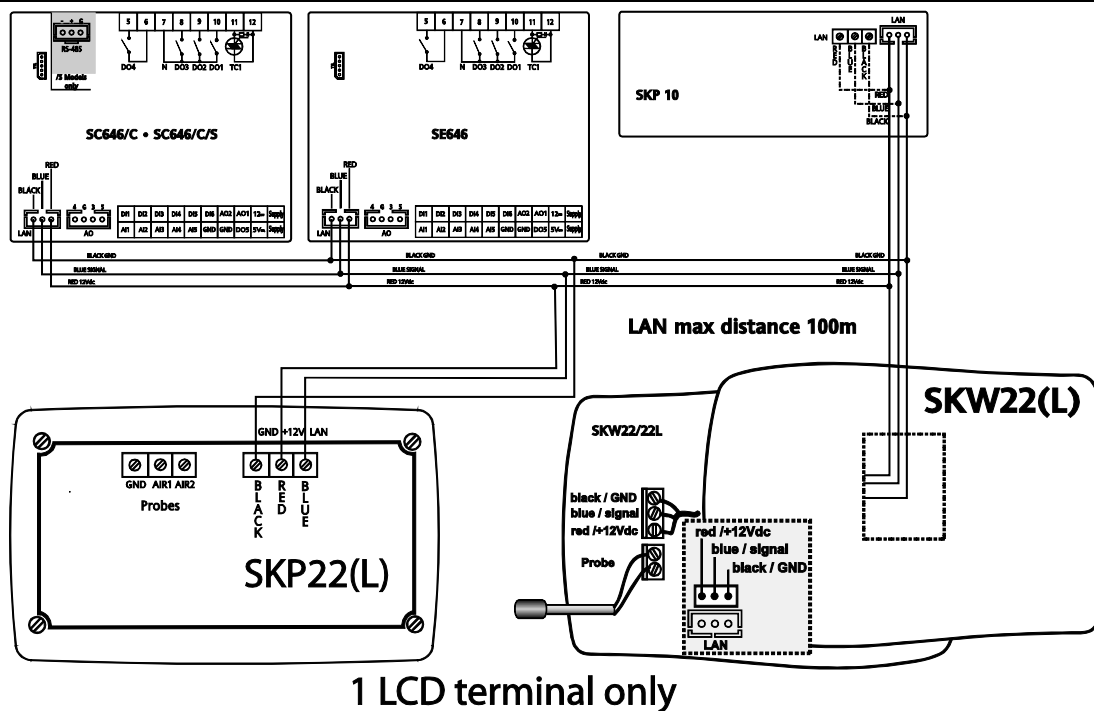

3.3.7 SKP20 Terminal

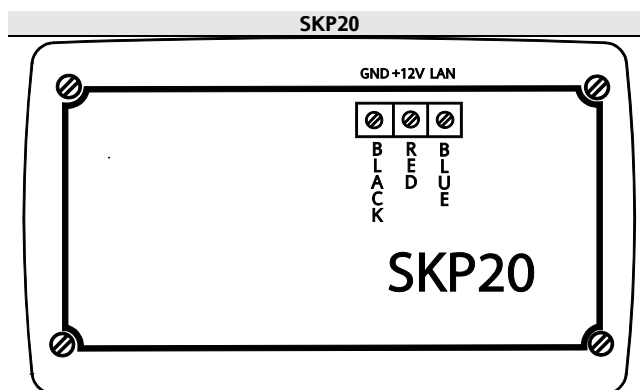

3.3.8 3.3.8 Example of connection SC600 – SE600 – SKP10 – LCD terminal SKP20

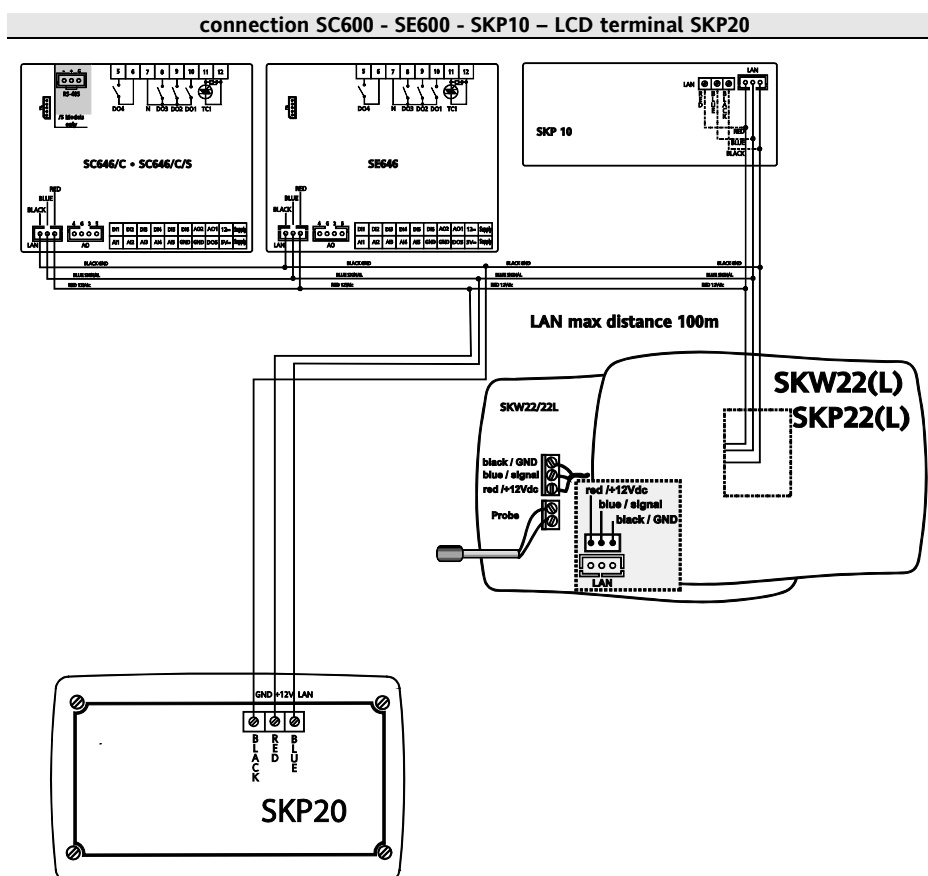

Flex - SKP20 Network

SKP20 and SKW22/SKP22 work in 'echo' mode. Both can be present in LAN network. Any change on SKW22/SKP22 has effect on SKP20 display and viceversa.

4 TECHNICAL DATA

4.1 General Specifications

	Standard	Min.	Max.
Power supply voltage Models 63x 64x	12-24V~		
Power supply voltage Models 65x	12-24V~ /24V=		
Power supply frequency:	50Hz/60Hz	---	---
Consumption SB600 SD600 SC600	6VA / 4W	---	---
Consumption SE600	5VA /3.5W	---	---
Insulation class	2	---	---
Working temperature	25°C	-20°C	55°C
Operating environment humidity (non-condensing)	30%	10%	90%
Storage temperature	25°C	-40°C	85°C
Ambient storage humidity (non-condensing)	30%	10%	90%

Classification	
The product complies with the following harmonized standards:	EN 60730-2-6 EN 60730-2-9
Use	operating device (non-safety) to be incorporated
Mounting	panel or on DIN Omega bar support
Type of action	1.C 1.Y
Pollution class	2
Over voltage category	II
Nominal pulse voltage	2500V
Digital outputs	refer to the label on the device
Fire resistance category	D
Software class	A

4.2 I/O features

Type and Label	Description	SB SC SD			Expansions SE		
		636	646	655	632	646	655
Digital inputs DI1 DI2 DI3 DI4 DI5 DI6	6 no-voltage digital inputs Closing current for ground: 0.5mA	x	x	x	x	x	x
Digital outputs High voltage DO1 DO2 DO3 DO4*	3 x 2A 250V~ relays; For 36xx models, D04 is available as an Open Collector (OC) output. Relay output lifetime at nominal rating: 100,000 cycles	OC	x	x	DO1 DO2 DO3	x	x
DO6	1 x 2A 250V~ relay; Lifetime of outputs on relays at nominal capacity: 100,000 cycles			x			x
Analogue output High voltage TC1	1 2A TRIAC, max 250V~ Resolution: 1% Remote control switches are NOT permitted downstream from the TRIAC		x			x	
TC1 + TC2 (= AO2)	2 x 3A TRIAC, max 250V Resolution: 1% Remote control switches are NOT permitted downstream from the TRIAC	x					
Analogue outputs O.C. PWM/PPM non-dangerous voltage SELV analogue outputs AO1 AO2	2 outputs Open Collector PWM/PPM Resolution: 2% Nominal range 0...16.9V _{rms} (12V~ rectified) Closing at 12V _{rms} ** Max. current 35mA (min. load of 340Ohm @12VDC)	AO2 = TC2 (TRIAC)	x	x	x	x	x
Non-dangerous voltage SELV analogue outputs AO3 AO4	0...10VDC output, max 28mA*** @10V (min. load resistance 360 Ohm) Accuracy 2% f.s. Resolution: 1%	x	x	x		x	x

		SB SC SD			Expansions SE		
Type and Label	Description	636	646	655	632	646	655
AO5	1 x 4...20mA / 0...20mA output 2% full scale accuracy Resolution: 1% • 0/4...20mA output, max load (max load resistance 350Ohm)***	x	x	x		x	x
Analogue inputs AI1 AI2 AI3 AI4 AI5	3 configurable inputs: a) NTC temperature 103AT 10kΩ, measurement range -50°C ÷ 99.9°C; b) No voltage digital input 2 configurable inputs: a) NTC temperature 103AT 10kΩ, measurement range -50°C ÷ 99.9°C. b) 4...20 mA current input/0-10V/0-5V/0-1V voltage input measurement range -50.0 ÷ +99.9; Accuracy: 1% full scale (2% full scale for 0-1V voltage input) Resolution: (a) 0.1°C (b) 0.1°C/bar Input impedance (b): • 0-10V and 0-5V: 21KOhm • 0-1V: 10KOhm • 4...20mA: 100Ohm c) No voltage digital input	x	x	x	AI1 AI2 AI5	x	x
Open Collector non-dangerous voltage SELV digital output DO4*, DO5	2 x Open Collector outputs ** Max. current 35mA @12VDC	x					
DO5	1 Open Collector output ** Max. current 35mA @12VDC	x	x	x	x	x	x

*On 636 models, DO4 is an open collector, **TC2 equals AO2 (TC2=AO2)** - see chapter entitled **Physical I/O Configuration (PAr/CL..Cr folder)**.

** Outputs AO1, AO2 and DO5 (typically connected to the device's auxiliary 12V= output) cannot deliver more than **70mA** in total. Any other loads connected to the same 12V= auxiliary output must also be taken into account.

If the Echo **SKP** keypad is connected to the device, the current becomes **55mA**.

***Outputs AO3, AO4 and AO5 cannot deliver more than 40mA total.



4.3 Mechanical technical data

Type	Description	Model
Terminals and connectors	1 8-way high voltage male connector For use in combination with the supplied female connector	All models
	1 x 20-way snap-on low voltage connector For use in combination with COLV0000E0100	All models
	1 JST 3-way LAN connector To be used with COLV000033200	All models
	1 JST 4-way connector To be used with COLV000042100	All models
	1 JST 3-way connector To be used with COLV000035100	/S models
Container	Container: PC+ABS plastic resin with V0 extinguishing classification	All models

4.4 Display and LEDs

Type	Label	Description	Model
Display and LEDs		4 digits or 3 digits + sign 18 LEDs	All models except SC600 SE600
Keys	UP DOWN set esc	4 keys	All models except SC600 SE600

4.5 Serial ports

Label	Description	Model
TTL	1 TTL serial to connect CopyCard (MFK) or Personal Computer via interface module	All models
RS-485	RS-485 opto-isolated serial	/S models
LAN	Connection to remote terminal / SE6xx (max. 100m)	All models

4.6 Transformer

The instrument must be connected to a suitable current transformer with the following features:

- Primary voltage: Depending on requirements of the individual device and/or country of installation
- Secondary voltage: 12V~
- Power supply frequency: 50/60Hz
- Power: 6VA min. (/S models), 5VA (all other models)

4.7 Mechanical dimensions

	Length (L) mm	Depth (d) mm	Height (H) mm	Notes
Front panel SB600 SK10	76.4	//	35	(+0.2mm)
Front (cover) SD600 SC600 SE600	70	//	45	(+0.2mm)
Dimensions SB600	86	76 connectors excluded	26	
Dimensions SD600 SC600 SE600	70.2	61.6	87	4DIN
		56.4 from Din bar to cover		
Hole for panel-mounting SB600 SKP10	71	//	29	(+0.2mm / -0.1mm)

4.8 Permitted use

This device was designed to control centralised air conditioning systems.

For safety reasons, the device must be installed and used in accordance with the instructions provided. In particular, parts carrying dangerous voltages must not be accessible under normal conditions.

The device must be adequately protected from water and dust with regard to the application, and must only be accessible using tools (with the exception of the front panel).

The device is suitable for use in household refrigeration appliances and/or similar equipment and has been tested for safety aspects in accordance with the harmonized European reference standards.

4.9 Improper Use

Any use other than that expressly permitted is prohibited.

The supplied relay contacts and in general all outputs are of the functional type and subject to failure (since they are electronically controlled they are prone to short-circuiting or remaining open). Any protection devices specified in product standards or suggested by common sense for obvious safety requirements must be installed externally to the device.

Eliwell is not liable for damage caused by:

- unspecified installation/use and, in particular, in contravention of the safety requirements of established legislation or specified in this document
- use on equipment which does not provide adequate protection against electric shock, water and dust in the actual installation conditions
- use on equipment which allows tool free access to dangerous components
- installation/use on equipment which does not comply with established legislation and standards.

4.10 Disclaimer

This document is the exclusive property **Eliwell Controls srl** and may not be reproduced or circulated unless expressly authorised by **Eliwell Controls srl** itself.

All due care has been taken in preparing this document. However **Eliwell Controls srl** can take no responsibility for its use.

4.11 Disposal



The equipment (or product) must be subjected to separate waste collection in compliance with the local legislation on waste disposal.



5 SYSTEM CONFIGURATION (FOLDER PAR/CL)

Before doing anything, make sure the device is connected to a suitable external transformer. The following rules must be followed when connecting cards to each other and to the application:

- Loads that exceed the maximum limits set forth in this manual/product label must not be applied to outputs.
- When connecting loads, follow connection diagrams carefully.
- To avoid electric pairings, wire all low SELV (°) utilities separately from high voltage ones.

(°) SELV: SAFETY EXTRA LOW VOLTAGE

Instrument configuration is determined by the values of the parameters associated with the inputs and outputs.

5.1 Configuration of analogue inputs

SBA600 SDA600
SCA600
analogue inputs

There are a total of 5 analogue inputs referred to below as AiL1...AiL5.

Using the parameters, a physical resource (probe, digital input, voltage/current signal) can be “physically” associated with each type of input

5.1.1 Configuration of SE600 expansion analogue inputs

SE600 analogue
inputs

There are a total of 5 analogue inputs referred to below as AiE1...AiE5.

Using the parameters, a physical resource (probe, digital input, voltage/current signal) can be “physically” associated with each type of input

5.1.2 Configuration of Terminals Analogue Inputs SKW22(L)/SKP22(L)

Analogue Inputs
SKW22(L)/SKP22(L)

There are a total of 2 analogue inputs referred to below as AIR1...AIR2.

Using the parameters, a physical resource (probe, digital input, voltage/current signal) can be “physically” associated with each type of input

A “logical” meaning can also be associated with each analogue input using the relevant parameter.

Inputs can be “physically” configured as specified in the table below.

Analogue inputs:
configuration
table

Parameter	Description	Value						
		0	1	2	3	4	5	6
CL00	AiL1 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
CL01	AiL2 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
CL02	AiL3 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	4-20 mA	0-10 V	0-5 V	0-1 V
CL03	AiL4 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	4-20 mA	0-10 V	0-5 V	0-1 V
CL04	AiL5 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
CE00	AiE1 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
CE01	AiE2 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
CE02	AiE5 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	4-20 mA	0-10 V	0-5 V	0-1 V
CE03	AiE4 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	4-20 mA	0-10 V	0-5 V	0-1 V
CE04	AiE5 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	//	//	//	//
Parameter	Description	Value						
		0	1	2	3			
Cr00	Air1 analogue input type	Probe not configured	//	NTC probe	//			
Cr01	Air2 analogue input type	Probe not configured	Probe configured as voltage-free digital input	NTC probe	4...20mA			
			See Configuration of Digital Inputs					

NOTE: // indicates that value is not present.

Analogue input AI	Parameter	range	Description
AiL3	CL10	CL11...99.9	AiL3 analogue input full scale value
AiL3	CL11	-50.0...CL10	AiL3 analogue input start of scale value
AiL4	CL12	CL13...99.9	AiL4 analogue input full scale value
AiL4	CL13	-50.0...CL12	AiL4 analogue input start of scale value
AiE3	CE10	CE11...99.9	AiE3 analogue input full scale value
AiE3	CE11	-50.0...CE10	AiE3 analogue input start of scale value
AiE4	CE12	CE13...99.9	AiE4 analogue input full scale value
AiE4	CE13	-50.0...CE12	AiE4 analogue input start of scale value
Air2	Cr10	CR11...99.9	Air2 analogue input full scale value
Air2	Cr11	-50.0...Cr10	Air2 analogue input start of scale value

The values read by analogue inputs can be calibrated using parameters CL20...CL24 / Cr20...Cr21

Parameter	Description	Unit of Measure	range
CL20	AiL1 analogue input differential	°C	-12.0...12.0
CL21	AiL2 analogue input differential	°C	-12.0...12.0
CL22	AiL3 analogue input differential	°C / Bar	-12.0...12.0
CL23	AiL4 analogue input differential	°C / Bar	-12.0...12.0
CL24	AiL5 analogue input differential	°C	-12.0...12.0
CE20	AiE1 analogue input differential	°C	-12.0...12.0
CE21	AiE2 analogue input differential	°C	-12.0...12.0
CE22	AiE3 analogue input differential	°C / Bar	-12.0...12.0
CE23	AiE4 analogue input differential	°C / Bar	-12.0...12.0
CE24	AiE5 analogue input differential	°C	-12.0...12.0
Parameter	Description	Unit of Measure	range
Cr20	Air1 analogue input differential	°C	-12.0...12.0
Cr21	Air2 analogue input differential	°C / Bar	-12.0...12.0

Study the following tables:

Table A – parameter association - analogue input configuration

Parameter	Description	value	Description	Notes
CL30	AiL1 analogue input configuration	0...16	See Table B	If CL00=1 (AiL1 configured as DI), set CL30=0
CL31	AiL2 analogue input configuration	0...16	See Table B	If CL01=1 (AiL2 configured as DI) set CL31=0
CL32	AiL3 analogue input configuration	0...30	See Table B	If CL02=1 (AiL3 configured as DI) set CL32=0
CL33	AiL4 analogue input configuration	0...30	See Table B	If CL03=1 (AiL4 configured as DI) set CL33=0
CL34	AiL5 analogue input configuration	0...16	See Table B	If CL04=1 (AiL5 configured as DI) set CL34=0
CE30	AiE1 analogue input configuration	0...16	See Table B	If CE00=1 (AiE1 configured as DI), set CE30=0
CE31	AiE2 analogue input configuration	0...16	See Table B	If CE01=1 (AiE2 configured as DI) set CE31=0
CE32	AiE3 analogue input configuration	0...30	See Table B	If CE02=1 (AiE3 configured as DI) set CE32=0
CE33	AiE4 analogue input configuration	0...30	See Table B	If CE03=1 (AiE4 configured as DI) set CE33=0
CE34	AiE5 analogue input configuration	0...16	See Table B	If CE04=1 (AiE5 configured as DI) set CE34=0
Parameter	Description	value	Description	Notes
CR30	Air1 analogue input configuration	0...16	See Table B	
CR31	Air2 analogue input configuration	0...30	See Table B	If CR01=1 (AIR2 configured as DI), set CR31=0

Table B – analogue input logical meaning & parameter values CL30...CL34 / CR30, CR31

AiL analogue input	AiL analogue input Remote terminal	Value	Description
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	0	Input disabled
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	1	Water/air inlet temperature internal exchanger
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	2	Water/air outlet temperature internal exchanger
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	3	Water outlet temperature internal exchanger circuit 1
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	4	Water outlet temperature internal exchanger circuit 2
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	5	External exchanger temperature circuit 1
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	6	External exchanger temperature circuit 2
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	7	Water inlet temperature recovery (or external) exchanger
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	8	Water outlet temperature recovery (or external) exchanger
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	9	External temperature
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	10	Internal ambient temperature
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	11	Sanitary water temperature
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	12	Compressor 1 discharge temperature
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	13	NOT USED
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	14	NOT USED
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	15	NOT USED
AiL1 AiL2 AiL3 AiL4 AiL5 AiE1 AiE2 AiE3 AiE4 AiE5	AIR1 AIR2	16	Temperature display
		17	NOT USED
		18	NOT USED
		19	NOT USED
		20	NOT USED
AiL3 AiL4 AiE3 AiE4	AIR2	21	High pressure input circuit 1
AiL3 AiL4 AiE3 AiE4	AIR2	22	High pressure input circuit 2
AiL3 AiL4 AiE3 AiE4	AIR2	23	Low pressure input circuit 1
AiL3 AiL4 AiE3 AiE4	AIR2	24	Low pressure input circuit 2
AiL3 AiL4 AiE3 AiE4	AIR2	25	Input for dynamic setpoint
AiL3 AiL4 AiE3 AiE4	AIR2	26	Internal exchanger pressure circuit 1
AiL3 AiL4 AiE3 AiE4	AIR2	27	Internal exchanger pressure circuit 2
AiL3 AiL4 AiE3 AiE4	AIR2	28	External exchanger pressure circuit 1
AiL3 AiL4 AiE3 AiE4	AIR2	29	External exchanger pressure circuit 2
AiL3 AiL4 AiE3 AiE4	AIR2	30	Pressure display

Digital inputs

5.2 Digital Input Configuration

There are a total of 6 no voltage digital inputs referred to below as DI1...DI6 and DIE1...DIE6. These can be added to by AiL1...AiL5 if the latter are configured as digital inputs (via parameters CL50...CL54+Cr50 respectively).

Study the following tables:

Table A – parameter association - configuration of digital inputs

Parameter	Description	value	Description	Notes
CL40	DIL digital input configuration 1	-58...+58	See Table B	
CL41	DIL digital input configuration 2	-58...+58	See Table B	
CL42	DIL digital input configuration 3	-58...+58	See Table B	
CL43	DIL digital input configuration 4	-58...+58	See Table B	
CL44	DIL digital input configuration 5	-58...+58	See Table B	
CL45	DIL digital input configuration 6	-58...+58	See Table B	
CL50	AiL analogue input configuration 1 when configured as digital input	-58...+58	See Table B	Set to 0 if AiL1 is NOT configured as a DI
CL51	AiL analogue input configuration 2 when configured as digital input	-58...+58	See Table B	Set to 0 if AiL2 is NOT configured as a DI
CL52	AiL analogue input configuration 3 when configured as digital input	-58...+58	See Table B	Set to 0 if AiL3 is NOT configured as a DI
CL53	AiL analogue input configuration 4 when configured as digital input	-58...+58	See Table B	Set to 0 if AiL4 is NOT configured as a DI
CL54	AiL analogue input configuration 5 when configured as digital input	-58...+58	See Table B	Set to 0 if AiL5 is NOT configured as a DI
CE40	DIE digital input configuration 1	-58...+58	See Table B	
CE41	DIE digital input configuration 2	-58...+58	See Table B	
CE42	DIE digital input configuration 3	-58...+58	See Table B	
CE43	DIE digital input configuration 4	-58...+58	See Table B	
CE44	DIE digital input configuration 5	-58...+58	See Table B	
CE45	DIE digital input configuration 6	-58...+58	See Table B	
CE50	AiE analogue input configuration 1 when configured as digital input	-58...+58	See Table B	Set = 0 if AiE1 is NOT configured as DI
CE51	AiE analogue input configuration 2 when configured as digital input	-58...+58	See Table B	Set = 0 if AiE2 is NOT configured as DI
CE52	AiE analogue input configuration 3 when configured as digital input	-58...+58	See Table B	Set = 0 if AiE3 is NOT configured as DI
CE53	AiE analogue input configuration 4 when configured as digital input	-58...+58	See Table B	Set = 0 if AiE4 is NOT configured as DI
CE54	AiE analogue input configuration 5 when configured as digital input	-58...+58	See Table B	Set = 0 if AiE5 is NOT configured as DI
Parameter	Description	value	Description	Notes
Cr50	AIR analogue input configuration 2 when configured as digital input	-58...+58	See Table B**	Set to 0 if AIR2 is NOT configured as a DI

Digital inputs: configuration table

Table B - Digital inputs: configuration table

Polarity is defined as indicated below:

	Value	Description
+	Positive	Active when contact closed
-	Negative	Active when contact open

Value	Description	Notes
0	Input disabled	
±1	Remote STD-BY	Remote mode changeover: to obtain the correct sequence STD-BY – DHW, enable 2 D.I. and configure one as STD-BY and the other as DHW (±28) If you enable only 1 D.I. in STD-BY and the machine is in DHW mode, it may occur that the from D.I. the status transitions to HEAT
±2	Remote off	Local ON/OFF ineffective
±3	Remote Summer/Winter	
±4	Power step 1 request	
±5	Power step 2 request	
±6	Power step 3 request	
±7	Power step 4 request	
±8	Digital input heat step 1 request	See also digital temperature control
±9	Digital input heat step 2 request	See also digital temperature control
±10	Digital input heat step 3 request	See also digital temperature control
±11	Digital input heat step 4 request	See also digital temperature control
±12	Digital input cool step 1 request	See also digital temperature control
±13	Digital input cool step 2 request	See also digital temperature control
±14	Digital input cool step 3 request	See also digital temperature control
±15	Digital input cool step 4 request	See also digital temperature control
±16	Block compressor 1	

Value	Description	Notes
±17	Block compressor 2	
±18	Block compressor 3	
±19	Block compressor 4	
±20	Block heat pump	See section Block heat pump (folder PAr/HP)
±21	Power stage forced to 50%	See section Forced power stage (folder PAr/PL)
±22	Economy input	See section Operating modes - Temperature control (folder PAr/tr)
±23	NOT USED	
±24	General alarm	
±25	End of defrost C1	
±26	End of defrost C2	
±27	NOT USED	
±28	Remote AS	
±29	NOT USED	
±30	High pressure pressure switch C1	
±31	High pressure pressure switch C2	
±32	Low pressure pressure switch C1	
±33	Low pressure pressure switch C2	
±34	Compressor 1 oil pressure switch	
±35	Compressor 2 oil pressure switch	
±36	Compressor 3 oil pressure switch	
±37	Compressor 4 oil pressure switch	
±38	NOT USED	
±39	External exchanger fan thermal switch C1	
±40	External exchanger fan thermal switch C2	
±41	Primary exchanger fan thermal switch	
±42	NOT USED	
±43	Compressor 1 thermal switch	
±44	Compressor 2 thermal switch	
±45	Compressor 3 thermal switch	
±46	Compressor 4 thermal switch	
±47	Internal circuit pump 1 thermal switch	
±48	Internal circuit pump 2 thermal switch	
±49	External circuit pump thermal switch	
±50	Internal exchanger electric heater 1 thermal switch	
±51	Internal exchanger electric heater 2 thermal switch	
±52	Auxiliary output alarm	
±53	NOT USED	
±54	NOT USED	
±55	Primary circuit flow switch	
±56	External circuit flow switch	
±57	NOT USED	
±58	Display	

N.B.: If more than one digital input in the table is configured with the same value, the function is activated when the input with the highest index is piloted.

Digital Outputs

5.3 Digital output configuration

See the section on Electric Connections for the number and capacity of relays/open collectors and for information on the symbols used on labels supplied with the device.

- High voltage outputs (relays) are identified as DO1, DO2, DO3, DO4 and DO6.
- The low voltage (SELV), open collector output is called DO5.

All digital outputs can be configured as outlined in the table below:

Table A – parameter association - output configuration

Parameter	Description	value	Description	Notes
CL90	DOL1 digital output configuration	-53...+53	See Table B	Present in all models
CL91	DOL2 digital output configuration	-53...+53	See Table B	Present in all models
CL92	DOL3 digital output configuration	-53...+53	See Table B	Present in all models
CL93	DOL4 digital output configuration	-53...+53	See Table B	Present in all models
CL94	DOL5 digital output configuration	-53...+53	See Table B	Present in all models (Open Collector Output)
CL95	DOL6 digital output configuration	-53...+53	See Table B	Present in models with 5 relays
CL96	AOL1 <u>digital</u> output configuration	-53...+53	See Table B	See Table A – Analogue Outputs and Models (Applies if CL71=0, set CL80 appropriately)
CL97	AOL2 <u>digital</u> output configuration	-53...+53	See Table B	See Table A – Analogue Outputs and Models (Applies if CL72=0, set CL81 appropriately)
CE90	DOE1 digital output configuration	-53...+53	See Table B	Present in all models
CE91	DOE2 digital output configuration	-53...+53	See Table B	Present in all models
CE92	DOE3 digital output configuration	-53...+53	See Table B	Present in all models
CE93	DOE4 digital output configuration	-53...+53	See Table B	Present in all models
CE94	DOE5 digital output configuration	-53...+53	See Table B	Present in all models (Open Collector Output)
CE95	DOE6 digital output configuration	-53...+53	See Table B	Present in models with 5 relays
CE96	AOE1 <u>digital</u> output configuration	-53...+53	See Table B	See Table A – Analogue Outputs and Models (Applies if CE71=0, set CE80 appropriately)
CE97	AOE2 <u>digital</u> output configuration	-53...+53	See Table B	See Table A – Analogue Outputs and Models (Applies if CE72=0, set CE81 appropriately)

Table B - Outputs: configuration table

Polarity is defined as indicated below:

	Value	Description
+	Positive	Active when contact closed
-	Negative	Active when contact open

Value	Description	Type
0	Output disabled	Digital
±1	Compressor 1	Digital
±2	Compressor 2	Digital
±3	Compressor 3	Digital
±4	Compressor 4	Digital
±5	Reversal valve circuit 1	Digital
±6	Reversal valve circuit 2	Digital
±7	Pump-down Valve circuit 1	Digital
±8	Pump-down Valve circuit 2	Digital
±9	Sanitary water valve	Digital
±10	NOT USED	Digital
±11	NOT USED	Digital
±12	NOT USED	Digital
±13	NOT USED	Digital
±14	Water pump 1 exceeded signal	Digital
±15	Water pump 2 exceeded signal	Digital
±16	Water pump operation	Digital
±17	NOT USED	Digital
±18	Recirculation fan	Digital
±19	Fan external exchanger Circuit 1	Digital
±20	Fan external exchanger Circuit 2	Digital
±21	NOT USED	Digital

Value	Description	Type
±37	NOT USED	Digital
±38	Boiler 2	Digital
±39	NOT USED	Digital
±40	NOT USED	Digital
±41	NOT USED	Digital
±42	NOT USED	Digital
±43	NOT USED	Digital
±44	NOT USED	Digital
±45	NOT USED	Digital
±46	NOT USED	Digital
±47	NOT USED	Digital
±48	NOT USED	Digital
±49	NOT USED	Digital
±50	NOT USED*	Digital
±51	NOT USED*	Digital
±52	NOT USED*	Digital
±53	NOT USED*	Digital
±54	NOT USED	Digital
±55	NOT USED	Digital
±56	Fan external exchanger circuit 1	Analogue
±57	Fan external exchanger circuit 2	Analogue
±58	Water heater	Analogue

Value	Description	Type
±22	Auxiliary output conditional on defrosting	Digital
±23	Electrical heater 1 internal exchanger	Digital
±24	Electrical heater 2 internal exchanger	Digital
±25	Electrical heater external exchanger 1	Digital
±26	Electrical heater external exchanger 2	Digital
±27	Auxiliary output	Digital
±28	Electric heater Domestic Hot Water	Digital
±29	Operating hours exceeded	Digital
±30	Water heater	Digital
±31	Alarm	Digital
±32	EEV 1 ON command	Digital
±33	EEV 2 ON command	Digital
±34	Compressor Inverter 1 (only for single circuit and single compressor units)	Digital
±35	NOT USED	Digital
±36	NOT USED	Digital

Value	Description	Type
±59	Water pump 1 modulating internal circuit	Analogue
±60	Water pump 2 modulating internal circuit	Analogue
±61	NOT USED	Analogue
±62	Analogue stage 1 for compressor	Analogue
±63	Analogue stage 2 for Compressor	Analogue
±64	NOT USED	Analogue
±65	NOT USED	Analogue
±66	Analogue stage 1 for Compressor Inverter	Analogue
±67	NOT USED	Analogue
±68	NOT USED	Analogue
±69	NOT USED	Analogue
±70	NOT USED*	Digital
±71	NOT USED*	Digital
±72	NOT USED*	Digital
±73	NOT USED*	Digital
±74	NOT USED*	Digital
	*see LED configuration	

If multiple outputs have been configured to run the same resource, these outputs will be activated in parallel.

5.4 Configuration of analogue outputs

Analogue Outputs

See the section on Electric Connections for the number and type of analogue outputs used and for information on the symbols used on labels supplied with the controller.

Table A2 – Analogue Outputs and Models

Output	Label a Display	Voltage dangerous voltage		SELV			Model bases			Model expansions			
		636 models	Model 646	PWM O.C	0..10V	0...20mA 4...20mA	636	646	655	632	636	646	655
TC1	TCL1	3A 230V	2A 230V				•	•					
TC2	TCL2	3A 230V					•						
AO1	AOL1			•			•	•	•				
AO2	AOL2			•				•	•				
AO3	AOL3						•	•	•				
AO4	AOL4						•	•	•				
AO5	AOL5					•	•	•	•				
TC1	TCE1	3A 230V	2A 230V								•	•	
TC2	TCE2	3A 230V									•		
AO1	AOE1			•	•					•	•	•	•
AO2	AOE2			•	•					•		•	•
AO3	AOE3				•						•	•	•
AO4	AOE4				•						•	•	•
AO5	AOE5					•					•	•	•



TRIAC analogue outputs (TC1, TC2)

TRIACs are high voltage outputs generally used to pilot fans or water pumps.
The output can be configured for proportional operation (constant speed variation) or as ON/OFF.

Remote control switches downstream from the TRIAC are NOT permitted

The output can be configured as described in the table entitled "Analogue Output TC1 - AO1 AO2: configuration table"

Configuration of low voltage (SELV) analogue outputs

- AO1 always available. If configured as digital, see parameter CL96/CE96
 - AO2 always available. If configured as digital, see parameter CL97/CE97
- They can be configured as:
- PWM (via CFS modules) or
 - Open Collector (ON/OFF).
- AO3 – AO4 - low voltage (SELV) output to drive external modules to control fans / pumps / compressors.
Can be used to pilot 0-10V fans (via parameters CL61/CL62 – CE61/CE62)
 - AO5 - safety low voltage (SELV) output to drive external modules to control fans / pumps / compressors.
Can be used to drive 4-20mA loads or 0-20mA loads (via parameter CL60/CE60 / CL63/CE63)

To configure, see the table below. All analogue outputs can be configured as digital or proportional.

Table B – Analogue Outputs – Configuration parameters

Analogue output
TC1 - AO1 AO2:
configuration
table

Output	Parameter	Description	values	Notes
TC1 Only for models 63x 64x	CL73 CE73	Phase shift TCL analogue output 1 Phase shift TCE analogue output 1	0...90	Phase shift values to pilot TRIAC with cut-off in the event of inductive loads.
	CL76 CE76	TCL analogue output pulse length 1 TCE analogue output pulse length 1	5...40 units (347...2776 µs)	pulse length to drive Triac (1 unit = 69.4 µs).
	CL79 CE79	TCL1 analogue output configuration TCE1 analogue output configuration	-53...+53 if digital (see polarity) 56...66 if proportional	See Table B Outputs: configuration table, paragraph on Configuration of Digital Outputs
TCE1	CE70	Enable TCE analogue output 1	0= 65x models	See CE95
			1= 64x models	see CE73 – CE76 – CE79
AO1	CL71 CE71	Enable AOL analogue output 1 Enable AOE analogue output 1	0= Output configured as digital 1= Output configured as TRIAC	If =0 see parameter CL96/CE96 (for pulse pilot) If =1 see parameters CL74 – CL77 – CL80 CE74 – CE77 – CE80
	CL74 CE74	Phase shift AOL analogue output 1 Phase shift AOE analogue output 1	0...90	Active if CL71=1 / CE71=1
	CL77 CE77	AOL analogue output pulse length 1 AOE analogue output pulse length 1	5...40 units (347...2776 µs)	Active if CL71=1 / CE71=1 (1 unit = 69.4 µs).
	CL80 CE80	AOL analogue output configuration 1 AOE analogue output configuration 1	-53...+53 if digital (see polarity) 56...66 if proportional	See Table B Outputs: configuration table

Output	Parameter	Description	values	Notes
AO2 *	CL72 CE72	Enable AOL analogue output 2 Enable AOE analogue output 2	0= Output configured as digital	If =0 see parameter CL97/CE97
			1= Output configured as TRIAC	(for pulse pilot) If =1 see parameters CL75 – CL78 – CL81 CE75 – CE78 – CE81
	CL75 CE75	Phase shift AOL analogue output 2 Phase shift AOE analogue output 2	0...90	Active if CL72=1 /CE72=1
	CL78 CE78	AOL analogue output pulse length 2 AOE analogue output pulse length 2	5...40 units (347...2776 µs)	Active if CL72=1 /CE72=1 (1 unit = 69.4 µs).
	CL81 CE81	AOL analogue output configuration 2 AOE analogue output configuration 2	-53...+53 if digital (see polarity) 56...66 if proportional	See Table B Outputs: configuration table

* in 636 models, AO2 can be used as TRIAC (TC2)

**Low voltage (SELV)
analogue output
AO3-4-5:
configuration
table**

Parameter	Description	values	Notes
CL60 CE60	AOL analogue output type 5 AOE analogue output type 5	0 = 4-20mA Current analogue output 1 = 0-20mA Current analogue output	See Analogue Output Configuration table
CL61 CE61	AOL analogue output configuration 3 AOE analogue output configuration 3	-53...+53 if digital (see polarity) 56...66 if proportional	Modulated piloting or on/off via 10V external relay
CL62 CE62	AOL analogue output configuration 4 AOE analogue output configuration 4	-53...+53 if digital (see polarity) 56...66 if proportional	Modulated piloting or on/off via 10V external relay
CL63 CE63	AOL analogue output configuration 5 AOE analogue output configuration 5	-53...+53 if digital (see polarity) 56...66 if proportional	Modulated piloting or on/off

The following can be piloted:

- Loads with output modulation (values from 56 to 66) or
- loads with on/off type switching using
 - o the Triac as a switch (TC1 AO1 AO2)
 - o The output as 0-10V switch (AO3-4)
 - o the output as a 0/4...20mA switch (AO5)

6 USER INTERFACE (FOLDER PAR/UI)

The interface, comprising the front cover of the controller, allows you to perform all operations needed to use the device.

SBA600



SDA600



SKP 10 terminal



N.B.:

- The SCA600 module has no display. To work on the device use terminal SKP 10 or SKW22(L)/SKP22(L).
- The SE600 expansion module has no display.

6.1 Keys

Refer to models SBA600 SDA600 and SKP 10.

There are 4 keys on the front cover of the controller. Each key has (see the two tables below):

- o A direct action (shown on the key itself).
- o An associated function (indicated on the front cover of the controller, near the key). In the manual, this is shown in square brackets (e.g. [Mode Change]).
- o A combined action using 2 keys. In the manual, this is shown in square brackets (e.g. [UP+DOWN]).

6.1.1 Description of keys and associated functions

Key	Description Key	Short press (press and release)	Key [associated function]	Long press [press and hold for about 3 seconds]	Menu / Notes
	UP	• Increase a value. • Go to next label • Modify Set Point (if UI25=1)		[Activate Sanitary Water function]	Sanitary Water / Manual defrost depending on model
	DOWN	• Decrease a value. • Go to previous label • Modify Set Point (if UI25=1)		[Standby]	Standby / Local ON/OFF according to model
	Esc(ape) Exit (without saving new settings)	• Exit without saving new settings • Go back to previous level.	mode	[Mode Change] --- See paragraph on How to change the operating mode	Operating Mode Menu
	Set Confirm (saving new settings)	• Confirm value / exit and save new settings • Move to next level (open folder, subfolder, parameter, value) • Open State Menu.	disp	[Main display] --- See Main Display section	[Main display menu]
	UP+ DOWN	Activate Time Bands			

By parameter (see parameters chapter, parameters UI20-21-22-23-24) the function [associated] can be enabled or disabled:

- 0 = Key not enabled for the function
- 1 = Key enabled for the function

The following indications refer to the SBA600 user interface. Navigation is identical for SDA600 and SKP10

6.1.2 Stand-by

Controller 'On' --> 'Standby'




Press and hold the [DOWN] key for about 3 seconds

The Standby icon will appear on the display
All other LEDs will be off



Controller 'Standby --> 'On'

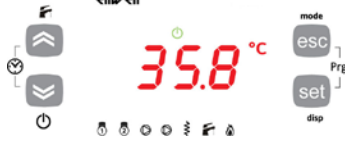

The Standby icon will appear on the display
Press and hold the [DOWN] key for about 3 seconds.

Energy SBA600 will return to the "normal" screen



6.1.3 Description of keys – combined action

Symbol [function associated with combined pressing of the keys]	Key Combination	Combined pressing of keys Press once (press and release)	[associated function]	[Menu] / Notes
		[UP + DOWN]	[Activate/Deactivate]	See section on Time Bands Time Bands / Reset depending on model
				
		[Esc + Set]	[Open programming menu]	[Programming menu]
				

6.1.3.1 Manual alarm acknowledgement and reset

Alarm signals are displayed as flashing. Below is an explanation of how to acknowledge an alarm. The various error messages will be shown in folder AL (see States Menu).



The error message will be displayed, and will alternate with the error signal (example XVD1 driver resource alarm).... and the main display.

The ALARM LED will be permanently on.

ACKNOWLEDGEMENT

Press any key once to acknowledge an alarm.

When any key is pressed, the alarm LED will start to flash.

MANUAL RESET

See Functions section Manual Reset paragraph.

6.2 LEDs and Display

The display has 18 icons (LEDs) split into 3 categories:

- Statuses and operating modes
- Values and Units of Measure
- Utilities

Display

Values of up to 4 digits or 3 digits plus sign can be displayed.

LED: decimal point

Values are always shown in tenths of a degree/bar.

6.2.1 LED: States and Operating Modes

LED states and Operating Modes	Icon	Description	Colour	Permanently on	Blinking
The display shows the value/resource set for the "main display". In the event of an alarm, it will alternate with the alarm code Exx. (When more than one alarm occurs at the same time, the one with the lowest number will be shown first - See Alarms and Diagnostics chapter)		Alarm	red	Active alarm	Alarm acknowledged
		Heating*		Heating mode	Antifreeze with heat pump active
		Cooling*		Cooling mode	Remote heating mode (from digital input)
		Standby*		Local standby mode (from keyboard)	Remote cooling mode (from digital input)
		Defrost	green	Defrost active	Remote standby mode (from digital input)
		Economy		Configurable See Parameters section Ui /dS folder Parameters UI07 /dS00	Manual defrost active Configurable See Parameters section Ui /dS folder Parameters UI07 /dS00

* In AS (sanitary water) mode the Mode LED is off

6.2.2 LEDs: values and units of measurement

LED	Unit of measure	Icon	Description	Colour	Permanently on	Blinking
			Clock (RTC) --- Time Bands	red	Shows current time (24hr format). --- Time Bands enabled	Set time --- Programming: Time Bands
		°C	Degrees centigrade		/	/
		Bar	Pressure (Bar)		/	/
		%R.H.	Relative humidity (% RH)		Not used	Not used
		ABC	Menu (ABC)		Menu navigation	/

6.2.3 LED: utilities

LED utilities	Description	Colour	Permanently on	Blinking
			Configurable (°)	Configurable (°°)
	utility	amber	See Parameters section --- Ui folder Parameters UI00..UI06	See Parameters section --- Ui folder Parameters UI00..UI06

(°) permanently on: Utility active

(°°) blinking: UI00..UI06= 50...53 (power steps 1...4) indicates safety timing

N.B.: In the case of LED configured as sanitary water valve, the LED blinks when AS mode is enabled but not active.


Permanently on when serving a sanitary water request

Default Configuration

LEDs for services are all configurable (see parameters chapter, folder Ui). The factory settings of the controller are listed in the table:

LED symbol on display	LED SBA600	default SBA600	Default icon on front panel SBA600
	LED 1 (first LED from left)	Power step 1	
	LED 2	Power step 2	
	LED 3	Internal circuit water pump	
	LED 4	External circuit water pump	
	LED 5	Internal exchanger electric heater 1	
	LED 6	Valve or DHW pump	
	LED 7	Water heater	

6.3 First switch-on

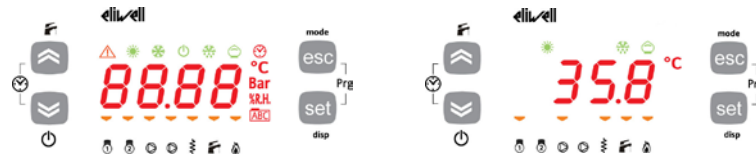

When Energy SBA600 is powered on for the first time, a lamp test is carried out to check its state and operation.

The Lamp Test lasts for just a few seconds. For this short time, all LEDs and digits will flash at the same time.

After the lamp test, the following are displayed (depending on the default settings):

- Time
- Real setpoint
- Parameter setpoint
- Value of the analogue input selected (AIL1...AIL5)

In the example, the main display is the real set point

6.4 Access to folders - Menu structure

Folders are organized into menus.

Access to said folders is defined by the keys on the front cover (see relative paragraphs).

In the paragraphs that follow (or chapters indicated), we will explain how to enter each individual menu.

There are 4 menus:

- Main Display Menu → see the 'Main Display Menu' chapter.
- Operating Mode Menu → see the "Operating Mode Menu" chapter.
- States Menu → see the "States Menu" chapter.
- Programming Menu → see the "Programming Menu" chapter.

There are 4 folders / sub-menus in the Programming Menu:

- Parameters Menu (folder Par) → see Parameters chapter.
- Functions Menu (folder Fnc) → see Functions chapter.
- Password PASS
- EU alarm codes

6.4.1 Main display Menu

"Main Display" means what the controller on the default display screen, i.e. when no keys have been pressed.

Main Display	Ai	AIL1	AIL2	AIL3	AIL4	AIL5			
		AI E1	AI E2	AI E3	AI E4	AI E5			
	Air1	Air2							
	E1(\$)	1rE1	1rE2	-	-	1rE5	1rE6	1rE7	1SP4
		2rE1	2rE2	-	-	2rE5	2rE6	2rE7	2SP4
	rtC	HH:MM							

In Energy SBA600, the main display can be customized to suit personal requirements. The various displays can be selected from the "disp" menu, which can be opened by pressing and holding the [set] key for more than three seconds. The main display can be selected from:


- Analogue inputs AiL1, AiL2, AiL3, AiL4, AiL5, AiE1, AiE2, AiE3, AiE4, AiE5, Air1, Air2
 - o If configured as digital inputs:
 - 0 or 0.0 = input not active (i.e. input short-circuited to ground)
 - 1 or 0.1 = input active (i.e. input open)
- analogue inputs 1Ai1..1Ai4, 2Ai1..2Ai4 (one of the probes available from XVD1 or XVD2 if the corresponding probe is configured)
- 1rE1..1rE7,1SP4, 2rE1..2rE7,2SP4 (one of the resources available from XVD1 / XVD2)
- rtC,
- Set-point → SetP= set by parameter, Setr= real with possible decalibrations

NOTES

E1(\$) see parameters UI10/UI11 values 20...35

If CP01 - Number of circuits = 1 the resources relating to XVD 2 will not be displayed (system with a single circuit)


A step by step account of how to proceed is provided below.

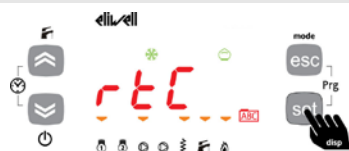

To open the [disp] menu to modify the main display setup, press and hold the set key for at least 3 seconds.



To modify the display, scroll the menu using the “up” and “down” keys and press the set key to confirm.

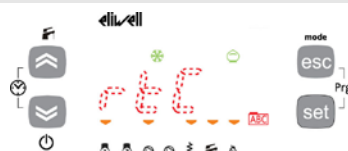

This will open the flashing menu on the previous display (in this case rtc, i.e. current time).




When you have decided the type of display, press the set key to confirm. You will be automatically returned to the main display set.

6.4.2 “Operating Mode” Menu

Instructions are provided below on how to change the operating mode. There are three different operating modes:


- Stand-by (StbY) mode
- HEAT mode
- COOL mode
- Sanitary Water (AS) mode

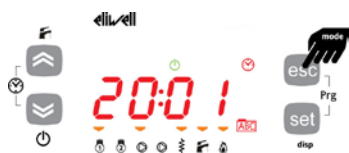


For example, let's say you want to change from StbY to COOL mode.

To change the operating mode, press and hold the mode key for at least 2 seconds.


PS The main display is set as rtc (current time).

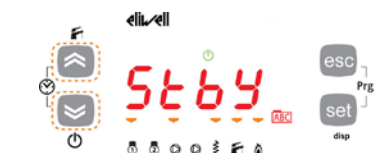

A blinking menu will open containing the values StbY (standby), HEAt (heat), COOL (cool) and AS (Domestic Hot Water).

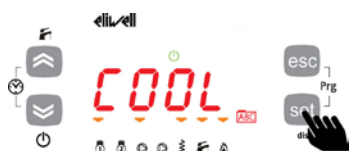

After selecting the preferred operating mode, press the set key.

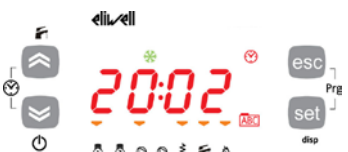

You will automatically return to the main display and will note that the Stby LED has now turned off and the COOL LED has turned on.

6.4.3 'States' Menu

The value of resources can be viewed in the states menu. For some resources, a "dynamic" view is possible:

- For example, when declared as not present / probe not configured (see System Configuration chapter (folder Par/CL), parameter CL01=0), analogue input AiL2 will not be displayed.
- For example the hours of operation of compressor 2 - CP02 – not available on single compressor machines.


Resources can be present / not present depending on the model (e.g. dOL6 is present on SBA655 only).

Label								Visibility	Description	Edit	
Ai	AIL1	AiL2	AIL3	AIL4	AIL5			Dynamic	Analogue inputs LOCAL	//	
Ai	AIE1	AiE2	AIE3	AIE4	AIE5			Dynamic	Analogue inputs EXTENDED(\$)	//	
Ai	Air1	Air2						Dynamic	Analogue inputs TERMINAL	//	
di	diL1	diL2	diL3	diL4	diL5	diL6	//	Dynamic	Digital inputs LOCAL	//	
di	diE1	diLE2	diE3	diE4	diE5	diE6	//	Dynamic	Digital inputs EXTENDED(\$)	//	
AO	tCL1	AOL1	AOL2	AOL3	AOL4	AOL5	//	Dynamic	Analogue outputs LOCAL	//	
AO	tCE1	AOE1	AOE2	AOE3	AOE4	AOE5	//	Dynamic	Analogue outputs EXTENDED(\$)	//	
dO	dOL1	dOL2	dOL3	dOL4	dOL5	dOL6	//	Dynamic	Digital outputs LOCAL	//	
dO	dOE1	dOE2	dOE3	dOE4	dOE5	dOE6	//	Dynamic	Digital outputs EXTENDED*(\$)	//	
CL	HOUr	dAtE	YEAr						Clock	YES	
AL	E000		...	...	...	...	E090	Dynamic	Alarms	//	
AL	E100 E200		...	...	...	...	E115 E215	Dynamic	XVD1 Alarms XVD2 Alarms	//	
SP	Value	//	//	//	//	//	//		Setpoint (set)	YES	
Sr	Value	//	//	//	//	//	//		Real setpoint	//	
Hr	CP01	CP02	CP03	CP04	PU01	PU02	PU03	Dynamic	Tens of hours of operation compressors/pumps	YES	
rEL	Mask	Rev								Firmware screen Firmware version	//

(\$) only if SE600 expansion module present

As shown in the table, the setpoint SP and time can be modified as well as displayed.

6.4.3.1 Inputs/Outputs Display (AiL, diL, tCL1/AOL, dOL)

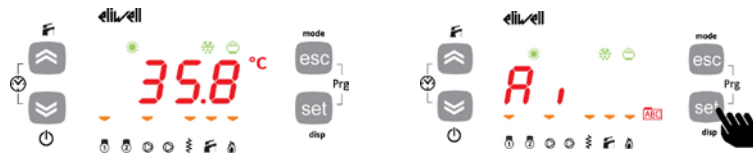

Example of analogue input display The procedure is the same for other I/Os***

Press the set key from the main display.

Label Ai appears on the display.
(Use the UP and DOWN keys to scroll the other labels until you find the one you need.)



Press the set key to view the label for the first analogue input (AiL1 in this case).

Press the set key again to view the value of AiL1. Note that the °C icon lights up to indicate that the value shown is in degrees centigrade

***For digital inputs / analogue inputs configured as digital, the value will be:

- 0 = input not active (for digital inputs this equals an open input, for analogue inputs configured as digital, this equals an input short-circuited to ground).

- 1 = input active (for digital inputs this equals an input short-circuited to ground, for analogue inputs configured as digital, this equals an open input).

Press the esc key to go back to the main display.


6.4.3.2 Setting the clock (CL)

The Energy SBA600 has a clock (RTC) to run the alarm log and time bands, just like a programmable timer thermostat. We will now show you how to set the time: you will also use the same procedure to set the date and year.



To change the time on your machine, starting from the main display, press the set key.

Press the key once to view the various folders. Scroll the menu using the "UP" and "DOWN" keys until you locate the CL folder.

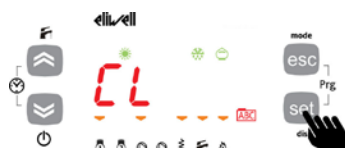


Press the set key to open the CL menu.



On entering you will see HOUR.
Use the "UP" and "DOWN" keys to select the time, date or year.

Once you have decided what you want to set, press the [set]** key to open the modification menu for the variable selected.
Press and hold for about 3 seconds.

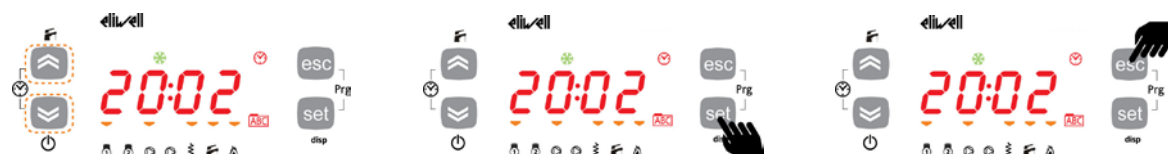

To set the time, date and year, use the "UP" and "DOWN" keys to enter the required value, then

...press the set key

To exit the set time menu, press the esc key until you are returned to the main display.

6.4.3.3 Alarm display (AL)



Press the set key from the main display.



Press the “set” key to view the label of the first active alarm (if it exists).



Label Ai appears on the display. Use the UP and DOWN keys to browse the other labels until you find the AL label.



In this case, the first alarm is E001. Scroll using the “UP” and “DOWN” keys to find other active alarms.

N.B.: the menu is not cyclical. For example, if the active alarms are E001, E002 and E003 the display will show:
E001 ->E002->E003 <-E002<-E001


Press the esc key to go back to the main display.

XVD1 Alarms



The XVD alarms are managed locally by each driver and are signalled and recorded by the master SBA controller in the same folder as the E0xx alarms. The alarm codes are divided up as follows:

XVD2 Alarms

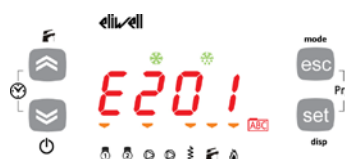

E1xx for driver XVD1

E2xx for driver XVD2


6.4.3.4 Example of how to set the setpoint (SP)

For example, we will modify the setpoint in COOL mode from 12.0 degrees centigrade to 12.6 degrees centigrade.





To change the setpoint on your machine, starting from the main display, press the set key.

Press the key once to view the various folders. Scroll the menu using the "UP" and "DOWN" keys until you locate the SP folder.

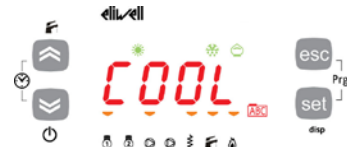


Press the set key to open the SP menu.

The first display will be COOL mode, and then scrolling with the UP and DOWN keys, the HEAT and ACS modes (the various displays are shown at the side).

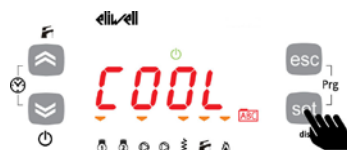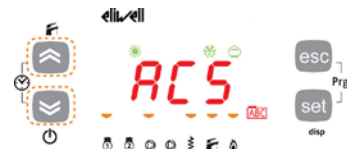

Let's say we want to change the COOL mode setpoint. Select COOL from the menu and press the set key.

The device will show the current setpoint of the machine, which is 12.0 degrees centigrade in this case). To increase or decrease this, press the "up" and "down" keys. For example, if you want to change the setpoint to 12.6 degrees, press the "up arrow" key until you reach the required value.

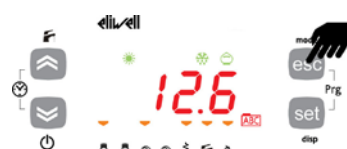

On reaching the required value, press the set key. The device will save the value 12.6

To repeat the procedure in reverse until you get back to the main display, press the esc key or wait for the 15-second timeout to elapse.

Setpoint edit function enable from main screen

Parameter Ui25 allows you to enable Set Point modification on the main display with the UP and DOWN keys. For example, we will modify the setpoint in COOL mode from 12.0 degrees centigrade to 12.6 degrees centigrade.

Parameter **Ui25=1 (folder Par/Ui/Ui25)** must be set.
See Parameters section (folder PAr)



Let's say we want to change the COOL mode setpoint.

The device must be in COOL mode (or in StdBy mode from COOL).

To change the set point of the HEAT mode, proceed in the same way by first changing the device's mode from COOL to HEAT

See Operating Mode Menu chapter.



To change the setpoint on your machine, press the UP or DOWN key in the main display.

The device will show the current setpoint of the machine, which is 12.0 degrees centigrade in this case).



To increase or decrease this, press the "up" and "down" keys again.

For example, if you want to change the setpoint to 12.6 degrees, press the "up arrow" key until you reach the required value.



On reaching the required value, press the set key. The device will save the value 12.6.

6.4.3.5 Display and reset compressor/pump hours



Example display and reset (tens of) hours for Pump 2

Press the set key from the main display.



Press the set key to view the first label - which in this case is the operating time for compressor 1 (CP01).



Label Ai appears on the display. Use the UP and DOWN keys to scroll the other labels until you reach the Hr label.



Scroll with the UP and DOWN keys to view (if the relative resources are present) the running time for compressor 2 (CP02) and the pump running time (PU01, PU02, PU03).

Press the set key to view pump PU02 running hours.



The number of tens of running hours is 2.
(Hours are expressed in tens:
2 means 20 hours of operation).

To reset the hours of functioning of pump PU02, press and hold [set].

N.B.: to clear the running hours of other resources, repeat the same procedure described above.

Press the esc key to go back to the main display.

6.4.4 Programming menu

Menu	Label								Description	notes
Parameters	PAr	CL	Cr	CF	Ui	St	...	Al	parameters	See the "Functions" chapter (folder FnC)
Functions	FnC	dEF	tA	tA	tA	St	CC	Eur	functions	
Password EU	PASS EU	Eu00	...	...	...	...	...	...	password	

6.4.4.6 Parameters (PAr folder)

Modifying a parameter

Instructions are provided below on how to change a machine parameter. In this case, we will take the parameter configuration folder CL01 and parameter CL01 as an example (folder PAr/CL/CL01).



To view the parameter menu, press the Esc and Set keys at the same time. This will open the PAr menu.



The parameters menu PAr contains all controller folders. Press the set key to view folders.



The first folder displayed by the controller will be the CL configuration folder. If you want to modify individual CL parameters, just press the set key again.



The controller will show parameter CL00 (factory default settings).

Use the UP and DOWN keys to scroll through the parameters.

To view the parameter value (CL01 in this case), press the set key.



For parameter CL01, the value shown will be 2. To change the parameter value, press the up and down keys.



On selecting a value, press the set key. To quit press the esc key.

N.B. pressing the set key confirms the modified value; pressing the esc key returns you to the previous level **without saving the new value entered.**

6.4.5 Setting a password (Par/PASS folder)

Levels of visibility

There are four levels of visibility that can be set by assigning appropriate values to each parameter in the folder, only via serial, software (DeviceManager or other communication SW) or programming key.

The levels of visibility are:

- Value 3 = parameter or folder always visible.
 - Value 2 = **manufacturer level**; these parameters can only be viewed by enter the manufacturer's password (see parameter Ui28) (all parameters declared as always visible, parameters visible at the installation engineer level and manufacturer's level will be visible).
 - Value 1 = **installation level**; these parameters can only be viewed by enter the installation password (see parameter Ui27) (all parameters declared as always visible, and parameters visible at the installation engineer level will be visible).
 - Value 0 = parameter or folder NOT visible.
1. Parameters and/or folders with a level of visibility ≤ 3 (password-protected) will be visible only if the correct password is entered (installer or manufacturer) following this procedure.
 2. Parameters and/or folders with a level of visibility = 3 are always visible even without a password: in this case, the following procedure is not necessary.

Access the PASS folder (basic view by pressing the esc and set keys [esc+set] and search the folder using the UP and DOWN keys). Set the PASS value to have access to the parameters visible for that password.



To view the PASS folder in the main display, press the Esc and Set keys at the same time. [esc+set].



Pressing both keys will open the folder menu. Scroll using the "up" and "down" keys to find the PASS folder. Press the set key to open the PASS menu. From here, set the password (installer or manufacturer), press set and exit.

Now open and view parameters to change a value (see parameters section).

6.4.6 Alarm Events (Par/EU folder)



To view the PAR folder in the main display, press the Esc and Set keys at the same time. [esc+set].



Press set to view the last alarm event - if it exists - EU00.
N.B.: EU00 indicates the last alarm event recorded, EU01 the second last, and so on.



Pressing the two keys will open the menu containing the list of folders. Use the "up" and "down" keys to scroll the list until you find the EU folder.



Press the set key again to view details of the selected event (in this case the first label will appear).
(alarm code EU00)

Scroll with the UP and DOWN keys to view (if present) any other alarm events.

Use the UP and DOWN keys to scroll:
Alarm code (as indicated)



Alarm start time



Alarm start date



Alarm stop time (alarm still active in this case)



Alarm stop date (alarm still active in this case)



Alarm type (automatic) or in alternative (manual)

7 OPERATING MODES - TEMPERATURE CONTROL (FOLDER PAR/TR)

Temperature control parameters can be viewed and configured in folder **tr** (see User Interface and Parameters section).

Energy SBA600 controls the main temperature control setpoint by dynamically modifying its value using special algorithms and events to maximise plant efficiency and output.

The action on the setpoint can be:

- Direct: modifies the main setpoints
- Indirect: modifies by using the sum of the values (positive or negative) called the setpoint differentials with the principal setpoints for the Cool and Heat modes

There are several setpoint differentials:

- Dynamic setpoint differential on dedicated input or external temperature
- Economy function setpoint differential
- Adaptive function setpoint differential (see section in question)

In the same way (by means of the same direct and indirect actions) the temperature controller regulator hysteresis can be dynamically controlled. This only affects the compressor power stages; the other steps, such as boiler and heaters, have parameter-set hysteresis.

The main hysteresis differentials for the compressors are:

- Adaptive function hysteresis differential (see section in question)

The results of the direct and indirect actions on the principal setpoints and hysteresis are the **real** setpoint and hysteresis.

In general, we can say that the main temperature control is based on these 4 values:

1. Real Cool setpoint
2. Real Heat setpoint
3. Real Cool hysteresis (compressors only)
4. Real Heat hysteresis (compressors only)

The main temperature controller calculates the thermal power to be delivered, both in Heat and Cool mode. The thermal power is expressed a number of steps (hot or cold) to deliver.

7.1 Temperature controller setpoint and hysteresis

7.1.1 Setpoint and hysteresis from parameter value

We list below the parameters used to set the **main** working setpoints, one for each operating mode:

Parameter		Description
COOL	HEAT	
tr10	tr20	Temperature control setpoint in Cool / Heat
tr11	tr21	Minimum temperature control setpoint in Cool / Heat
tr12	tr22	Maximum temperature control setpoint in Cool / Heat
tr13	tr23	Temperature control hysteresis in Cool / Heat

There are direct modifications to the setpoint and hysteresis (direct action on the principal values, such as modification via COM1) and indirect modifications, which sum the differentials to obtain the **real** setpoint and hysteresis.

7.1.2 Real setpoints and hysteresis

The real setpoints and hysteresis are calculated from the parameters described above and summing the total differentials calculated in a specific way from the components described above.

- **Real setpoint Heat** = Main setpoint Heat + **setpoint differential Heat**
- **Real setpoint Cool** = Main setpoint Cool + **Setpoint differential Cool**

Setpoint differential = Dynamic setpoint differential on dedicated input and/or external temperature
+ Economy function setpoint differential
+/- Adaptive function setpoint differential

- **Real hysteresis Heat** = Main hysteresis Heat + **Hysteresis differential Heat**
- **Real hysteresis Cool** = Main hysteresis Cool + **Hysteresis differential Cool**

Hysteresis differential = Adaptive function Hysteresis Differential

7.1.2.1 Setpoint differential: dynamic differential

See dynamic setpoint section (folder PAr/dS)



7.1.2.2 Setpoint differential: Economy differential

Enabling

The function is enabled only if a digital input has been configured as Economy input (at least one of CL40...CL45, CL50...CL54=22)

When the digital input is enabled, the setpoint is increased by a differential equal to the value of parameter **tr15** or **tr25** depending on the current operating mode (Cool or Heat):

tr15: Setpoint differential in Cool from Economy input (typically positive) if the current operating mode is Cool

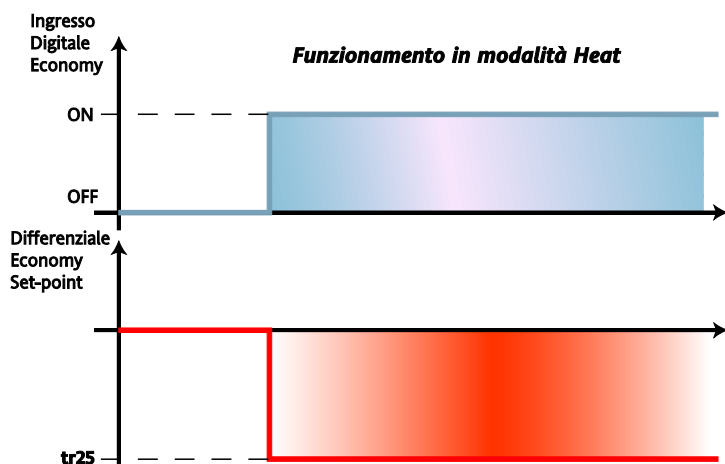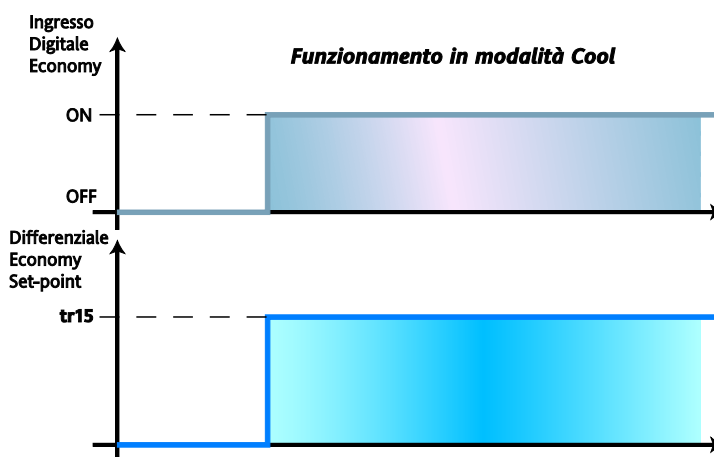

tr25: Setpoint differential in Heat from economy input (typically negative) if the current operating mode is Heat.

The activation of Economy mode is indicated by the Economy LED (if so configured)

7.1.2.3 Setpoint and hysteresis differentials: Adaptive function

See Adaptive section (folder PAr/Ad)

7.2 Temperature controller

The SBA600 has five types of temperature control that can be selected with **tr00** *Temperature control type*:

- **Proportional:** Calculates the power the unit must supply in relation to the distance of the air/water temperature from the setpoint
 - o tr00=0 Proportional temperature control - **see diagrams A and B**
- **Differential:** Calculates the power the unit must supply in relation to difference in temperature between two analogue inputs
 - o tr00=1 Differential temperature control - **see diagrams C and D**
- **Digital (condenser unit)**
 - o tr00=2 Digital temperature control
- **INVERTER proportional:** Calculates the power the unit must supply in relation to the distance of the air/water temperature from the setpoint
 - o tr00=3 INVERTER proportional temperature control - **see diagrams A' and B'**
- **INVERTER differential:** Calculates the power the unit must supply in relation to difference in temperature between two analogue inputs
 - o tr00=4 INVERTER differential temperature control

Temperature control parameters can be viewed and configured in folder **tr** (see User Interface and Parameters section).

7.2.1 Temperature control probes

Table A Regulation probe selection

Temperature control	COOL	HEAT	Description	Probe 1	Probe 2
Proportional	tr02	tr03	Select temperature control probe in Cool/Heat	See Table B	N.O.
Differential	tr04	tr05	Select probes for temperature control differential in Cool/Heat	See Table B	See Table B

Table B Control probes

value	Probe 1	Probe 2
0	Internal exchanger water/air inlet temperature (CL30...CL34=0)	External temperature NTC input (CL30...CL34=8)
1	Internal exchanger water/air outlet temperature (CL30...CL34=1)	
2	Circuit 1 and 2 internal exchanger water outlet average temperature Average ((CL30...CL34=2), (CL30...CL34=3))	
3	External exchanger inlet water temperature (CL30...CL34=6)	
4	External exchanger outlet water temperature (CL30...CL34=7)	
5	Circuit 1 and 2 external exchanger average temperature Average ((CL30...CL34=4), (CL30...CL34=5))	

*if one of the probes is in error or not configured, the average is a probe error

7.2.2 Proportional temperature control

This is a type of control which activates the power steps as a function of the divergence of the actual temperature from the real setpoint.

Homogeneous or power stage compressors

The steps (heat or cool) are discrete and there are a limited number of them (max 4 for SB devices).

The number of steps (resources) requested is linked to the difference between the control temperature and the **real** setpoint; the greater the difference, the larger the number of steps (resources) used to achieve the setpoint.

The temperature interval between application of one power step and the next depends on the proportional band and the number of resources available (see Compressors section).

Temperature control is usually dependent on the inlet/outlet water/air temperature of the internal exchanger. Installations with double internal exchanger can control the temperature as a function of the average of the two temperatures measured at the exchanger outlets.


In some applications (e.g. machines with water reversal in Heat mode) it may be necessary to use the **external** (recovery) **exchanger** inlet/outlet water temperature for temperature control.

Various temperature control probes can be selected for Heat and Cool modes using the parameters given in **Table B Control probes**.

7.2.3 Proportional power step temperature control in Cool / Heat mode

Temperature control is enabled in Heat mode only if *Enable heating pump tr01* = 1

Case **tr00=0**

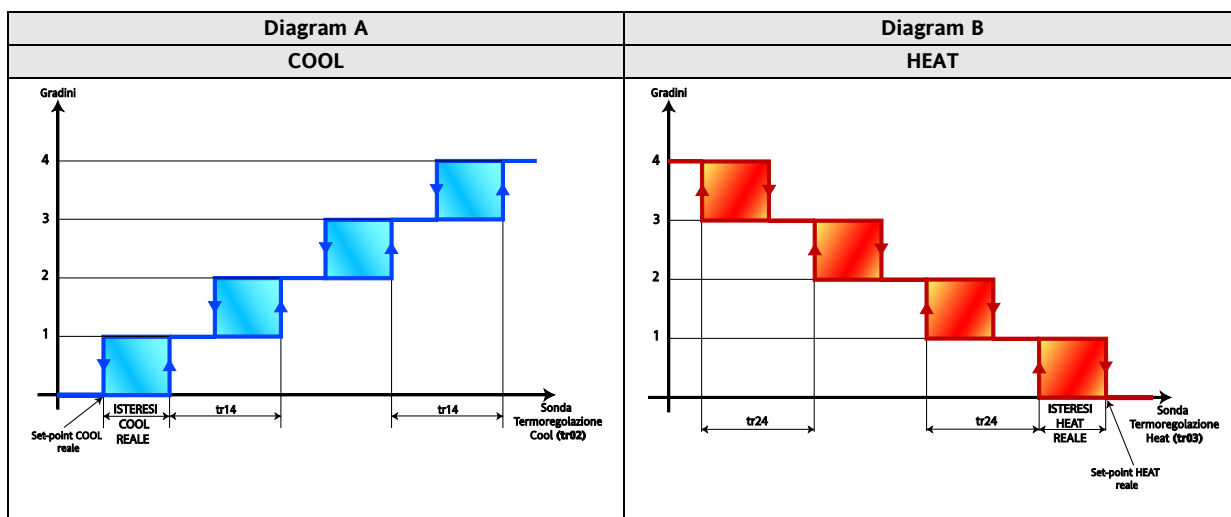


Parameter		Description
COOL	HEAT	Description
tr02	tr03	Select temperature control probe in Cool / Heat
tr14	tr24	Insert steps/compressors differential in Cool / Heat
SetPoint		Real setpoint in Cool / Heat
Hysteresis		Real control hysteresis in Cool / Heat

N.B.: The real hysteresis may not be greater than the differential. In this case the hysteresis is considered equal to the differential.

7.2.4 INVERTER temperature control in Cool / Heat mode

Temperature control is enabled in Heat mode only if *Enable heating pump tr01* = 1

Case tr00=3

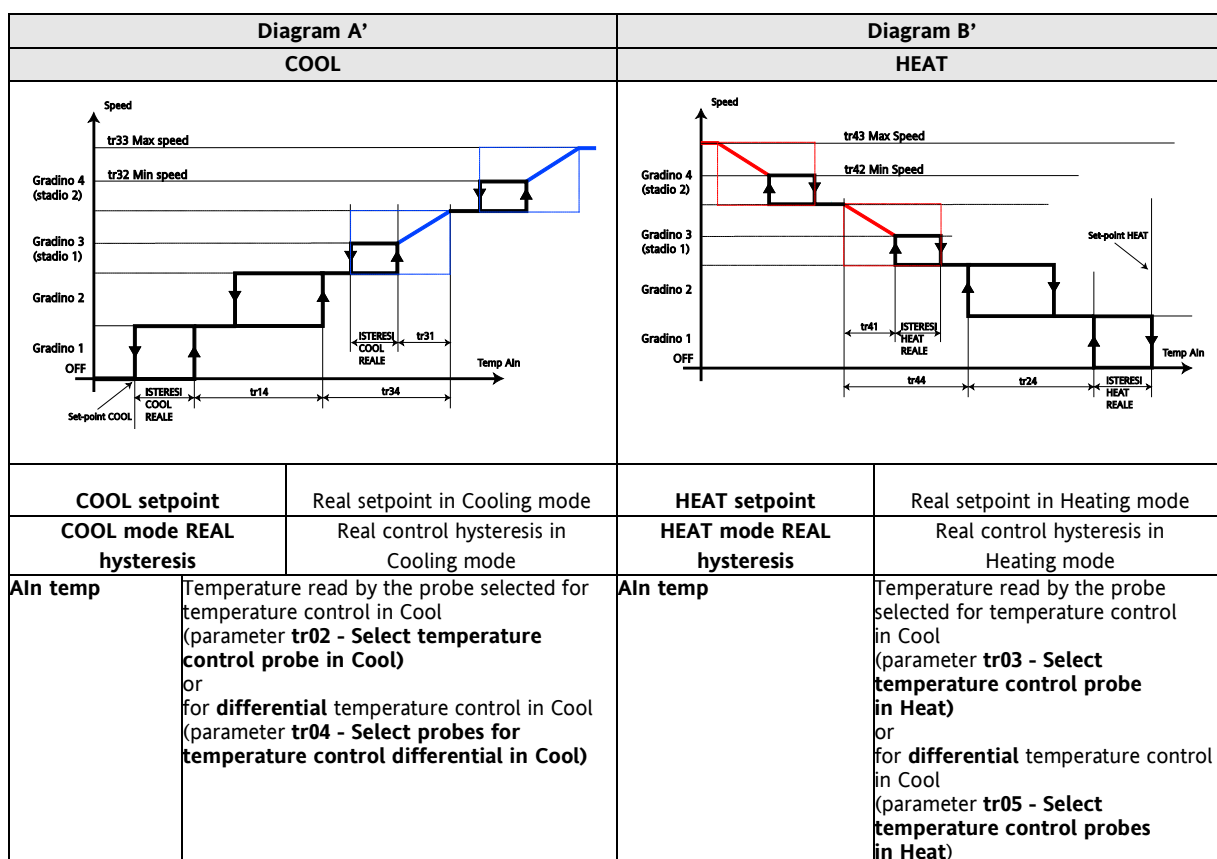

	Parameter		Description
	COOL	HEAT	
	tr14	tr24	Insert steps/compressors differential in Cool / Heat
	tr30	tr40	Temperature controller hysteresis with inverter in Cool / Heat
	tr31	tr41	Temperature controller band with inverter in Cool / Heat
Speed	tr32	tr42	Minimum speed with inverter in Cool / Heat
Speed	tr33	tr43	Maximum speed with inverter in Cool / Heat
	tr34	tr44	Inverter/compressors insertion differential in Cool / Heat

N.B.: The real hysteresis may not be greater than the differential. In this case the hysteresis is considered equal to the differential.

Cool Case

N.B.: the sum tr30+tr31 must be less than tr34


Heat Case

N.B.: the sum tr40+tr41 must be less than tr44

If this is not the case, the hysteresis + band value will be equal to the differential.

7.2.5 Notes on inverter Management

Activation of the compressors is determined by the specified analogue signal, but also by a corresponding digital permissive, taken from the standard available digital outputs.

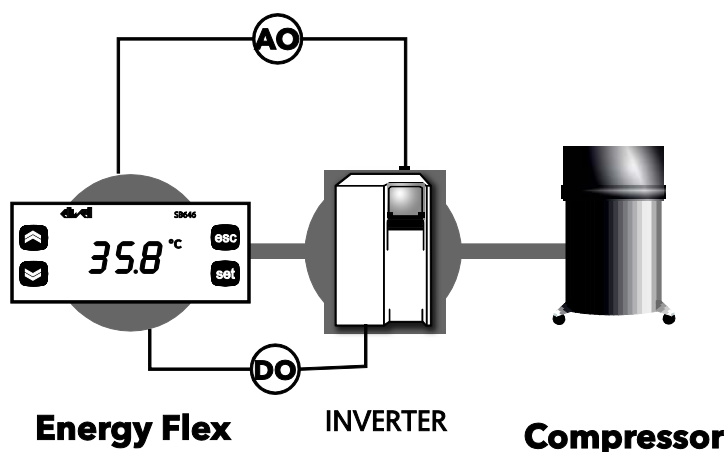

Digital and analogue signals both affect the inverter, and activation of the compressor is determined by said signals, but also by the regulatory mechanisms and parametrisations of the inverter interposed between the controller and the compressor.

For example, the inverter typically influences the activation and deactivation modes of the compressors.

Consequently, on the basis of the type of inverter and the type of compressor, the resulting management can be more or less efficient and more or less appropriate for protecting the specific compressor employed.

To further improve management of the compressors and obtain benefits in terms of overall efficiency, it may be appropriate to “modulate” the digital permissive in specific situations, such as, for example, at the time of stopping (because the setpoint has been reached) and during defrosting.

Single circuit and single-compressor units

In the case of 1 circuit 1 compressor, and only in this case, there is a dedicated digital output available denoted **Compressor Inverter 1**


Stage	Digital output Compressor 1 (CL90..95/CE90...95 = ±1)	Digital and analogue output Compressor Inverter 1 (CL96/97/CE96/97 = ±34)
Starting for temperature control requirements	Starts in accordance with the standard temperature controller	No change, it is typically the inverter that (in accordance with its settings) determines gradual starting of the compressor
Stopping due to fulfilment of temperature control demand	Stops in accordance with the standard temperature controller	Digital output: remains on (for time St06 - Reversal valve switching from Defrost to Heat delay , then switches off the same as the standard output) to allow inverter to reduce its speed before switching it off Analogue output: assumes value 0 (below minimum inverter threshold)
Alarms		
Dedicated alarms (*)	Output off	No change, in the case of dedicated alarms it is good practice to switch off the compressor
OFF / Stdby		
Instrument OFF (*)	Output off	No change, compressor off (digital and analogue outputs = 0)
Instrument STD BY	Output off in compliance with delay intervals	Digital output: remains on (for additional time St06 - Reversal valve switching from Defrost to Heat delay , then switches off the same as the standard output) Analogue output: assumes value of tr32 - Minimum speed with inverter in Cool or tr42 Minimum speed with inverter in Heat to allow the inverter to bring the compressor to the minimum speed before switching it off

(*) assumes priority over any active alarms

Stage	Digital output Compressor 1 (CL90..95/CE90...95 = ±1)	Digital output Compressor Inverter 1 (CL96/97/CE96/97 = ±34)
Defrost		
Defrost start	Behaviour dependent on parameters St06/St07	Diagram A → <u>Digital output</u>: remains on. → <u>Analogue output</u>: normally regulates up to the start of defrosting when it assumes a value equal to tr42 Minimum speed with inverter in Heat to allow the inverter to bring the compressor to minimum speed After time St06 - Delay time for switching of cycle inversion valve from Heating to Defrosting the inversion valve is reversed and, after an additional time St07 - Reversal valve switching from Heat to Defrost delay the analogue output is brought to the maximum value tr43 - Maximum speed with inverter in Heat
Defrost end	Behaviour dependent on parameters St06/St07	Diagram B dF23 - Drip time ≠ 0 and greater than St06 (dF23 and St06 are counted in parallel). → the <u>digital output</u> is switched off after time St06 → the <u>analogue output</u> is set to 0 to allow the inverter to bring the compressor to minimum speed The compressors shut down as the digital output is turned off after time St06 (<dF23) After time dF23 - Drip time the inversion valve is reversed and, after an additional time St07 - Reversal valve switching from Heat to Defrost delay the analogue output is brought to the value requested by the temperature controller → the <u>analogue output</u> is brought to the value requested by the temperature controller after dF23 (>St06) Diagram C dF23 - Drip time = 0 or less than St06 (dF23 and St06 are counted in parallel). → <u>Digital output</u>: remains on. → the <u>analogue output</u> assumes a value of tr42 - Minimum speed with inverter in Heat and is then brought to the value required by the temperature controller after St06) + St07
Mode Change		
Mode Change	Behaviour dependent on parameter St05	St05 - Reversal valve switching delay = 0, no change, the mode changeover in progress is performed while keeping the compressor running. St05 - Reversal valve switching delay ≠ 0, the output remains on for an additional time St06 - Reversal valve switching from Defrost to Heat delay Set St05>St06 to be certain that the compressor is stopped when the valve is reversed In the mode change from heating/cooling the analogue output assumes the value tr32 – Minimum speed with Inverter in Cool In the mode change from cooling/heating the analogue output assumes the value tr42 - Minimum speed with Inverter in Heat It is set to 0 when the digital output is turned off.

Note

Pay attention to the use of parameter **St06 - Reversal valve switching from Defrost to Heat delay** as a sort of post-off of the **Compressor 1 Inverter** output (in certain situations), whose value must be selected in accordance with the application (inverter and its parametrisation).

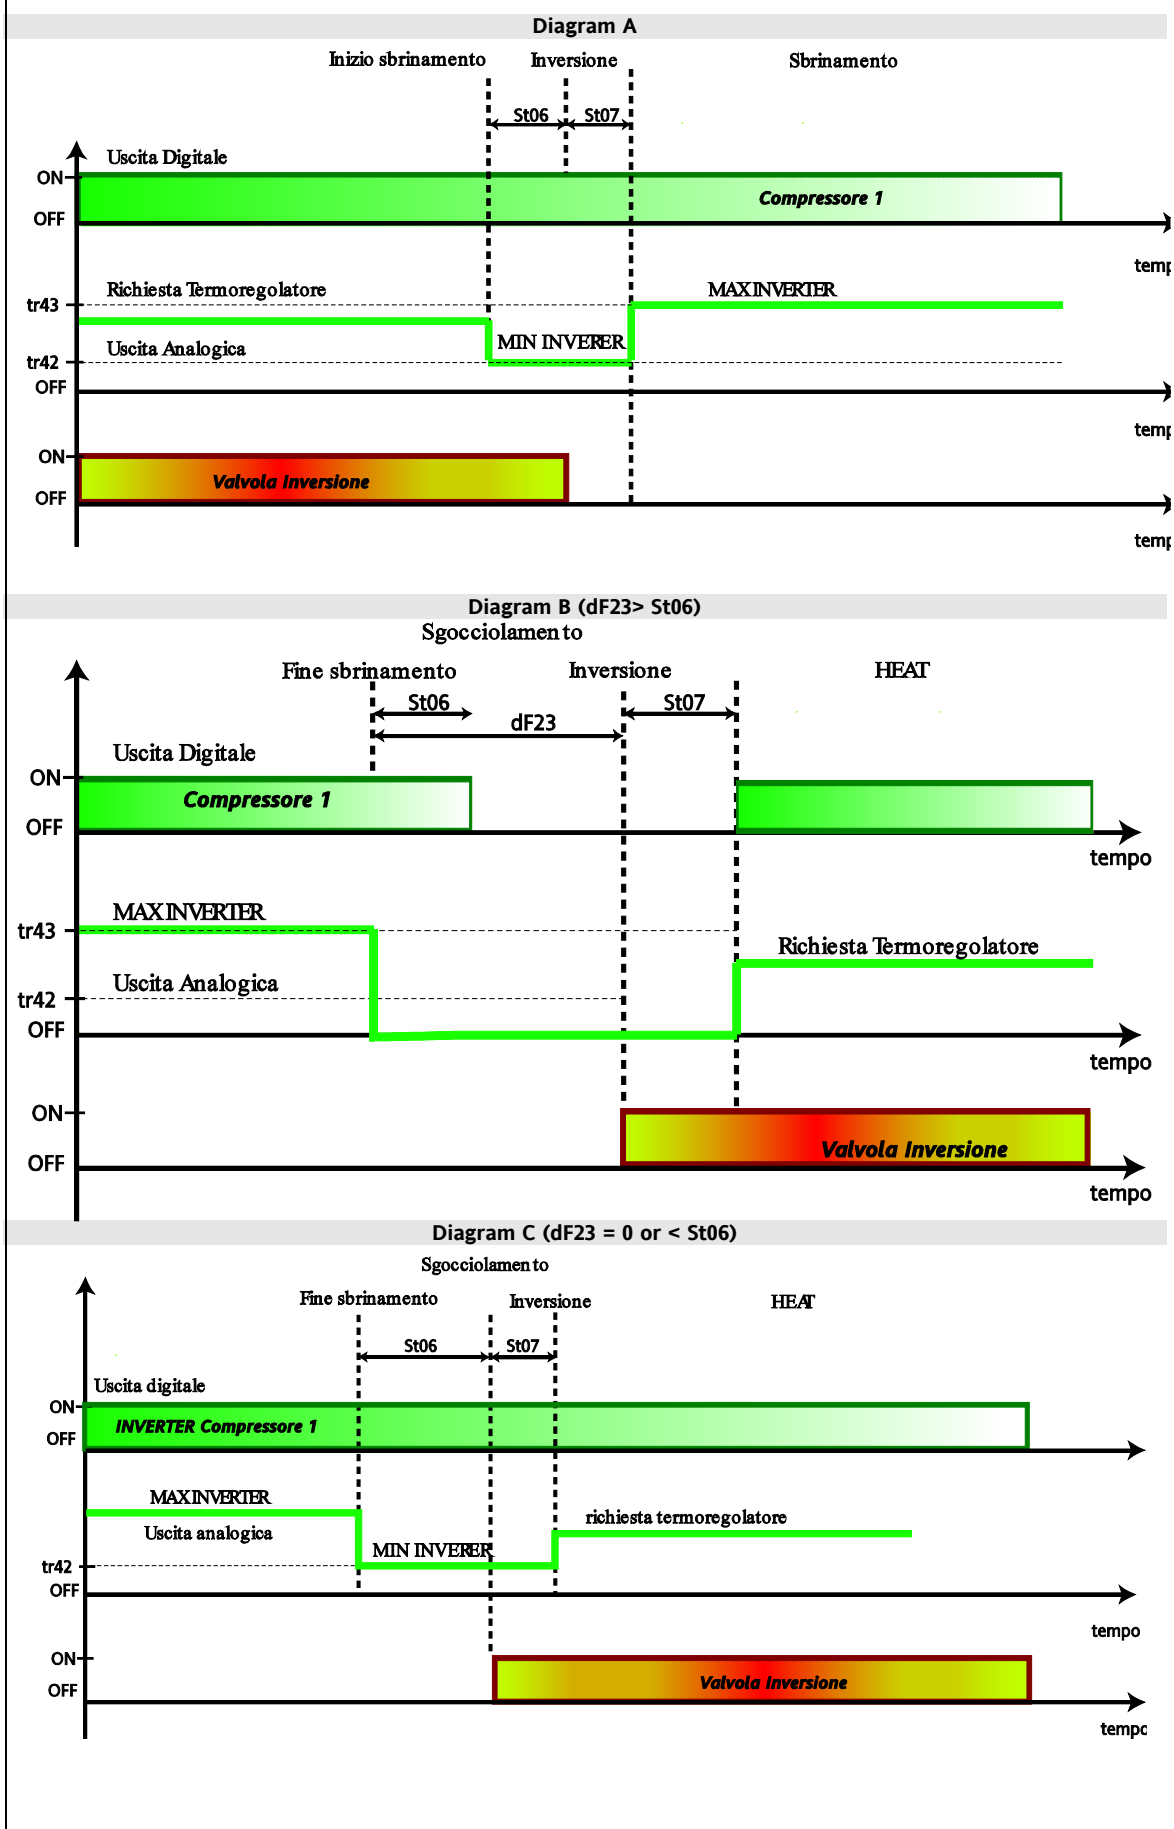

7.2.6 Activation of the XVD electronic expansion valve driver

If at least one capacity step is required by the compressor(s) on one of the two circuits, an ON command will be transmitted to the driver for the XVD electronic expansion valve relative to the circuit in question. If, on the other hand, the circuit does not require cooling or heating capacity (all compressors off) for any reason (e.g. alarm associated with the compressor), an OFF command will be transmitted to the relative XVD.

7.3 ENVELOPE control

Envelope control requirements

In the case of **1 circuit 1 compressor**, and only in this case, temperature control is available on a dedicated digital output also with ENVELOPE control.

Enabling

The envelope control functions are enabled by means of parameters:

Parameter	Description
ri00	Enable discharge temperature limitation control 0= disabled; 1= enabled
ri01	Select compression ratio control mode 0= Compression ratio control disabled 1=Compression ratio control enabled, minimum and maximum values 2=Compression ratio control enabled, minimum value 3=Compression ratio control enabled, maximum value
ri12	Compressor running time in safety If different from zero, it enables oil recovery function

7.3.1 Discharge temperature limitation


Limitation of the discharge temperature with reduction of compressor rpm

Enabling

ri00 - Enable discharge temperature limitation control = 1

This logic cuts in to limit the value of discharge temperature to the threshold value defined by the parameters

	Parameter	Description
Reference value Discharge temperature	ri20	Discharge temperature limit zone 1b
	ri21	Discharge temperature limit zone 1a - 2
	ri22	Discharge temperature limit zone 1c - 3
	ri16	Compressor speed correction
	ri34	Discharge temperature correction period
	ri63	Evaporation pressure zone 1a/1b
Hysteresis	ri64	Evaporation pressure differential 2
	ri65	Evaporation pressure zone 1b/1c

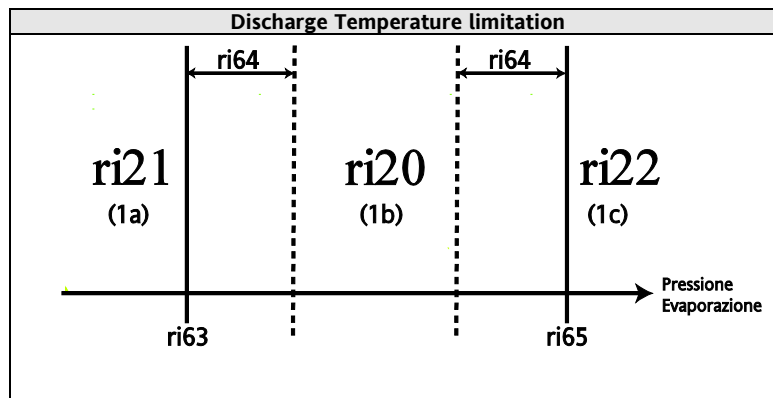

The discharge temperature is compared to the reference value, which will be ri20, ri21 or ri22, on the basis of the evaporation pressure value.

If the real discharge temperature exceeds the reference value, the compressor Inverter speed and ri16 are reduced and the resulting value is “frozen” for time ri34.

Subsequently the control is performed with a frequency defined by the same parameter ri34, with possible further reductions of ri16 at each instance.

If the discharge temperature returns below the set threshold value, the speed determined by the control at that time is restored (offset zero setting).

Determination of the reference value:


Parameter	Description
ri63	Evaporation pressure zone 1a/1b
ri64	Evaporation pressure differential 2
ri65	Evaporation pressure zone 1b/1c

- when the evaporation pressure falls below the value defined by parameter ri63 -> maximum discharge temperature value ri21;
- pressure that rises above value ri63+ri64 -> ri20;
- pressure that rises above value ri65 -> ri22;
- pressure that falls below value ri65-ri64 -> maximum discharge temperature ri20.

7.3.2 Compression ratio control

The control function of the compression ratio is enabled by the parameter **ri01 - Compression ratio control mode selection**

Parameter	Description
ri14	Initial transient for compression ratio control
ri30	Minimum compression ratio
ri31	Maximum compression ratio
ri32	Minimum compression ratio range
ri33	Maximum compression ratio range
ri55	Overheating setpoint correction period/scan time

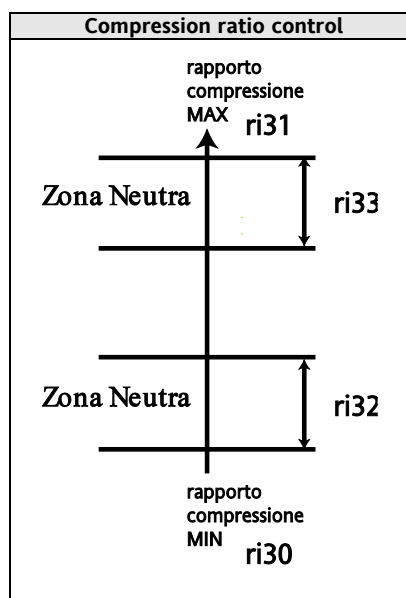

The compression ratio given by $((\text{High pressure value} + 1 \text{ bar}) / (\text{Low pressure value} + 1 \text{ bar}))$ is compared with parameter ri30 minimum compression ratio and ri31 maximum compression ratio in order to maintain it between these two values.

The logic utilised is as follows:

- after the initial transient defined by ri14, from starting of the compressor;
- with scan time ri55 (for "synchronism" with the other controls of the command signal that use the same period as the scanning time) the compression ratio is calculated;
- if the result is less than ri30 a correction is introduced to increase the compressor control signal by the value defined by parameter ri16 and the resulting value is "frozen" for time ri55;
- if compression ratio is more than ri31 a correction is introduced to reduce the compressor control signal by the value defined by parameter ri16 and the resulting value is "frozen" for time ri55;
- if the compression ratio is between ri30 and ri30+ri32 or between ri31-ri33 and ri31 no action is taken ("neutral zones") and the resulting value is "frozen" for time ri55;
- if the compression ratio is between ri30+ri32 and ri31-ri33, the speed is restored as determined by the temperature control (offset zero setting) at that time.

7.3.3 Oil recovery

Parameter	Description
ri10	Compressor safety speed for oil recovery
ri11	Compressor safety speed
ri12	Compressor running time in safety

To guarantee correct recovery of oil in the circuit if the compressor is working at rotation speeds below ri10 for a maximum time ri13, the control signal is forced to ri11 for a period equivalent to ri12.

7.3.4 ENVELOPE control regulation priority

The oil recovery function assumes priority over all the other regulations that act on the compressor Inverter on the condition that the compressor is running.

The other two functions (discharge temperature and compression ratio) have priority over normal regulation and if there are conflicting actions the action that tends to reduce the compressor Inverter speed will prevail. For a capacity increase it is necessary that none of the controls constrain such an increase.

7.3.5 Temperature control differential

Differential temperature control is enabled with parameter **tr00** *Temperature control type*.

I.e. tr00=1 (differential) / tr00=4 (INVERTER differential)

The aim of differential temperature control is to maintain a constant difference between the external temperature and the temperature of the air/water used for heating/cooling.

The temperature difference in question is defined by

$$\text{temperature control value} = \text{Probe 1} - \text{Probe 2}$$


where **Probe 2** is the external temperature.

See **Control Probes Table**

Installations with double internal exchanger can control the temperature as a function of the average of the two temperatures measured at the exchanger outlets. The same applies to the external exchangers.

7.3.5.1 Differential temperature control in Cool / Heat mode

Temperature control is enabled in Heat mode only if **tr01**: *Enable heat pump* = 1.

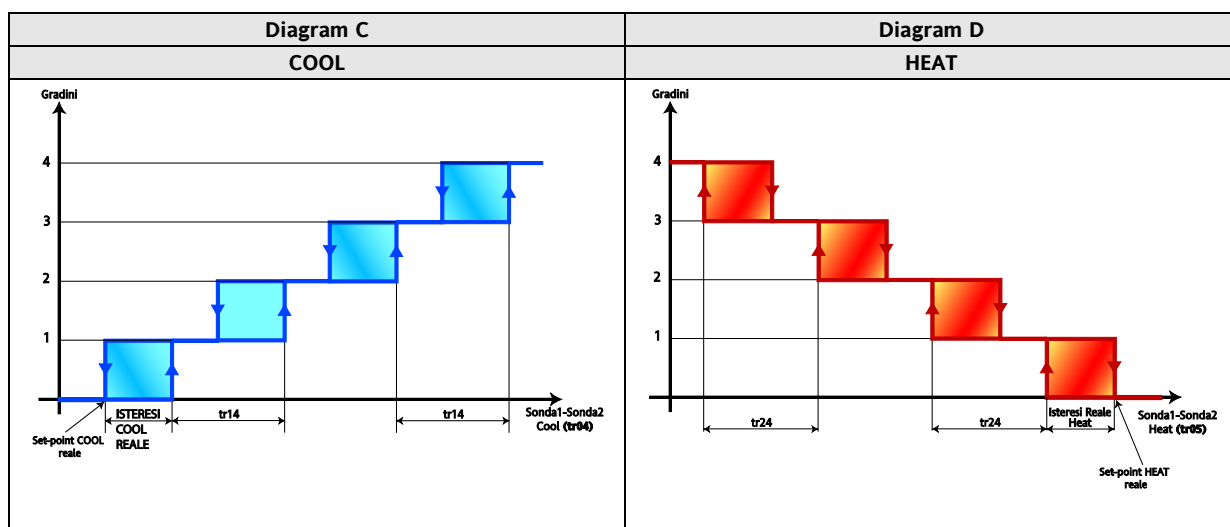

Parameter		Description
COOL	HEAT	Description
tr04	tr05	Select probes for temperature control differential in Cool / Heat
tr14	tr24	Insert steps/compressors differential in Cool / Heat
SetPoint		Real setpoint in Cool / Heat
Hysteresis		Real control hysteresis in Cool / Heat

N.B.: The real hysteresis may not be greater than the differential. In this case the hysteresis is considered equal to the differential.

7.3.6 Digital temperature control

The function is enabled if the parameter **tr00**: *Temperature control type* = 2.

In the case of digital temperature control, the power step request depends on the state of specific digital inputs, typically driven by external thermostats, rather than analogue variables.

The operating mode can also be selected via a digital input.

N.B.: Safety timings, settings (compressor ON delay, pump ON, ..) and alarms are active as usual.

The digital input configuration depends on the type of thermostat used in the application.

We list below the meanings which can be associated with the digital inputs in question.

Type 1 thermostat

Value DIL1 to DIL5 / AIL1 to AIL5	Description
±8	Digital input heat step 1 request
±9	Digital input heat step 2 request
±10	Digital input heat step 3 request
±11	Digital input heat step 4 request
±12	Digital input cool step 1 request
±13	Digital input cool step 2 request
±14	Digital input cool step 3 request
±15	Digital input cool step 4 request

Type 2 thermostat

Value DIL1 to DIL5 / AIL1 to AIL5	Description
±3	Remote Summer/Winter
±4	Power step 1 request
±5	Power step 2 request
±6	Power step 3 request
±7	Power step 4 request

For further details, see the section on System Configuration (folder PAr/CL-Cr-CF) /

section on Configuration of digital inputs (DIL1 to DIL5 and AIL1 to AIL5) /

Table B - Digital inputs: configuration table

Notes:

- If two digital inputs are configured as heat step request and cool step request, activating both at the same time generates a *configuration error*, for further details see the alarms table;
- If a digital input has been configured as heat request and the digital input for summer/winter is in the summer position, this generates a *configuration error*;
- Temperature control depends directly on the activation of digital inputs which therefore must be activated in a logical sequence. For example, power steps must be activated and deactivated in the fixed sequence 1-2-3-4 and 4-3-2-1.

8 OPERATING STATES (FOLDER PAR/ST)

Once it has been configured, the Energy SBA600 is ready to control the utilities as a function of the temperature and pressure measured by the probes and the temperature control functions defined via its parameters. Operating mode parameters can be viewed and configured in folder **St** (see User Interface and Parameters sections). When Energy SBA600 is not in OFF or StdBy status, it is either in heating or cooling mode

Operating states

There are 3 possible operating states that can be set by parameter **St00- Select operating mode:**

- St00=0 Cool only **COOL**
- St00=1 Heat only **HEAT**
- St00=2 Heat and cool **HEAT + COOL**

Working modes

The working modes can be selected:

- from the keyboard - if keys are enabled in parameters:
 - o **UI 21 - Enable MODE function from key** Enables/disables mode selection from a key
 - o **UI 23 - Enable ON/OFF function from key** Enables/disables ON/OFF key for switching the device on or off
- from appropriately configured digital inputs:
 - o i.e. Remote ON/OFF
 - o Remote STD-BY

N.B.: Remote mode changeover: to obtain the correct sequence STD-BY – DHW, enable 2 D.I. and configure one as STB and the other as DHW (±28)

If you enable only 1 D.I. in STD-BY and the machine is in DHW mode, it may occur that the from D.I. the status transitions to HEAT

		St00		
		0	1	2
		COOL	HEAT	HEAT+COOL
Operating modes	Cooling	x	NA	x
	Heating	NA	x	x
	Standby (Stdby)	x	x	x
	Remote Standby (Stdby)	x	x	x
	OFF	x	x	x
	Remote off	x	x	x
	AS (see section on Sanitary Water)	NA	X	X
	Remote AS (see section on Sanitary Water)	NA	X	X

If different states are requested at the same time, the following priorities are assigned (in increasing order):

Current working state (current mode)				Working state after request
Priority	COOL	HEAT	HEAT+COOL	
Action	1 Digital input configured as ON/OFF (§)	Digital input configured as ON/OFF (§)	Digital input configured as ON/OFF (§)	Remote OFF (§)
	2 ON/OFF key enabled (press and hold DOWN key)	ON/OFF key enabled (press and hold DOWN key)	ON/OFF key enabled (press and hold DOWN key)	OFF
	3 Digital input configured as Standby	Digital input configured as Standby	Digital input configured as Standby	Standby
	4 Mode key enabled (press and hold ESC key)	Mode key enabled (press and hold ESC key)	NA	Mode chosen by user (see mode changeover key)
	4' NA	NA	Mode key enabled (*)	Standby (*)
	5 NA	NA	Select mode (**) Mode key enabled (press and hold ESC key)	(**) Mode chosen by user (see mode changeover key)

(§) In this case the key [local ON/OFF] has no effect on the operating mode

(*) it will not be possible to switch from COOL mode to HEAT mode (HEAT label not visible by pressing and holding ESC key (Mode changeover function))


(**) it will not be possible to switch from HEAT mode to COOL mode (COOL label not visible by pressing and holding ESC key (Mode changeover function))

8.1 Automatic mode changeover


The automatic changeover function is enabled by parameter **St01- Enable change mode from analogue input**

The Cool/Heat modes are selected by means of two different differentials set by parameter **(St03 - Differential for change automatic mode in Heat** for Heat mode, and **St04 - Differential for change automatic mode in Cool** for Cool mode; in the neutral zone (between the two setpoints), the mode can be set from a key as well (if enabled). See the graph below for more details;

8.1.1 Example of automatic changeover based on water temperature

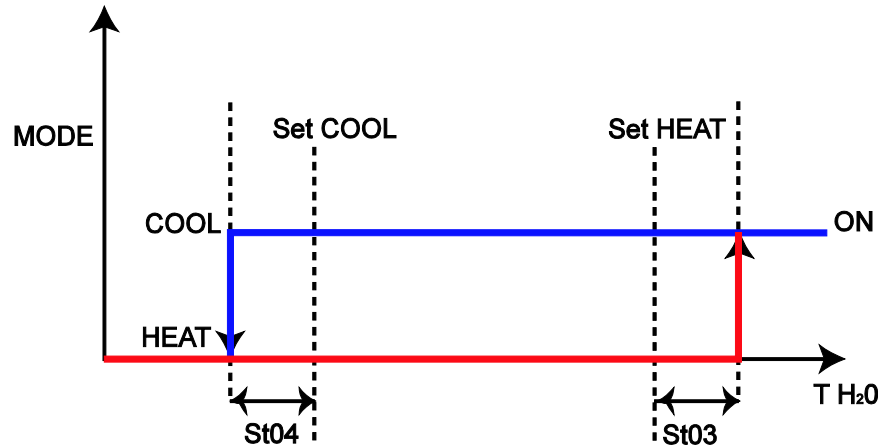

8.1.2 Example of automatic changeover based on external air temperature

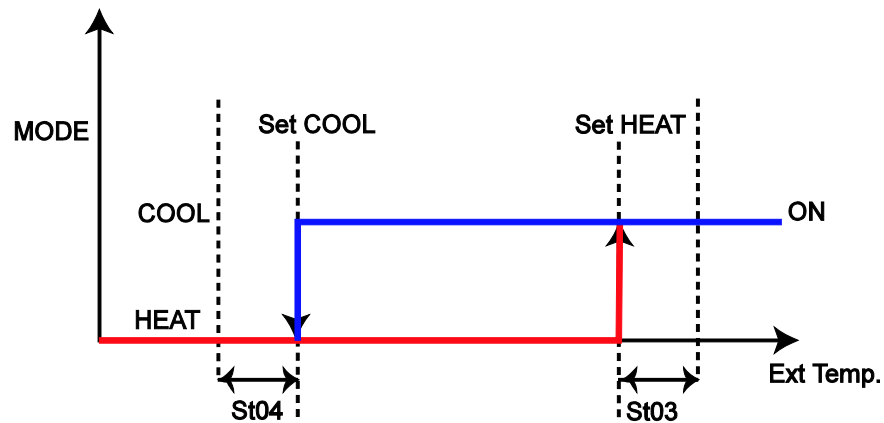

MODE	Operating mode
T H2O	Water temperature (*)
Ext. Temp	External temperature (*)
COOL SETPOINT	Real temperature control setpoint in Cool (**)
HEAT SETPOINT	Real temperature control setpoint in Heat (**)
St03	Differential for change automatic mode in Heat
St04	Differential for change automatic mode in Cool

(*) If St01= 1 see parameters St02

(**) The real setpoints may differ from the values of parameters tr10 and tr20 – see Operating modes – Temperature control (folder PAr/tr)

N.B.: St04 is added to COOL setpoint; St03 is added to HEAT setpoint.

N.B.: $St03 + St04 < \text{HEAT setpoint} - \text{COOL setpoint}$, or the sum of differentials must ever be more than HEAT setpoint - COOL setpoint.

8.2 Operating states table

Operating states and associated functions/algorithms enabled/disabled for each one are listed in the table below.

● Indicates function enabled

Example: The Hot Start function is enabled ONLY in HEAT

Function	Cooling COOL	Heating HEAT	Std-By and remote Std-By	OFF and remote OFF
User interface	●	●	●	● (°)
Temperature controller	●	●		
Operating mode selection	●	●	●	
Compressor	●	●	●	
Internal circuit water pump	●	●	●	
Recirculation fan	●	●		
External exchanger fan	●	●	●	
External circuit water pump	●	●	●	
Internal circuit electric heaters	●	●	●	
External circuit electric heaters	●	●	●	
Auxiliary output	●	●	●	
Water heater		●	●	
Defrost		●		
Dynamic setpoint	●	●		
Economy	●	●		
Adaptive function	●	●		
Antifreeze with heat pump	●	●	●	
Power limitation	●	●		
Running time recording	●	●	●	●
Reset manual alarms	●	●	●	●
Manual defrost		●		
MFK	●	●	●	●
Alarm log	●	●	●	●
Diagnostics	●	●	●	●
Serial communication	●	●	●	●

(°) In this case the button [local ON/OFF] has no effect on the operating mode

8.3 Reversing valve management

The change of state between chiller and heat pump requires switching of the reversing valve.

In order to balance pressures in the circuits, temporary inversion of valve status is performed prior to starting of the compressors in accordance with parameter **St08**.

Energy Flex makes it possible to set the valve switching mode ("slow"/"fast" switching) on the basis of the type of plant, by setting parameter **St05**.

Parameters **St06/St07** instead control transition at start and end of defrost.

INVERTER Compressor Note

Parameter **St06** is also used for inverter management of a BLDCM compressor to define the "post-off" time of the **Compressor 1 Inverter** output in certain situations: its value must be chosen according to the application (inverter and its parametrisation).

Parameter	Changeover / transition	Changeover
St05	Reversal valve switching delay	COOL - HEAT
St06	Reversal valve switching from Heat to Defrost delay	HEAT - defrost
St07	Reversal valve switching from Heat to Defrost delay	Defrost - HEAT
St08	Reversal valve activation time for pressure release	temporary inversion of valve state

If switching time **St05** is other than zero, inversion of the valve for Heat-Cool or Cool-Heat changeover occurs only with the compressors off ("soft inversion" mode). The compressors are switched off and on according to set rules and times. It is a prudent mode, but one which ensures the required efficiency and speed.

If switching time **St05** is equal to zero:


During Heat-defrost transition the inversion of the valve occurs 'run time' ("fast inversion" mode) if **St06**=0 (not depending on **St07**)


During Defrost-Heat transition the inversion of the valve occurs 'run time' ("fast inversion" mode) if **df23**=0 AND **St07**=0 (not depending on **St06**)

8.3.1 Changeover from Cool to Heat and vice versa



- The operation is described below – diagrams A...D.
- Operation in defrost is described in the related sections.
- Note that the mode changeover with **St05**=0 also occurs with the compressors running and operation is also identical in anti-freeze mode with a heat pump

Diagram	Parameter	Changeover	Antifreeze with heat pump
A	St05 different from 0	COOL - HEAT	//
B		HEAT - COOL	//
C	St05 = 0	COOL - HEAT	C
D		HEAT - COOL	D

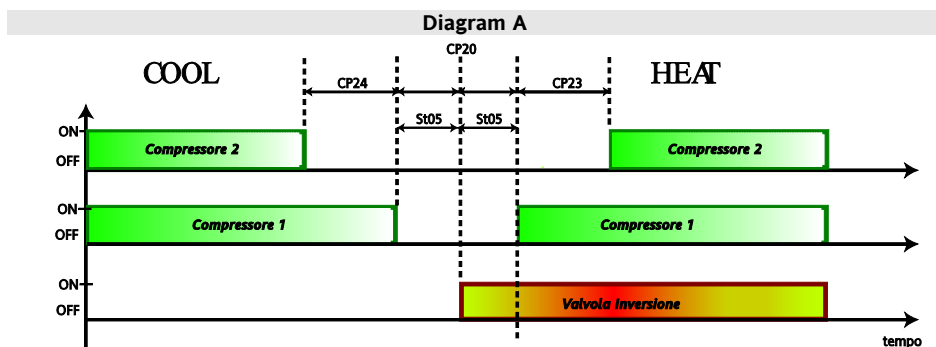

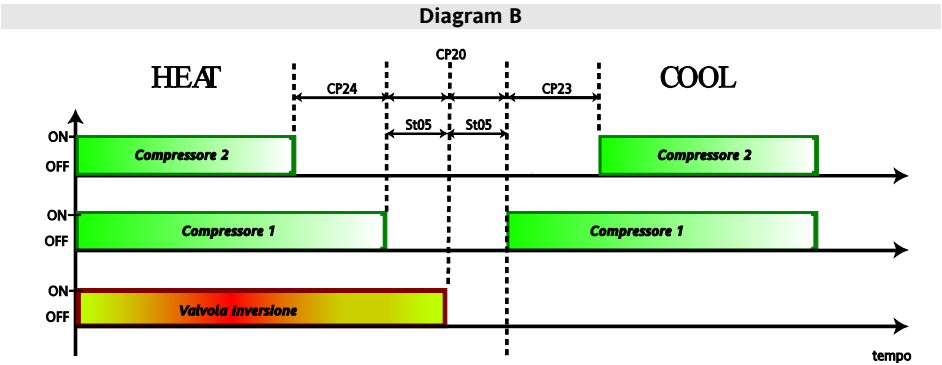

Parameter	Description
St05 different from 0	Reversal valve switching delay
CP20	Minimum off/on for same compressor
CP23	Minimum on/on time for same compressor
CP24	Minimum off/off time for different compressors

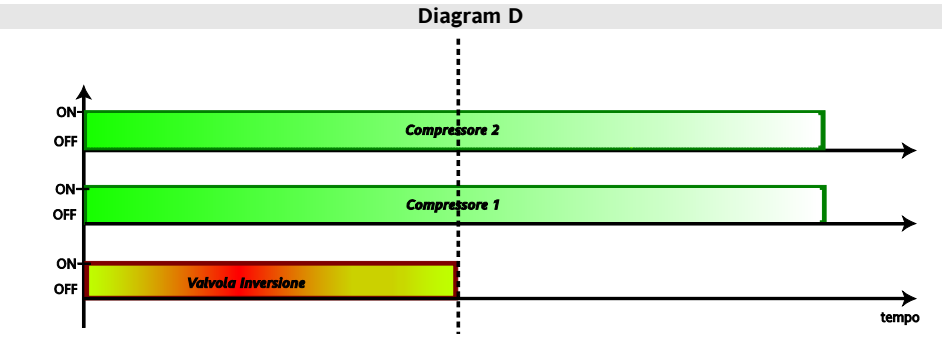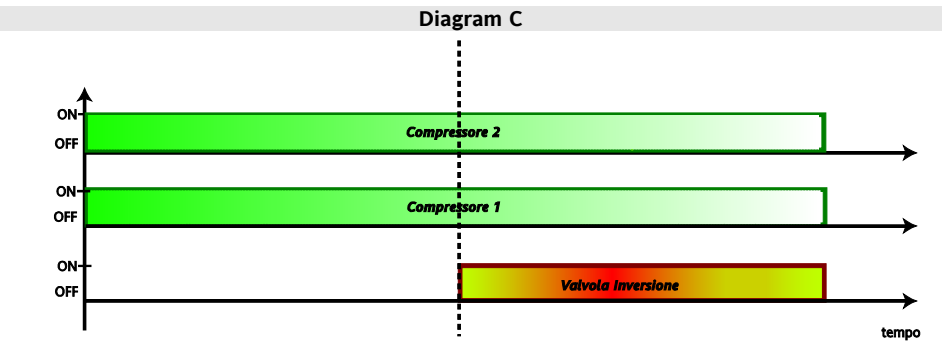

Parameter	Description
St05 = 0	Reversal valve switching delay

8.3.2 Changeover from Cool to Antifreeze and vice versa

Diagram	Parameter	Changeover
E	St05 different from 0	COOL - ANTIFREEZE
F		ANTIFREEZE - COOL

Diagram E


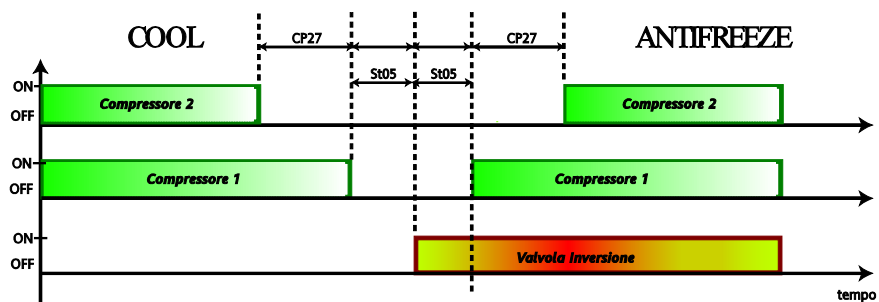


Diagram F

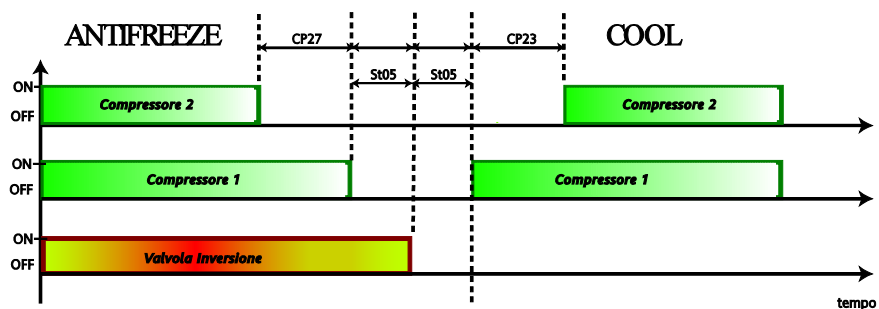

Parameter	Description
St05 different from 0	Reversal valve switching delay
CP27	Defrost compressor/step delay minimum

8.3.3 Heat – defrost mode changeover

Diagram	Parameter	Changeover
G	St06 / St07 <u>both</u> different from 0	HEAT – defrost
H	St06 / St07 <u>both</u> different from 0 And no dripping (dF23=0)	Defrost - HEAT

Diagram G


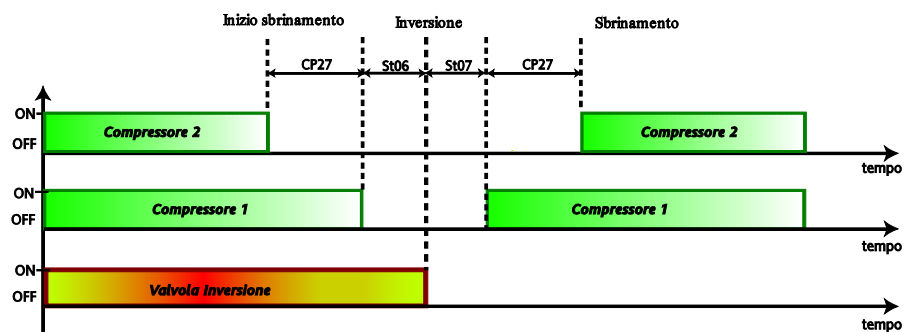


Diagram H

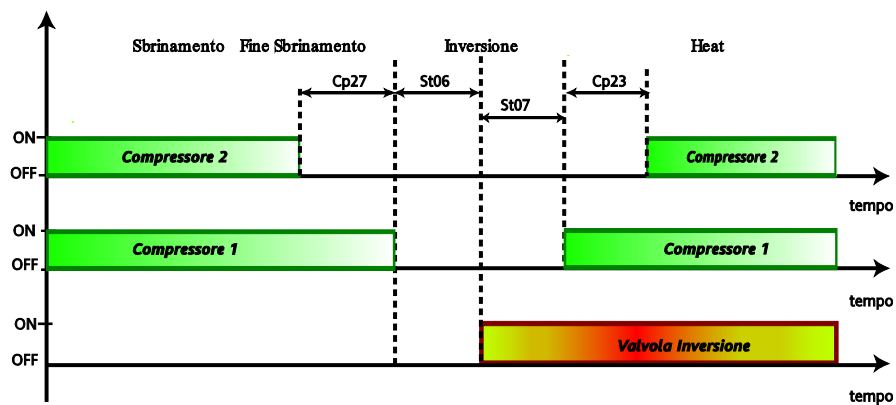

Parameter	Description
St06 different from 0	Reversal valve switching from Heat to Defrost delay
St07 different from 0	Reversal valve switching from Defrost to Heat delay
CP27	Defrost compressor/step delay minimum
dF23	Drip time > St06

8.3.4 Circuit pressure release

If parameter **St08 – Reversal valve activation time for pressure release** is

- set to a value different from zero
- none of the other control sequences described above are in progress,


each time the compressors are completely switched off, the reversal valve is temporarily inverted.

This results in improved balance in the circuits and ensures better restart of the compressors themselves.

When the time **St08** has elapsed, the valve returns to the previous position.

This activation of the valve always occurs exclusively with the compressors off.

The time interval is cancelled with immediate effect if new conditions occur that require the restarting of the compressors and the immediate resetting of the valve to its previous position.

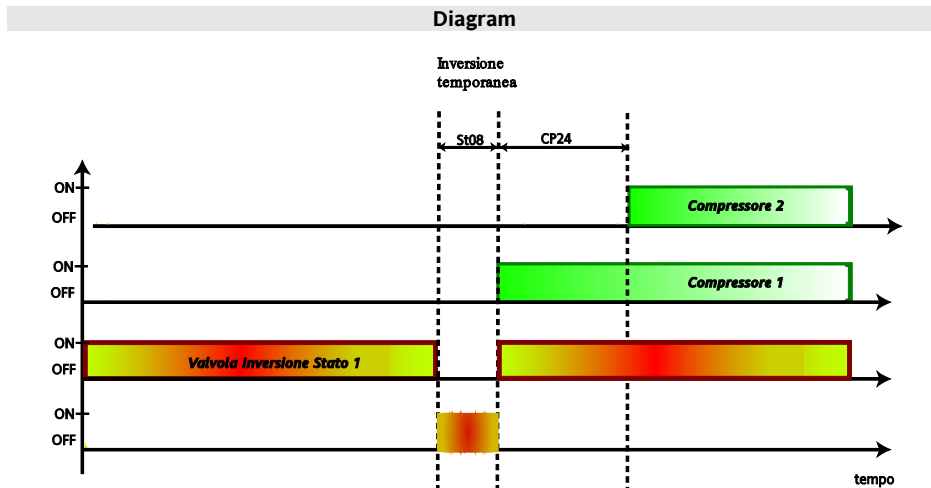

8.4 Cycle inversion and changeover of operating mode in XVD drivers

When the cycle in the refrigerant circuit is inverted it is very likely that the superheating regulation obtained by means of the XVD drivers will have very different performance specifications. This may be the case, for example, of the water/air circuits in which the exchangers, internal and external, are very different.

It may therefore be necessary to use 2 settings of the various regulation parameters (PID, superheating setpoint,...).

Hence operating mode command "1"=HEAT on activation of the inversion valve switching to HEAT mode, or operating mode command "0"=COOL on deactivation of the inversion valve at the time of return to cooling mode, will be transmitted to the XVD modules (if present).

The XVD modules can be set to disregard this command by setting the same parameters vector for the two operating modes (parameters 1E21, 1E22 and 2E21, 2E22).

In greater detail, to specify more clearly the management of the vectors associated with the various operating modes, when 1E21 and 1E22 are set to 0, the values 1E30...1E53 specified in the parameters map of the SBA controller will be used for both HEAT/COOL modes (they are sent to module XVD via LAN along with the other shared parameters, and substitute parameters dE30...dE53).

In contrast, when 1E21 and 1E22 assume values other than 0 (typically the permitted values are 12...16), for HEAT/COOL modes the values dE30...dE53 will be used as specified in vectors 12...16 of the parameters map of the XVD module.

The same occurs for the second XVD module, if present (parameters 2E21 and 2E22...).

9 COMPRESSORS (FOLDER PAR/CP)

Compressor parameters can be viewed and configured in folder **CP** (see User Interface and Parameters chapters).

The parameters are:

- CP00, CP01 to define the type and number of compressors in the system;
- CP03..CP10 to define the timings.

The Energy SBA600 is able to control "Alternate", "Scroll" and "Screw" compressors in a range of configurations.

The Energy SBA600 controls up to two cooling circuits, with one or two evaporators.

The Energy SBA600 can control from one to four power steps, at most two per cooling circuit.

The Energy SBA600 can also drive inverters for compressors by means of the following analogue outputs

- Analogue stage 1 for Compressor
- Analogue stage 2 for Compressor

The type of compressors management depends on the configuration of the analogue outputs.

Energy SBA600 has 3 analogue outputs, 2 with voltage output 0-10V and one with current output 0-20mA or 4-20mA. Of the three outputs, a maximum of 2 can be configured as analogue outputs to control a compressor inverter; depending on the number of outputs configured only one or both the analogue stages (equivalent to a capacity step) are available.

NB: compressor management via inverter is only suitable for systems with non-capacity-controlled compressors.

Safety timings can be set for the actuation of compressors and power stages to prevent damage.

Special on/off sequences can be programmed to optimise the use of the available compressors and powers.

General conditions of operation

In **Off** status the compressors are stopped immediately and always (even when the safeties are active).

In Stand-by the compressors are normally OFF; during the transition from On to Standby, they are stopped in accordance with their timings. In Stand-by, the compressors are activated in anti-freeze with heat pump mode

In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):

the compressors are switched off immediately in case of compressor shut-down alarms (see alarms table).

9.1 Types of compressor

Compressors may be controlled in a variety of ways according to their number, size and construction.

Parameter **CP00** indicates the **type of compressor**:

Value CP00	Description
0	Non-power stage compressors
1	Alternate power stage compressors
2	Screw power stage compressors

Configuring digital outputs as compressor:

The compressor or compressors or the compressor and its power stage must be connected to one of the available relay outputs **D01...D04, D06 or to the open collector output D05** with the following parameter settings:

- CL90...CL95= $\pm 1... \pm 4$ for compressor1..4

9.1.1 Non-power stage compressors (CP00 = 0)

This is the simplest case, in which the individual compressor is switched on/off via a single digital output. If more compressors are present, they can be of the same or a different power rating and switched on according to the power requirements of the system.

Compressor without power stages: **CP00 = 0**.

N.B.: Set **CP03=0**

Power	Compressor
0	Off
100%	On

4 Homogeneous compressors without power stages: **CP00 = 0**

Power	Compressor 1	Compressor 2	Compressor 3	Compressor 4
0	Off	Off	Off	Off
25%	On	Off	Off	Off
50%	On	On*	Off	Off
75%	On	On*	On*	Off
100%	On	On*	On*	On*

*In this case, the starting sequence is fixed. This may not always be the case.

Installations with inverter: since only two analogue outputs are available to drive compressors, if the installation has more than two compressors it must utilise mixed analogue and relay management; in this case the analogue capacity steps are always the "higher" steps, i.e. those that are furthest from the setpoint. Refer to the paragraph Compressors Configuration / **Permitted configurations** in the case of compressors without capacity control (**CP00** = 0) for the various permitted combinations and configurations according to the type of system, which is understood as the number of compressors and the number of circuits.

9.1.2 Power stage compressors (CP00 = 1,2)

The construction of these compressors enable them to modulate their power delivery by means of power stage activation. Each compressor is switched on or off by a single digital output, but other digital outputs control its power stage depending on the power requirements of the system.

The compressor is always switched on or off without any power stage active.

There are two methods for activating power stages: for multiple cylinder reciprocating compressors, for screw compressors.

In the first case, the power stage is obtained by short circuiting the suction and discharge valves of the cylinders, in screw compressors by deviating the discharge flow to various positions along the screw.

The actuation logic for the power stage relays is different in each case; see the following table:

Alternate power stage compressors with 3 power stages: **CP00** = 1

There are 3 power stages, so the compressor can deliver 0%, 25%, 50%, 75% or 100% of its power

Power	Compressor	Power stage 1	Power stage 2	Power stage 3
0	Off	Off	Off	Off
25%	On	On	On	On
50%	On	On	On	Off
75%	On	On	Off	Off
100%	On	Off	Off	Off

N.B.: The compressor control timings are different from those of the power stages. See Compressor timings for more details.

N.B.: note that with **CP00** = 2, starting of the compressor (necessarily at 25% of its power) occurs by activating two relays simultaneously.

9.2 Compressor configuration

The SBA600 can control from one to a maximum of four steps on a single circuit, or up to two steps per circuit for a total of two circuits.

The system is configured with the parameters

- **CP01** - Number of circuits
- **CP02** - Number of compressors per circuit
- **CP03** - Number of capacity steps of compressor

Multicompressor configurations always use compressors of the same type/construction.

Multicircuit installations always employ symmetrical circuits.

Permitted configurations:

- In the case of non-power stage compressors (**CP00**= 0)

CP00 = 0 (set CP03=0)		Non-power stage compressors			
		CP02 = 1	CP02 = 2	CP02 = 3	CP02 = 4
Circuits	CP01 = 1	Compressor 1 (§)	Compressor 1 (*) Compressor 2 (**) (§)	Compressor 1 Compressor 2 Compressor 3	Compressor 1 Compressor 2 Compressor 3 Compressor 4
	CP01 = 2	Compressor 1 (*)	Compressor 1 Compressor 2	Not allowed	Not allowed
		Compressor 2 (**)	Compressor 1 Compressor 2		
N.B.: Set CP03=0					

(§) Capacity step replaced by analogue stage 1 if a single analogue output is configured as compressor

(*) Capacity step replaced by analogue stage 1 if 2 analogue outputs are configured as compressor

(**) Capacity step replaced by analogue stage 2 if 2 analogue outputs are configured as compressor

N.B.: asymmetrical or unbalanced distributions of inverter controls for compressors are not permitted

- In the case of capacity controlled compressors (**CP00** = 1 and 2) with 1 capacity step per compressor (**CP03** = 1)

CP00 = 1 and 2 CP03 = 1		Compressors with 1 capacity step			
		CP02 = 1	CP02 = 2	CP02 = 3	CP02 = 4
Circuits	CP01 = 1	Comp. 1, Step 0	Comp. 1, Step 0	Not allowed	Not allowed
		Comp. 1, Step 1	Comp. 1, Step 1		
	CP01 = 2	Comp. 1, Step 0	Not allowed	Not allowed	Not allowed
		Comp. 1, Step 1 Comp. 2, Step 0 Comp. 2, Step 1			

KEY: (Comp. = compressor, Step = Step)

- In the case of power stage compressors (*Type of compressor* **CP00** = 1 and 2) with 2 power stages per compressor (*Number of capacity steps of compressor* **CP03** = 2)

CP00 = 1 and 2 CP03 = 2		Compressors with 2 power stages			
		CP02 = 1	CP02 = 2	CP02 = 3	CP02 = 4
Circuits	CP01 = 1	Comp. 1, Step 0 Comp. 1, Step 1 Comp. 1, Step 2	Not allowed	Not allowed	Not allowed
	CP01 = 2	Not allowed	Not allowed	Not allowed	Not allowed

- In the case of power stage compressors (**CP00**: *Type of compressor* = 1 and 2) with 3 power stages per compressor (**CP03**: *Number of power stages per compressor* = 3)

CP00 = 1 and 2 CP03 = 2		Compressors with 3 power stages			
		CP02 = 1	CP02 = 2	CP02 = 3	CP02 = 4
Circuits	CP01 = 1	Comp. 1, Step 0 Comp. 1, Step 1 Comp. 1, Step 2 Comp. 1, Step 3	Not allowed	Not allowed	Not allowed
	CP01 = 2	Not allowed	Not allowed	Not allowed	Not allowed

9.3 Compressor timing

Compressor and power stage on/off states must be limited in time to ensure the mechanical and electrical safety of the equipment.

The SBA600 provides a set of safety parameters for compressors and power stages.

In some cases, such as during defrosting, these parameters are not considered to guarantee machine performance. In other cases, the safety timings may influence or modify the compressor operation logic.

- CP20: Minimum off/of for same compressor** [Secx10]
- CP21: Minimum on/on time for same compressor** [Secx10]
- CP22: Minimum compressor on time** [Secx10]
- CP23: Minimum on/on time for different compressors** [Sec]
- CP24: Minimum off/off time for different compressors** [Sec]
- CP25: Minimum compressor on time per splitting increment** [Sec]
- CP26: Minimum compressor on time per splitting decrease** [Sec]
- CP27: Defrost compressor/step delay minimum** [Sec]

9.3.1 Minimum time between switching off/on for a given compressor


Defined by parameter **CP20**: *Minimum off/on for same compressor* is the minimum time that must elapse between one compressor switch-off and its next start-up. This is expressed in seconds x 10 and is active even after a reset.

9.3.2 Minimum time between switching on/on for a given compressor

Defined by parameter **CP21**: *Minimum on/on time for same compressor* is the minimum time that must elapse between one start and the next. This is expressed in seconds x 10 and is active even after a reset.

9.3.3 Minimum compressor on time

Parameter **CP22**: *Minimum compressor on time* defines the minimum time between a compressor start and compressor stop. It is expressed in seconds x 10

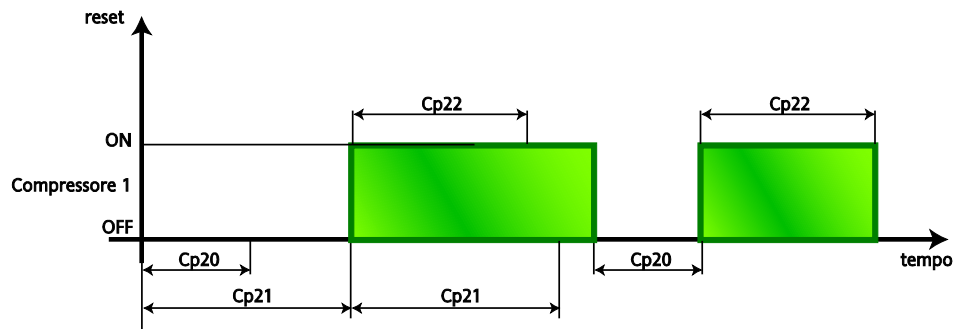


9.3.4 Minimum on/on time for same compressor

Parameter **CP23**: *Minimum on/on time for different compressors* defines the minimum time between two different compressors switching on. If requested, a compressor can be switched on only after this time has elapsed since the previous compressor was switched on. This is expressed in seconds and is active even after a reset.

9.3.5 Minimum off/off time for different compressors

Parameter **CP24**: *Minimum off/off time for different compressors* defines the minimum time between two compressors switching off. If requested, a compressor can be switched off only after this time has elapsed since the previous compressor was switched off. This is expressed in seconds and is active even after a reset.

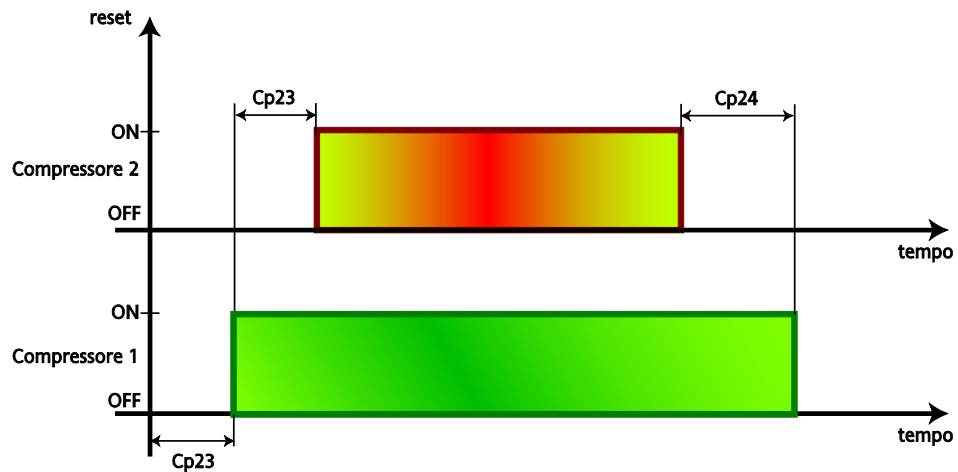


9.3.6 Minimum compressor on time per splitting increment

Parameter **CP25**: *Minimum compressor on time per splitting increment* defines the minimum generic time between two power stage increments (steps). It is expressed in seconds.

9.3.7 Minimum compressor on time per splitting decrease

Parameter **CP26**: *Minimum compressor on time per splitting decrease* defines the minimum generic time between two power stage decreases (steps). It is expressed in seconds.

N.B.. **CP25** and **CP26** have priority over **CP23** and **CP24**

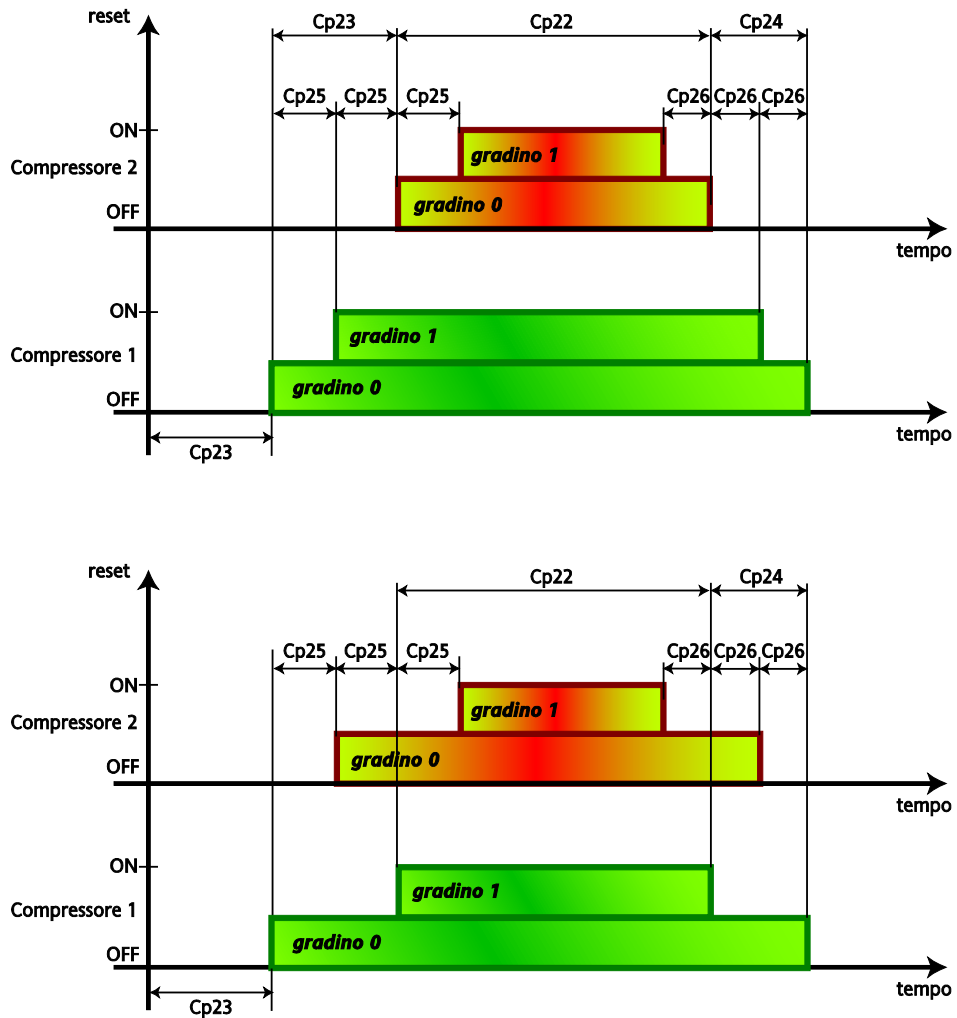

N.B.. When safety timings overlap, the longest one prevails.

9.3.8 Defrost compressor/step delay minimum

In defrost mode and during antifreeze with heat pump, times **CP23**, **CP24**, **CP25** and **CP26** are disregarded and replaced with parameter **CP27**: *Defrost minimum on-off time* is the single minimum time for increase or release of a generic power stage.

In other words, this safety timing applies to both compressors, power stages and compressors/power stages.

All other safety timings are ignored in this phase. This speeds up the start and end of defrosting, or at least controls their duration.

For consistent operation in all situations, parameter **CP27** must be set to lower values than parameters **CP23/CP24**.

9.3.9 Pump Down

The pump-down system consists of unloading the evaporator before each stoppage of the last compressor in the circuit. To achieve this aim, it is necessary to have a solenoid valve on the liquid line, which is able to completely intercept the refrigerant.

The solenoid valve is installed before the thermostatic expansion valve and is able to completely stop the flow of refrigerant.

The solenoid valve is controlled by the Energy Flex, one for each circuit.

Parameters involved

CP33	Pump-down time during shutdown
CP34	Pump-down interruption set-point
AL43	Low pressure alarm activation time from analogue input
AL44	Low pressure alarm regulator setpoint from analogue input
AL45	Low pressure alarm regulator hysteresis from analogue input

Enabling

The function is enabled if the parameter CP33 - Pump-down time during shutdown is different from 0

Digital outputs used

- Circuit 1 pump-down valve
- Circuit 2 pump-down valve

appropriately configured.

Before the last compressor in the circuit is shut down, the solenoid valve is activated (closed). The compressor remains active until the low pressure analogue input in the same circuit doesn't reach the Setpoint CP34 - Pump-down interruption set-point.

On the other case (analogue input non configured), compressor will remain active until the low pressure digital input is activated. On both cases the compressor cannot stay ON after maximum time defined by CP33 - Pump-down time during shutdown.

At the next request compressors of the circuit, the solenoid valve opens and begins the activation of the compressors when the analog input of low pressure exceeds the value AL44 + AL45. If the analog input is not configured, it starts the activation when the digital input of low pressure is deactivated. If the analog input of low pressure is already higher than the specified threshold or, in his absence, if the digital input of low pressure is already off, compressors activation starts simultaneously to the opening of the valve.

If the analog input does not exceed the specified threshold or, in the second case, if the digital input low pressure does not turn off, the compressor does not start and the unit produces a low pressure alarm (analog or digital) after a CP33 time.

Notes:

- If an alarm is active, the procedure is ignored and the compressors shut down immediately.
- If the device is OFF, the procedure is ignored and the compressors shut down immediately.
- If the device is in standby mode, the pump-down during shutdown procedure occurs as normal.

During the pump-down phases, the digital and analogue low pressure alarms are ignored.

If the value of the parameters St05/St06/St07 is different from 0, the pump-down during shutdown procedure does not occur:

- when passing from Heat mode to defrost, and on exiting defrost
- when passing to antifreeze with heat pump
- when changing mode

The alarms which deactivate the digital outputs Circuit 1 pump-down valve and Circuit 2 pump-down valve are the same alarms which deactivate the compressors in the given circuit

Please Note. in the alarms table no distinction is made between compressors and valve in the same circuit.

9.3.10 Other timings

Compressors are also subject to other timings related to the operational status of other services such as water pumps, reversing valves, etc.

For details, see the chapters dealing with these services.

9.4 Compressor on/off sequence

9.4.1 Availability of resources

A resource is available if it can be used (switched on/off).

A compressor (or its power stage, if applicable) is available if

- it is not blocked due to an alarm (see alarms section)
- it is not blocked by safety timings (see compressors section)
- it is not blocked by the configuration (see compressors section)
- there are no blocks caused by temperature control (e.g. heat pump block, capacity limitation, etc.)

When checking the availability of resources, the Compressors → Circuits sequence is always followed.

When selecting (actuating/deactivating) resources, the opposite sequence is followed: Circuits → Compressors (selecting an evaporator selects its circuit).

A circuit is said to be saturated when it is delivering all the power stages available from its compressors. A circuit is said to be active or on if at least one compressor is running, and off if none of the compressors is running. The current activation level of a particular circuit is defined as the total number of power steps that the compressors are supplying at the time (for example, a circuit that has 2 compressors with 1 power stage can supply up to 4 activation levels/steps).

A compressor is said to be saturated when it is supplying its maximum number of deliverable steps (for example, a compressor with 3 power stages can supply at most 4 activation levels/steps). A compressor is said to be active or on if it has at least one active step. The activation level of a particular compressor is defined as the total number of power steps that it is supplying at the time (for example, a compressor that has 2 power stages can supply up to 3 activation levels/steps).

9.4.2 Managing resources

If the number of active steps satisfies the current request, it is not modified.

If the temperature controller requests activation/deactivation of a capacity step, the availability of the compressors and circuits is first analysed in order to manage the services on the basis of two possible logics, saturation and balancing. The procedure is to first select the best circuit and then the best compressor in that circuit.

Saturation: The saturation policy attempts to distribute resources equally over the smallest possible number of services compatible with the constraints imposed by other requirements, for example compressor safety timings.
The resulting allocation is such as to have the largest possible number of compressors switched off and circuits deactivated at any one time.

Balancing: The balancing policy attempts to distribute resources equally over the largest possible number of services compatible with the constraints imposed by other requirements, for example compressor safety timings.
The resulting allocation is such as to have compressor and circuit output levels equalized as far as possible (in other words, the smallest number of compressors and circuits switched off).

There are two parameters that make it possible to establish circuit (and evaporator) activation separately as well as activation of the compressors for each circuit:

- **CP10: Enable circuit balancing**
- **CP11: Enable compressor balancing**

Value CP10 CP11	Description CP10	Description CP11
0	Saturation (circuits)	Saturation (compressors)
1	Balancing (circuits)	Balancing (compressors)

9.4.3 Resource selection criterion

When the two control selections are applied (saturation and balancing), it may happen that one has to choose between resources which are equally available (for example, when switching on the very first service of all). This selection must therefore also take into account factors such as hours of operation and fixed on/off sequences.

The hours of operation of a circuit is the sum of the operating hours of its compressors.

Hours of operation: When making a choice, the strategy is to select the circuit or compressor that has the least hours of operation when switching on and the most hours of operation when switching off. This strategy ensures that all resources are used equally.

Fixed sequence: **On(1-2-3-4), Off(4-3-2-1)**
In this case, the selection of the circuit or compressor follows a fixed sequence (subject to availability). This option uses the resources in a fixed manner, which may be useful in case of steps of different power or when managing secondary backup resources in special circumstances.

Fixed sequence INVERTER compressor: **On(1-2-3-4), Off(4-3-2-1)**
Only usable option in the case of single-circuit configuration with at least one compressor managed by INVERTER

Operating time: This option applies only when there is a single circuit with two compressors (non-power stage) or two circuits with two compressors each, and uses the compressor resources (in this case, non-homogeneous) in a manner that is equal to the load.
If the effective operating time of the circuit (TE, time between starting the first compressor and stopping the last compressor during the previous cycle) is less than the time set by parameter, on the next request from the temperature controller (for that specific circuit) the first compressor resource to be activated will be the one with the lowest index ("resource 1") and then resource 2; if the effective operating time of the circuit is greater than the time set by parameter, on the next request from the temperature regulator the first compressor resource to be activated will be the one with the highest index ("resource 2") and then resource 1.

There are two parameters that serve to establish independently the circuits selection criterion and the compressors selection criterion for each circuit:

- **CP12: Circuit selection criterion**
- **CP13: Compressor selection criterion**

Value	Description CP12	Description CP13
0	Hours balancing	Hours balancing
1	Sequence On 1,2; Off 2, 1	Sequence On 1,2,3 and 4; Off 4,3,2 and 1
2	//	Operating time

9.4.4 Selecting the circuit/evaporator

Parameter **CP10: Enable circuit balancing** is only relevant if there are 2 circuits. If set to 0 (saturation) all the power steps of a given circuit are first activated, followed by those of the other circuit. If set to 1 (balancing), the power steps are activated in such a way that both circuits deliver the same power, or the difference is at most one step.

The choice of circuit depends on parameter **CP12: Circuit selection criterion**

CP12	Saturation CP10 = 0	Balancing CP10 = 1
Hours of operation CP12 = 0	When switching on, the circuit with the least hours of operation is selected (with compressors available for starting) up to saturation, then the second circuit is activated. When switching off, first the circuit with the fewest active capacity steps is switched off (with compressors available for switch-off), or (for an equal number of active capacity steps) the one with largest number of running hours.	When switching on, the procedure starts with a step of the circuit with the fewest running hours (with compressors available to start); this is then balanced with a step from the other circuit and so forth until both circuits are saturated. When switching off, the opposite sequence is followed, giving priority to the circuit with most running hours (with compressors available for switch-off).
Fixed sequence On(1,2) Off(2,1) CP12 =1	When switching on, the first circuit is used up to saturation, after which the second circuit is activated. When switching off, first the entire second circuit is switched off, followed by the first circuit.	When switching on, the procedure starts with a step of the first circuit; this is then balanced with a step from the other circuit and so on until both are saturated. When switching off, the opposite sequence is followed.

9.4.5 Selecting the compressor or power stage

Parameter **CP11: Compressor balancing enabling** is relevant only if there are 2 power stage compressors in the same circuit (which for the SBA600 remains single, since it cannot control a second compressor with the same characteristics).

When 0 is selected (saturation), all the power steps of one compressor are first activated, followed by those of the other compressor. When 1 is selected (balancing), the power steps are activated in such a way that both circuits deliver the same power or the difference is no more than one step. The choice of compressor depends on parameter **CP13: Compressor selection criterion**.

Parameter **CP14: Compressor operating time for each on sequence** is used if the running time in the previous cycle is used as the selection criterion.

CP13	Saturation CP11 = 0	Balancing CP11 = 1
Hours of operation CP13 = 0	When switching on, the available compressor with the least hours of operation is selected until it is saturated, after which the other compressors are selected. When switching off, first the available compressor with least power stages active is selected, or (for an equal number of power stages active) the one with the largest number of hours of operation.	When switching on, the procedure starts with the first power stage of the compressor with least hours of operation, then the first stage of the next compressor until all compressors are operating, then the second stages, etc. When switching off, the procedure switches off the power stages of the available compressors with the same logic, favouring those with the largest number of hours of operation.
Fixed sequence On(1,2,3,4) Off(4,3,2,1) CP13 = 1	When switching on, the first compressor is used up to saturation, after which the second compressor is activated, and so on. When switching off, the first compressor to be selected is the one with the highest index, until it is completely switched off, and so on.	When switching on, the procedure starts with the first power stage of the first compressor, then the first stage of the second compressor until all compressors are operating, then the second stages, etc. When switching off, the stages are switched off with the same logic, starting from the one with the highest index.
Operating time CP13 = 2	CP11 is irrelevant because selection by operating time <u>is not used</u> if there are 2 capacity controlled compressors in the same circuit. If the effective operating time of the <i>circuit</i> is less than the time set in parameter CP14, at the <u>next</u> temperature controller request the start sequence On(1,2) and the stop sequence Off(2,1) will be used. In the case of two circuits with two compressors each, the sequences are On(3,4) and Off(4,3), independently for the two circuits. But if the operating time is greater than CP14, the next sequences will be On(2,1) and Off(1,2).	

10 INTERNAL CIRCUIT PUMP (FOLDER PAR/PI)

The **SB600** controls one or two hydraulic pumps on the internal exchanger water circuit. Control may be digital or analogue, and depends on a number of system variables such as temperature controller status, external exchanger fan speed and internal exchanger water temperature.

For systems with two pumps, these are connected in parallel, and at most one is operational at a time.

Internal circuit water pump parameters can be viewed and configured in folder **PI** (see User Interface and Parameters chapters).

The following must be configured:

Digital control

- at least one digital output as internal circuit water pump 1, using the parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ±14**.
- **at least one digital output as internal circuit water pump 2, using the parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ±15**.

Analogue control

- at least one analogue output as modulating internal circuit water pump 1, using the parameters **CL80-CL81 if analogue / CL61...CL63 if analogue = ±59**.
- **at least one analogue output as modulating internal circuit water pump 2, using the parameters **CL80-CL81 if analogue / CL61...CL63 if analogue = ±60**.

** when there are two pumps.

The configurable outputs for digital pump control are relays, whereas in modulating operation they are the internal triac (for direct control) or the pulse outputs (for external triacs) and the analogue outputs.

10.1 Configuration of internal circuit water pump

Enabling

The controller is enabled by setting parameter (**Pi00 - Select primary circuit water pump function**) not equal to 0.

Control of the second pump is enabled only if parameter (**Pi05 - Maximum internal circuit water pump changeover start time**) is not equal to 0.

Table 1

	Parameter	Description	value		
			0	1	2
I pump	P100	Select primary circuit water pump function	Pump disabled	Continuous operation (Always ON)	on request (pump on when compress or on)
			0	Not equal to 0	
II pump	PI05	Maximum internal circuit water pump changeover start time	Pump disabled	after this time (in minutes) the active pump is switched off and replaced by the second pump if available	

Table 2

	Parameter	Description	value		
			0	1	2
antifreeze heater	PI10	Enable internal circuit water pump on when anti-freeze heaters on	internal circuit water pump disabled	Internal circuit water pump enabled	//
boiler	PI11	Enable internal circuit water pump start when boiler active	No enabling	Enable pump when the boiler is on	Enable modulating pump on the basis of the temperature difference between internal exchanger water/air inlet Internal exchanger water/air outlet temperature See configuration of analogue inputs

General conditions of operation

At any given time, only one of the pumps may be operating, so that we will talk below of “the pump”, rather than “the pumps”.

- In **Off** the internal circuit pump is immediately and always off (even if post-pumping is underway).
- In **Standby** the internal circuit pump is normally off; during the transition from On to Stand-by, the pump is switched off in accordance with its timings (e.g. post-pumping). In Standby, the pump is activated in: antilock, antifreeze with water pump, antifreeze with internal heater, antifreeze with heat pump.
- In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - In *Defrosting* the internal circuit pump is always on (at maximum speed if of the modulating type);
 - The pump is forced on (at maximum speed if of the modulating type) if *antifreeze with water pump* is active, which is also active in Stand-by;
 - The pump is forced on (at maximum speed if of the modulating type) if *anti-lock* is active, which is also active in Stand-by;
 - The pump is forced on (without delays) if the internal heater is on in integration mode, both to prevent damage to the exchanger and to ensure that the heat is effectively dispersed/used;
 - The pump be forced on (at maximum speed if of the modulating type) if *antifreeze with internal circuit heater* is active, depending on parameter **Pi10: Enable primary circuit water pump on when anti-freeze heaters on** (also active in Standby);
 - The pump may be forced on (without delays and at maximum speed if modulating) if the *boiler* is active, depending on parameter **Pi11: Enable internal circuit water pump start when boiler active**; with **Pi11** = 0, if only the boiler is active and the pump is enabled on request, the pump is normally off;
 - The pump is influenced by the Sanitary Water regulator if the value of parameter AS00 is 4 or 6 e.g. with systems provided with the Sanitary Water pump rather than the Sanitary Water valve. This influence is due to the fact that the two pumps cannot both be ON at the same time; see the section on Sanitary Water;
 - The pump is switched off immediately in case of pump block alarm (see alarms table and flow switch paragraph).

N.B.: If an automatic reset flow switch alarm occurs, the pump is kept on to allow it to be reset; if the alarm becomes manual reset, the pump is switched off.

N.B.: The minimum time between the pump switching off then switching back on again is fixed and set at 10 seconds. This applies to both pumps individually.

10.1.1 Control of the second pump

The system's two pumps are connected in parallel, and at most one is operational at a time.

At each activation request the pump with least operating hours is activated, if available, i.e. if there is no thermal switch alarm.

If it is not available, the other pump is activated.

If the active pump is active for longer than the time given in parameter **Pi05 - Maximum internal circuit water pump changeover start time**, it is switched off and the other is turned on (if available, otherwise the timer is set to zero and the same pump keeps running).

10.2 Continuous operation

Case **Pi00**= 1.


10.2.1.1 Internal circuit pump digital control in Cool / Heat

One of the two digital outputs is always active.

10.2.1.2 Internal circuit pump analogue control in Cool / Heat

One of the two analogue outputs is always active and controlled in continuous mode.


The modulating operation of the internal circuit water pump is either active or not depending on the external exchanger fan speed. In the case of two circuits, we take the average speed of the two fans.

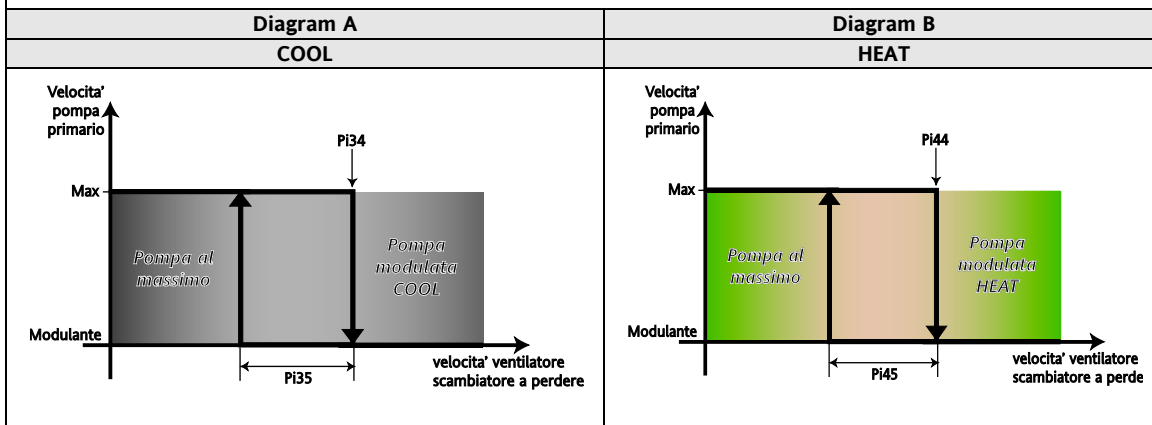

Parameter		Description
COOL	HEAT	
PI02		Internal circuit water pump pick-up time.
PI30	PI40	Minimum primary circuit water pump speed in Cool / Heat
PI31	PI41	Maximum primary circuit water pump speed in Cool / Heat
PI34	PI44	Fan speed setpoint for primary circuit water pump modulation in Heat
PI35	PI45	Fan speed hysteresis for primary circuit water pump modulation in Heat
Control sensor		Internal exchanger water/air outlet temperature or the difference between - Internal exchanger water/air inlet temperature and - Internal exchanger water/air outlet temperature

Modulating function in Cool / Heat mode

The internal circuit modulating pumps connected to the analogue outputs are switched on at maximum speed (relative to the current mode of operation) for a period given in parameter **PI02 - Internal circuit water pump pick-up time**. After this time, the pump is run at the speed requested by the controller.

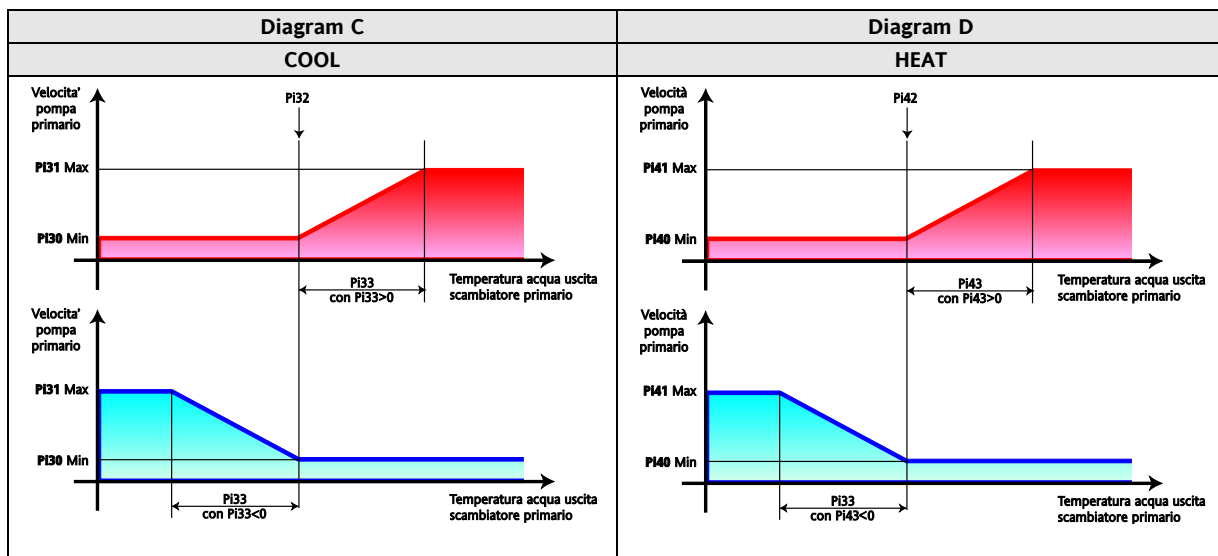

Parameter		Description
COOL	HEAT	
PI02		Internal circuit water pump pick-up time.
PI30	PI40	Minimum primary circuit water pump speed in Cool / Heat
PI31	PI41	Maximum primary circuit water pump speed in Cool / Heat
PI32	PI42	Minimum primary circuit water pump setpoint speed in Cool/Heat
PI33	PI43	Proportional band primary circuit water pump in Cool/ Heat
Control sensor		Internal exchanger water/air outlet temperature or the difference between - Internal exchanger water/air inlet temperature and - Internal exchanger water/air outlet temperature

N.B. The pump runs *at minimum speed* if the compressors are off.

N.B. A probe must be configured as *Internal exchanger water/air outlet temperature* and if two probes are so configured, the **average** is taken.

N.B. If $PI00=2$ i.e. if the difference between

- Internal exchanger water/air inlet temperature and
- Internal exchanger water/air outlet temperature

is considered, it is not permitted to have two output probes.

10.3 Operation in response to request

Case $PI00=2$.

10.3.1.1 Internal circuit pump digital control in Cool / Heat

One of the two digital outputs is active in parallel with the compressor. The internal circuit pump is activated when the main temperature controller calls the first step. The compressor starts after the delay given in parameter **PI20**: *Delay primary circuit water pump on - compressor on* (Pre-pumping). Once the last power stage of the compressor is off, the pump is switched off after the delay given in **PI21**: *Delay compressor off - primary circuit water pump off* (Post-pumping).

N.B.: Post-pumping is also observed in stand-by mode.

10.3.1.2 Internal circuit pump analogue control in Cool / Heat

The two analogue outputs are activated in the same situations in which the digital outputs are activated (with pre / post-pumping) but allow for analogue control, with modulating operation according to the diagrams in the previous paragraphs for continuous operation (modulation as a function of the internal exchanger water/air outlet temperature probe value or the **average** of the two).


N.B. The pump runs *at minimum speed* if the compressors are shut down by alarms.

10.3.1.3 Operation on call: periodic pump activation

The function is **enabled** if **PI22** is not equal to 0, and allows water to be driven round the circuit at regular intervals for improved temperature control (the real water temperature in the circuit can always be measured periodically), with consequent energy savings.

Use parameter **PI22**: *Maximum pump off time in operation on call* to establish a maximum time for the pump to stay off after which it is forced on (so long as there are no shutdown alarms, and at maximum speed if modulating) for the minimum time defined in **PI03**: *Minimum pump on time*.

N.B.: the function is disabled in Stand-by

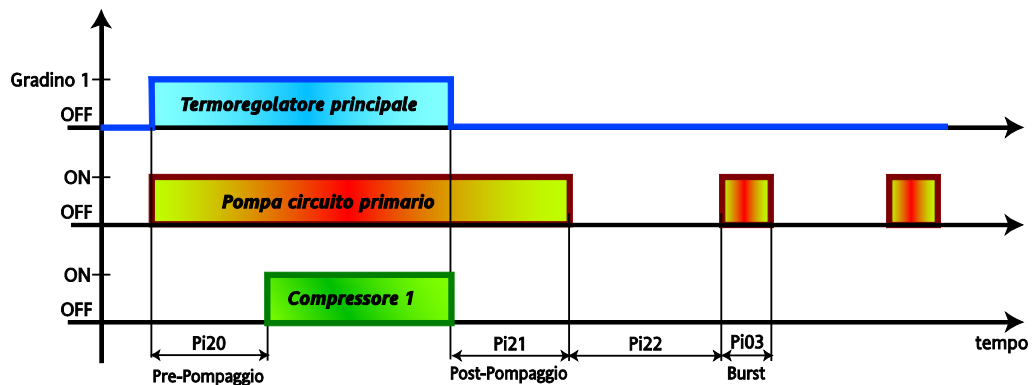

N.B.: the activation of the compressor could also be delayed by other safety timings, this means that the pre-pumping time could be longer (never shorter).



10.4 Pump anti-lock (anti-sticking) mode

This function prevents any mechanical faults due to extended disuse.

The anti-lock function is activated when:


- enabled by parameter (**PI01** - *Time primary circuit water pump not active for anti-lock* > 0). See **Table 3**
- It is always active except when OFF (local and remote) and on Stand-by (local and remote) unless an alarm switches off the pump

If the pump is off for a time equal to or greater than the value in parameter **Pi01**: *Time primary circuit water pump not active for anti-lock*, the controller forces it on (at maximum speed if modulating) for the time set in parameter **Pi03**: *Minimum water pump start time*.

Table 3

Antilock	Parameter	Description	value	
			0	>0
	PI01	<i>Time primary circuit water pump not active for anti-lock</i>	Function disabled	Function enabled
Diagram E	PI03	Minimum internal circuit water pump start time	Time in seconds x 10	

Diagram E Pump anti-lock

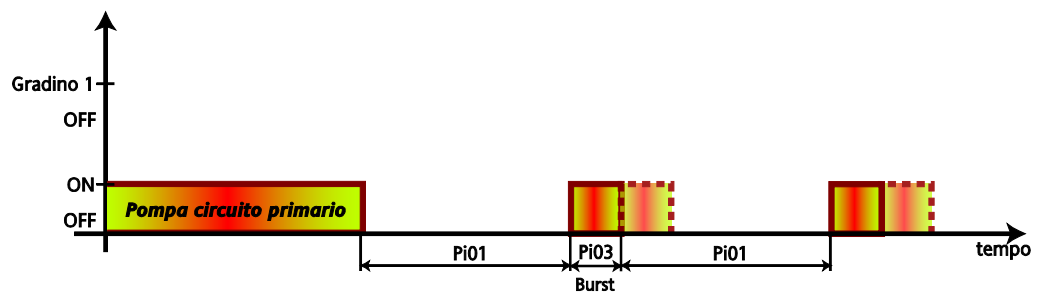

N.B.: the broken line indicates the second pump, if present



10.5 Antifreeze operation with pump

The antifreeze function runs when:


enabled by parameter **Pi50 - Select probe for internal circuit + water pump antifreeze.**

- See **Table 4**
- always active, except for OFF (local and remote) and Stdb (local and remote) unless alarms switch off the pump

Table 4 - Pi50

Value	Probe
0	No probe (pump in antifreeze disabled)
1	Internal exchanger water/air inlet temperature
2	Internal exchanger water/air outlet temperature
3	Circuit 1 internal exchanger water outlet temperature
4	Circuit 2 internal exchanger water outlet temperature
5	Circuit 1 and 2 internal exchanger water outlet minimum temperature
6	External temperature

Diagram F Antifreeze operation with pump

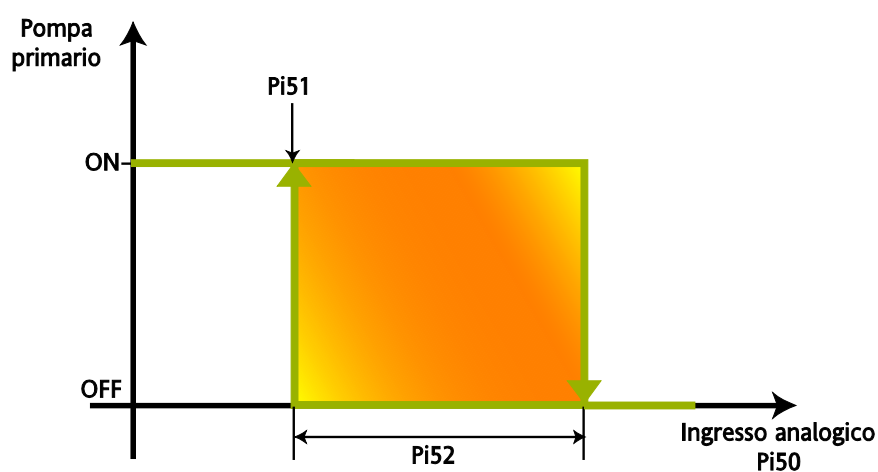

Parameter	Description
PI51	Primary circuit water pump regulator setpoint for anti-freeze
PI52	Primary circuit water pump regulator hysteresis for anti-freeze
Control sensor Pi50	Select probe for internal circuit + water pump antifreeze

N.B. If the probe selected for antifreeze with the internal circuit pump is in error, the machine is blocked.

11 VENTILATION FAN (FOLDER PAR/FI)

The recirculation fan parameters are visible and can be set up in folder **FI** (see User Interface and Parameters chapters).

The following must be configured:

- at least one digital output as recirculation fan using parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ±18**.

Enabling

The controller is enabled by setting parameter (**Fi00 - Select recirculation fan operation**) not equal to 0.

Table 1 – Parameter Fi00

	Parameter	Description	value		
			0	1	2
Enabling	Fi00	Select recirculating fan function	Recirculation fan disabled	Recirculation fan continuous operation	Recirculation fan operation on temperature controller call

General conditions of operation

- In **Off** the recirculation fan is immediately off (even when post-ventilation is underway).
- In **Standby** the fan is off, in accordance with established timings (e.g. post-ventilation). Note: the fan remains on until all of the compressors have been switched off.
- In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - In defrost, the recirculation fan is off (as per parameter **Fi03: Post-ventilation time in Heat**);
 - if at least one of the internal exchanger heaters is on, the fan is *forced* on (absolute priority); after the last heater has been turned off, parameter **Fi03: Post-ventilation time in Heat** applies;
 - if alarm **Er30: Primary circuit anti-freeze alarm**, is active, the fan is forced on;
 - the recirculation fan is immediately switched off in case of a blocking alarm (see alarms table).

11.1.1 Continuous operation

Case Fi00 = 1.

The digital output recirculation fan is always on except in the conditions specified in the general conditions of operation section.

11.1.2 Operation in response to request

Case Fi00 = 2.


Activation of the recirculation fan depends on the status of the compressors (not of the compressor temperature controller), of the temperature measured by the internal exchanger water/air inlet temperature probe, and the real temperature controller setpoint (Heat or Cool).

The fan is switched on only if at least one compressor is running and the exchanger inlet air temperature is adequate.

N.B. If the Internal exchanger water/air inlet temperature is in error (or has not been configured), recirculation fan activation depends exclusively on the compressor status.

11.1.2.1 Recirculation fan in Heating / Cooling

Control is dependent on the real setpoint as shown

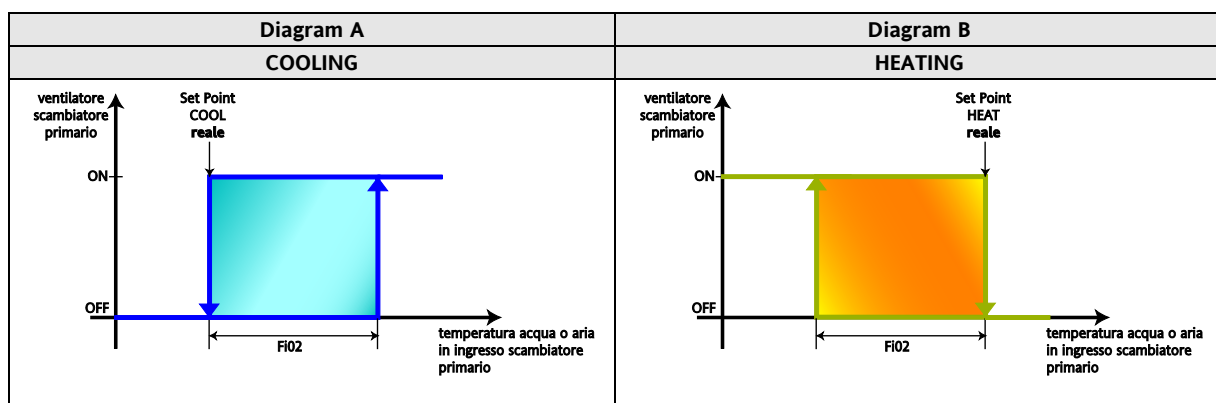

Parameter		Description
COOL	HEAT	
Fi01	Fi02	Recirculating fan regulator hysteresis in Cool / Heat
SetPoint		Real setpoint in Cool / Heat
Control sensor		Internal exchanger water/air inlet temperature

11.2 Post-ventilation

In Heat mode, the fan is switched off after a delay set in parameter **Fi03**: *Post-ventilation time in Heat* after the internal circuit integration heaters have been switched off.

This post-ventilation time allows the heat generated by the heaters to be dispersed, thus preventing damage or fire.

12 EXTERNAL EXCHANGER FAN (FOLDER PAR/FE)

The **SBA** controls (via digital outputs) the ventilation of the air condensation units of the two chiller/heat pump temperature control circuits.
Alternatively, it can control ventilation in a modulating mode via the analogue outputs.

The configurable outputs for digital pump control are relays, whereas in modulating operation they are the internal triac (for direct control) or the pulse outputs and the analogue outputs (indirect control).

External exchanger fan parameters can be viewed and configured in folder **FE** (see User Interface and Parameters sections).

The following must be configured:

- at least one digital output as external exchanger fan with parameters **CL90...CL97 / CL80-CL81** if digital / **CL61...CL63** if digital = ± 19 (circuit 1)/ ± 20 (circuit 2).

Enabling

The controller is enabled by setting parameter **FE00 - External exchanger fan mode selection** not equal to 0.

Table 1 – Parameter FE00

	Parameter	Description	value		
			0	1	2
Enabling	FE00	External exchanger fan mode selection	Ventilation disabled	Continuous operation (Always ON)	Operation on call (ON when compressor ON)

General conditions of operation

- In **Off** the fans are switched off immediately and always (even when the cut-off bypass is active).
- In **Stand-by** the fans are normally switched OFF; during the transition from On to Standby, the fans are switched off in accordance with their timings (e.g. bypass on cut-off in progress). If **FE11=2** the fans are active at the same time as the external exchanger heaters in antifreeze mode.
- In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - In **Defrost** the behaviour of the fans is governed by **FE11: Enable external exchanger fan special starts** (see below for details);
 - if the external exchanger heaters are on (or if at least one is on in the case of 2 heaters), the fans are activated if **FE11=2**. In the case of two circuits, the fans of both circuits are activated;
 - the external exchanger fans are switched off immediately in case of fan shut-down alarms (see alarms table).

Parameter		Description
COOL	HEAT	
FE30	FE50	Open system intercooler fan minimum speed in Cool / Heat
FE31	FE51	Open system intercooler fan average speed in Cool / Heat
FE32	FE52	Open system intercooler fan maximum speed in Cool / Heat
SetPoint		Real setpoint in Cool / Heat
Control sensor		External exchanger water/air inlet temperature

External exchanger fan on pick-up

The external exchanger modulating fans connected to the analogue outputs are switched on at maximum speed (relative to the current mode of operation) for a period given in parameter **FE01: External exchanger fan pick-up time**. After this time, the pump is run at the speed requested by the controller.

External exchanger fan control input

Control is achieved with the value of the analogue input configured with parameters **FE33: Select probe to regulate open system intercooler fan in Cool** and **FE53: Select probe to regulate open system intercooler fan in Heat**.

Parameters table **FE33** and **FE53**

Value	Description	Regulation
0	No probe	On or On/Off
1	External exchanger temperature (circuit 1 and 2)	Direct
2	High pressure input (circuit 1 and 2)	Direct
3	Low pressure input (circuit 1 and 2)	Inverse
4	External exchanger pressure (circuit 1 and 2)	Direct
5	Internal exchanger pressure (circuit 1 and 2)	Inverse
6	Internal exchanger water/air inlet temperature	Direct
7	Internal exchanger water/air outlet temperature	Direct

If the system has two circuits, the fans on the two external exchangers are controlled independently, on separate probes:
both circuits must have analogue inputs configured for this purpose.
If not, ventilation will always be active.
Analogue inputs for ventilation control

Description	UM
External exchanger temperature circuit 1	°C
External exchanger temperature circuit 2	°C
High pressure input circuit 1	Bar
High pressure input circuit 2	Bar
Low pressure input circuit 1	Bar
Low pressure input circuit 2	Bar
External exchanger pressure circuit 1	Bar
External exchanger pressure circuit 2	Bar
Internal exchanger pressure circuit 1	Bar
Internal exchanger pressure circuit 2	Bar
Internal exchanger water/air inlet temperature	°C
Internal exchanger water/air outlet temperature	°C

12.1.1 Continuous operation


Case **FE00** = 1.

Ventilation is activated, independently of the state of the compressors, on the basis of the value of the analogue input configured for control.

The parameter **FE21** - **External exchanger fan pre-ventilation time** must be set to 0

N.B.: If an analogue input is not configured or if the configured analogue input is in error, ventilation is always active (at maximum speed if modulating).

12.1.1.1 External exchanger fan digital control in Cool / Heat

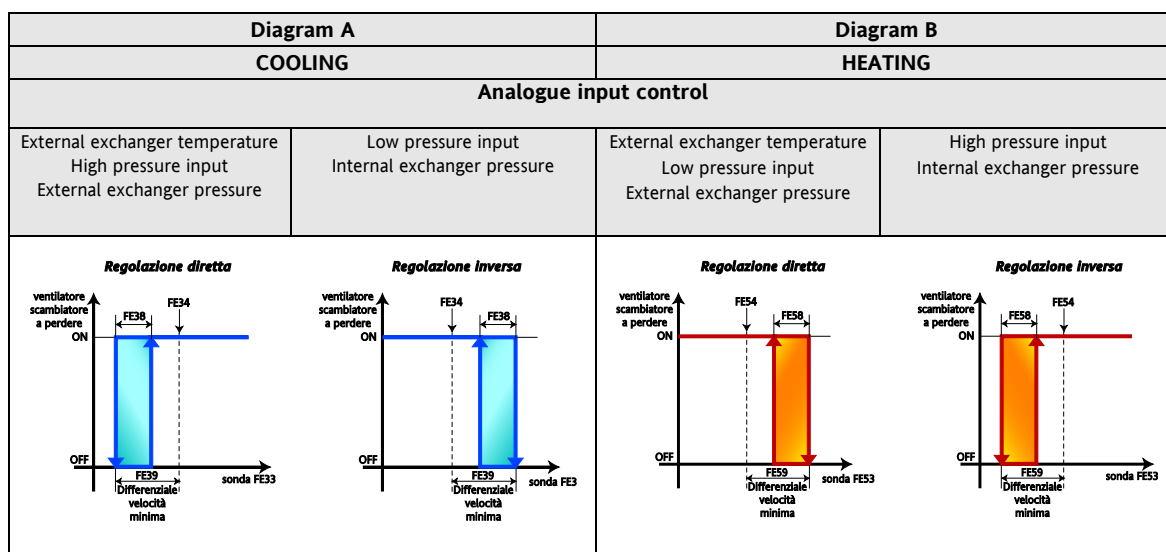

Parameter		Description
COOL	HEAT	
FE33	FE53	Select probe to regulate open system intercooler fan in Cool / Heat
FE34	FE54	Open system intercooler fan minimum setpoint speed in Cool / Heat
FE38	FE58	Open system intercooler fan hysteresis cut-off in Cool / Heat
FE39	FE59	Open system intercooler fan differential cut-off in Cool / Heat
Control sensor		External exchanger water/air inlet temperature

12.1.1.2 External exchanger fan analogue control in Cool / Heat



Analogue input control:

External exchanger temperature
High pressure input
External exchanger pressure circuit

Analogue input control:

Low pressure input
Internal exchanger pressure

COOL

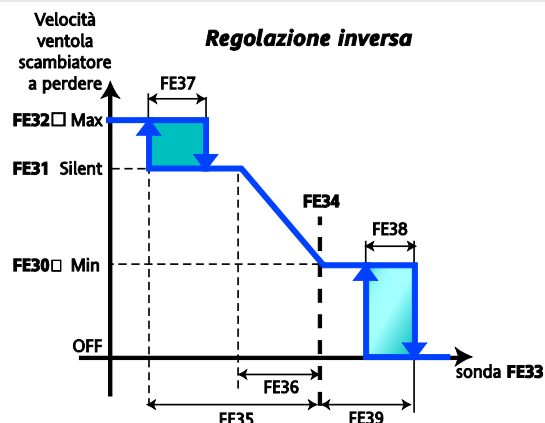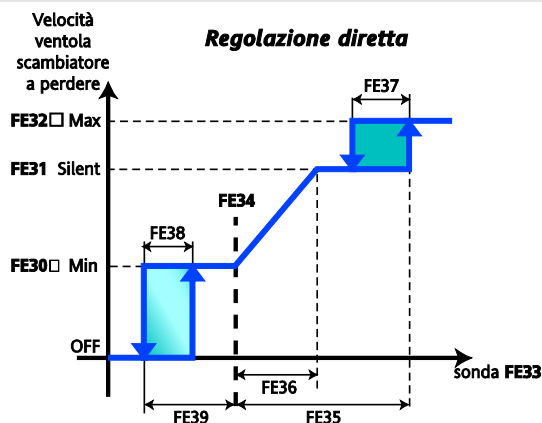



Analogue input control:

External exchanger temperature
Low pressure input
External exchanger pressure circuit

Analogue input control:

High pressure input
Internal exchanger pressure

HEAT

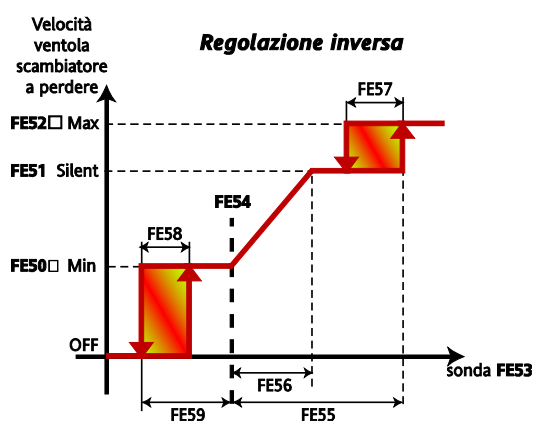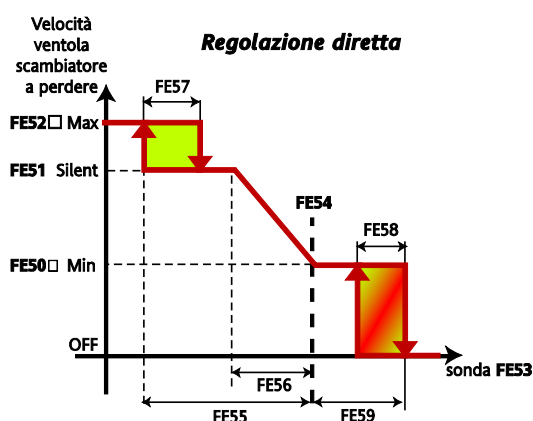

Parameter		Description
COOL	HEAT	
Control sensor		Select external exchanger fan control probe in Cool / Heat
FE33	FE53	
FE34	FE54	Open system intercooler fan minimum setpoint speed in Cool / Heat
FE35	FE55	Open system intercooler fan maximum speed differential in Cool / Heat
FE38	FE58	Open system intercooler fan hysteresis cut-off in Cool / Heat
FE39	FE59	Open system intercooler fan differential cut-off in Cool / Heat
Control sensor		Select external exchanger fan control probe in Cool / Heat

12.1.2 Operation in response to request

Case FE00 = 2.

Ventilation is activated, on the basis of the value of the analogue input configured for control and depending on the situation (e.g. fan start or shutdown), according to the state of the temperature controller or the compressors.

If the compressor inverter output is configured, the state of this output is considered as the compressor status (circuit 1 only).

N.B.: If an analogue input is not configured or if the configured analogue input is in error, Ventilation is activated only on the basis of the compressor status (at maximum speed if modulating).

12.1.2.3 External exchanger fan digital control in Cool / Heat

External exchanger fan control is activated at the moment in which the main temperature controller calls the first step of the temperature control circuit (to which the external exchanger belongs).

The compressor starts after the delay given in parameter **FE21**: *External exchanger fan pre-ventilation time*.


N.B.: activation of the compressor may also be delayed by the intervention of other safety times.

Furthermore, the digital outputs are controlled by parameter **FE34**: *Open system intercooler fan minimum setpoint speed in Cool* as for continuous operation, with the following exception: after the compressor is activated (i.e. the first compressor or the first power step in the specific circuit), for the time indicated by parameter **FE20**: *Cut-off open system intercooler fan bypass time*; the fans are forced on even if the controller is requesting cut-off.

Preventilation is used in Cool to prevent high temperatures on the exchanger when the compressor is switched on. The cut-off bypass prevents extreme temperatures on the exchanger.

N.B.: if there are alarms blocking the compressors, external exchanger fan control remains active even with the compressors off.

N.B.: The activation of the compressor could also be delayed by other safety timings, this means that the preventilation time could be longer (never shorter).

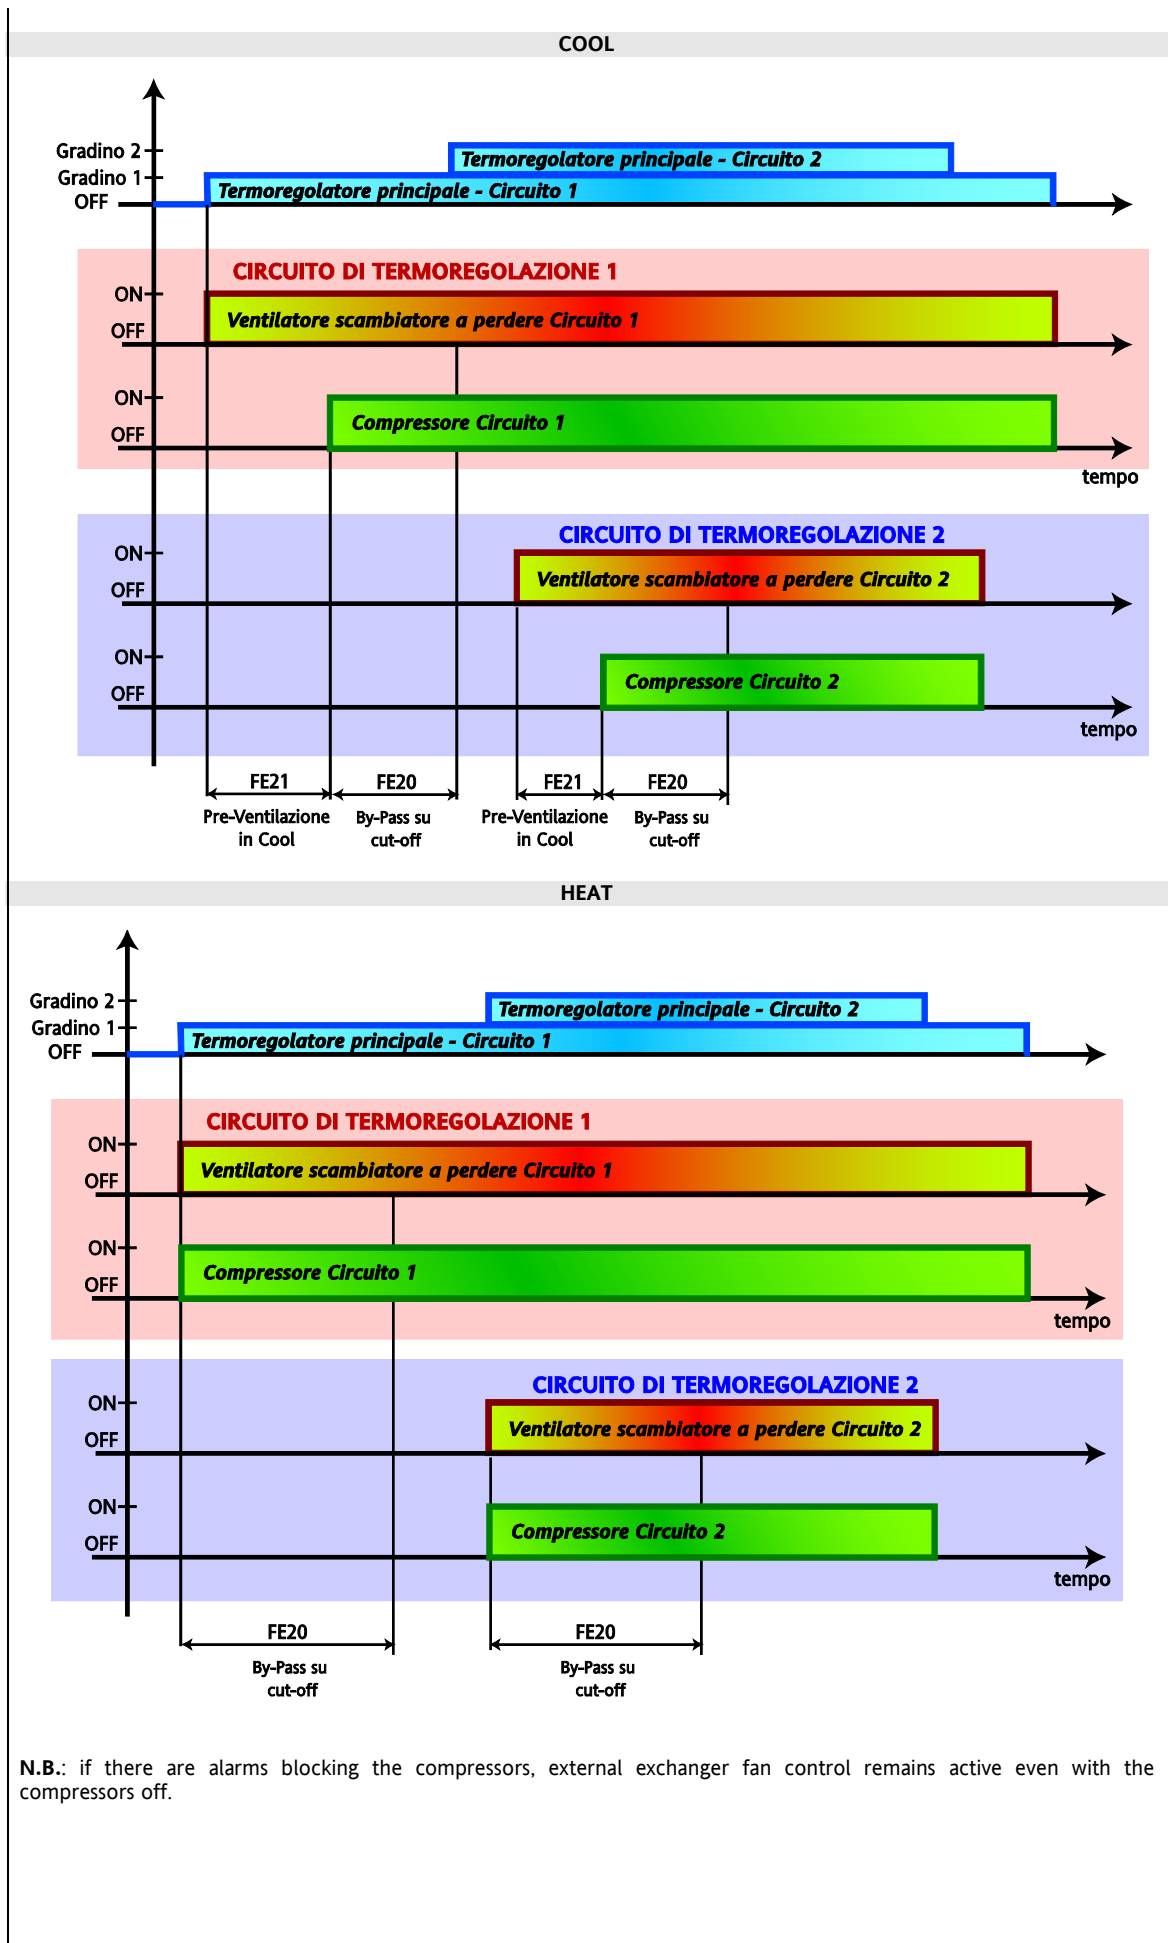

12.1.2.4 External exchanger fan analogue control in Cool

The analogue outputs are activated exactly as the respective digital outputs (with pre-ventilation and cut-off bypass) and are modulated, except for the cut-off bypass period (where the fans are activated at minimum speed if the controller requests cut-off), according to parameter **FE34**: *Open system intercooler fan minimum setpoint speed in Cool* as for continuous operation.

If there is no request for steps the fan is normally off.

12.1.2.5 External exchanger fan analogue control in Heat

The analogue outputs are activated exactly as the respective digital outputs (with cut-off bypass) and are modulated, except for the cut-off bypass period (where the fans are activated at minimum speed if the controller requests cut-off), according to parameter **FE54**: *Open system intercooler fan minimum setpoint speed in Heat* as for continuous operation.

If there is no request for steps the fan is normally off.

12.2 Fan control in defrost


Fan activation in defrost mode is useful because pressure at the external exchanger can reach alarm levels if the exchanger is not totally de-iced. To prevent a high pressure alarm in this situation, the fans are run (at minimum speed if modulating).

The behaviour of the external exchanger fan during defrost is determined by **FE11**: *Enable external exchanger fan on in defrost*, except for the *coil drainage* phase, in which the fans run at maximum speed.

If the machine has two temperature control circuits, the status of the fan is dependent on the defrost condition of its respective circuit.

On completion of defrosting the fan resumes operation as requested by its controller.

- If **FE11** = 0, the fan is forced off throughout defrosting.
- If **FE11** = 1, the fan is off or on at minimum speed (digital output active) depending on the analogue input configured for control of the fan in defrost and parameter **FE12**: *Open system intercooler fan switch on setpoint during defrost* in the following way:

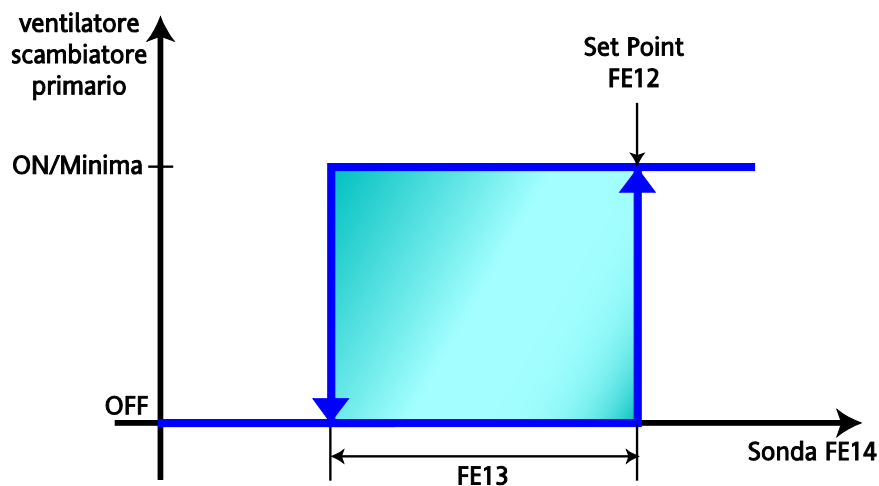

FE12: *Open system intercooler fan switch on setpoint during defrost*

FE13: *Open system intercooler fan switch-on hysteresis during defrost*

FE14: *Select probe to regulate open system intercooler fan during defrost*

Parameter table **FE14**

Value FE14	Description
0	No probe
1	External exchanger temperature (circuit 1 and 2)
2	High pressure input (circuit 1 and 2)
3	External exchanger pressure (circuit 1 and 2)

N.B.: if there are two temperature control circuits, each must have a probe configured for this purpose. If no analogue input is configured or if the configured input is in error, ventilation is always at minimum during defrost (maximum in coil drainage).

N.B.: at the end of defrost, the fans are switched on (at maximum speed if modulating) for the time set in parameter **dF23**: *Drip time*, before the reversing valve switches.

This controller provides more functionalities in managing modulating fans speed (external exchanger fans) during Defrost Fan speed)
Consider these parameters

FE30 - Minimum speed external exchanger fan in Cool
FE32 - Maximum speed external exchanger fan in Cool

Once the unit is reset the first time actually the minimum speed FE30 is currently used.
If the defrost ends for timeout (dF22 - Maximum defrost time) the minimum speed FE30 will be used as well.
If, however, the first defrost ends by reaching the temperature / pressure then in the next defrost the fan speed will be increased by an amount equal to $\frac{1}{4}$ of the difference between the two maximum and minimum speed (FE32 - FE30).

In the subsequent defrosting cycles, the fan speed defrost calculation will be:

- Each time the defrost will end up temperature. / Pressure, the speed will be increased by $(FE32 - FE30)/4$, up to a maximum corresponding to FE32;
- Each time the defrost will end, however, by duration, the speed will be decreased by $(FE32 - FE30)/4$, up to a minimum corresponding to FE30.

This method allows optimum defrosting of the heat exchanger, with the following settings:

- dF22 with the duration you set "ideal" / defrost waiting for complete defrosting
- end of defrost temperature / pressure situation is not common (not standard situation): this would not in fact have complete defrosting (eg for non-ideal positioning of the end defrost probe).

The described mechanism has the advantage of auto adapt quickly to environmental conditions and, moreover, does not require the processing of the historical data.

Exception is **FE10: Enable single condensation** = 1; in this case both circuits operate in parallel at the maximum output value of the two controllers for the two circuits.

12.3 Fan control with single condensation

Parameter **FE10: Enable single condensation** configures 2 circuit machines with single condensation.

- If **FE10** = 0 the two fans are independent and depend on the condensation pressure/temperature and the state of the compressors on the individual circuits.
- If **FE10** = 1 the 2 (in reality 2 digital and 2 analogue) external exchanger fan outputs operate in parallel at the maximum output value of the two controllers for the two circuits.

13 EXTERNAL CIRCUIT PUMP (FOLDER PAR/PE)

The parameters for the external circuit water pump can be viewed and configured in folder **PE**

At least one digital output must be configured as External Circuit Water Pump

Enabling

The external circuit water pump can be enabled by parameter (**PE00 - External circuit water pump mode selection**≠0)

Parameter	Description	value			
		0	1	2	3
PE00	Select external circuit internal circuit operation	Pump Disabled	Continuous operation (Always ON)	In response to a request from the temperature controller	Operation synchronised with external exchanger fans

On the basis of **PE00** the external circuit pump can operate

- continuously
- In response to a request from the temperature controller
- or in synchrony with the external exchanger fans.

General conditions of operation

- In **Off** the pump is always off.
- In **Stand-by** the pump is normally off; however, it is started together with the external exchanger heating elements in antifreeze mode (if **PE00**=1 or 2).
If **PE00**=3 the pump is started only if the external exchanger fans are started.
- In **On** the pump is always on if **PE00** = 1.
If **PE00**=2 the external circuit water pump is started on receiving a request from the temperature controller, unless the compressors are locked (for example due to alarms). In this case the pump turns off even if a request has been received from the temperature controller.
If **PE00**=3 the External Circuit Water Pump output is activated "in parallel" to the external exchanger heaters: e.g. the pump is activated if the external exchanger fan is activated (single-circuit systems), or if at least one of the two fans is activated (dual-circuit systems).

N.B.:

- The pump is immediately switched off in the event of boiler lock alarms (see alarms table).
- If an automatic reset flow switch alarm occurs, the pump is kept on to allow it to be reset; if the alarm becomes manual reset, the pump is switched off.
- The minimum time between the pump switching off then switching back on again is fixed and set at 10 seconds.

13.1 Working modes

13.1.1 Continuous operation

Case **PE00** = 1.

See **General conditions of operation**

13.1.2 In response to a request from the temperature controller

Case **PE00** = 2.

See **General conditions of operation**


In addition

- The compressor is switched on with a set delay (**PE02**) after the internal circuit water pump switches on.
- The internal circuit water pump is switched off with a delay (**PE03**) after the temperature controller enters the OFF state or after machine standby.

Table 2 (section PI02-PI03)

Parameters	Description
PE02	External circuit pump switch-on - compressor switch-on delay
PE03	Compressor switch-off - external circuit pump switch-off delay

Diagram A

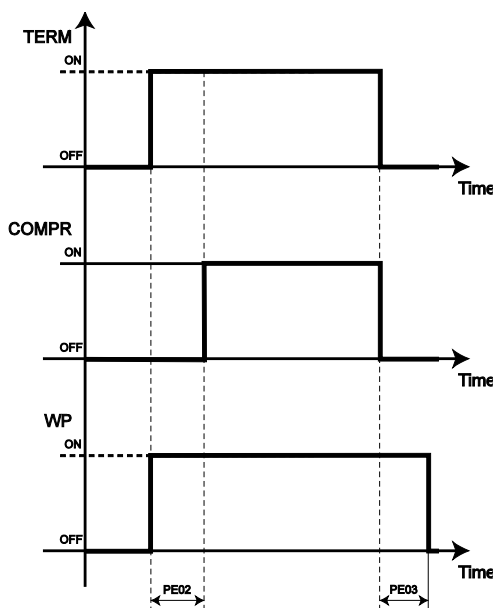

TERM: temperature controller	COMPR: compressor
WP: external circuit water pump	Time: time in seconds
PE02: External circuit pump switch-on - compressor switch-on delay	PE03: Compressor switch-off - external circuit pump switch-off delay

13.1.3 Operation synchronised with external exchanger fans

Case **PE00** = 3.

See **General conditions of operation**

The External Circuit Water Pump output is activated “in parallel” with the external exchanger heaters: i.e. the pump is activated if the external exchanger fan is activated (single-circuit systems), or if at least one of the two fans is activated (dual-circuit systems).

13.2 Pump anti-lock (anti-sticking) mode

This function prevents any mechanical faults due to extended disuse.

The anti-lock function is activated when:

- it has been enabled via parameter (**PE04** - *External circuit water pump OFF time for antilock* = 1). See **Table 3**
- It is always active except when OFF (local and remote) and on Stand-by (local and remote) unless an alarm switches off the pump


If the pump is off for a time equal to or greater than the value in parameter **PE05**: *External circuit water pump OFF time for antilock*, the controller forces it on (at maximum speed if modulating) for the time set in parameter **PE06**: *External circuit water pump ON time for antilock*.

See **Table 3** and **diagram B**

Table 3, parameter PE04..PE06

Anti-lock	Parameter	Description	value	
			0	1
	PE04	External circuit water pump antilock function enabling	Function disabled	Function enabled
Diagram B	PE05	External circuit water pump OFF time for antilock	Time in hours	
	PE06	External circuit water pump ON time for antilock	Time in seconds	

Diagram B Pump anti-lock

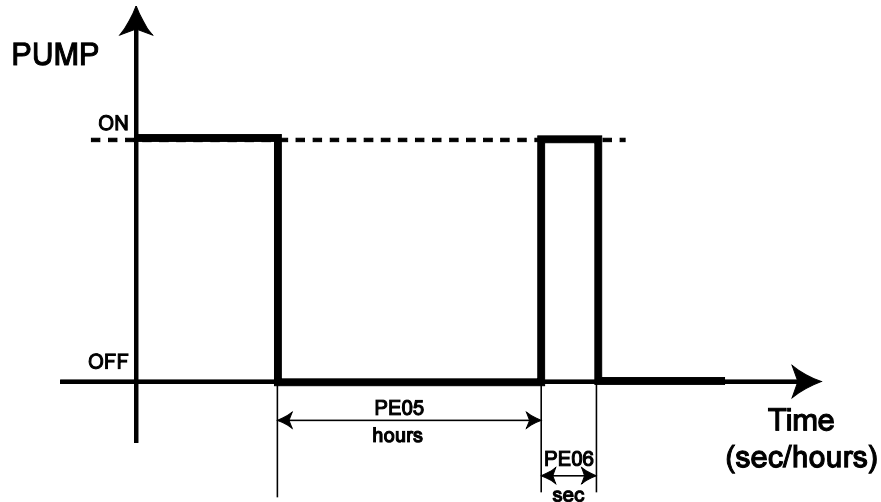

N.B.: PE05 is in hours, PE06 is in seconds

13.3 Antifreeze operation with pump

The antifreeze function runs when:

- enabled via parameter (PE07 – Antifreeze function enabling with external circuit water pump = 1). See table 4
- always on in any machine operating state except local or remote OFF, unless alarms block the pump

To ensure efficient operation of the pump, the following must be configured correctly:


- an analogue input, configured as NTC external temperature input
- a digital or analogue output, configured as pump

Table 4 parameters PE07...PE09

	Parameter	Description	value	
			0	1
	PE07	Antifreeze function enabling with external circuit water pump	Function disabled	Function enabled
Diagram C	PE08	External circuit water pump set point control for antifreeze		
	PE09	External circuit water pump hysteresis control for antifreeze		

- The pump is running if External circuit exchanger water temperature < PE08
- The pump is running if External circuit exchanger water temperature > PE08+PE09.

Diagram C - antifreeze function with pump

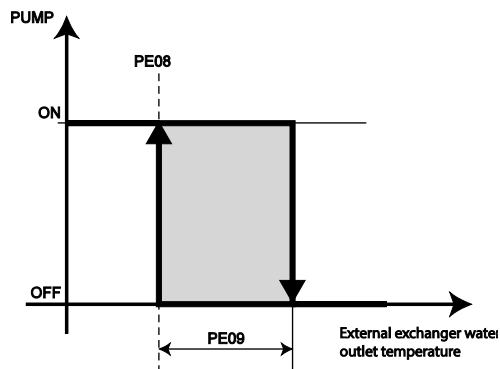

14 INTERNAL EXCHANGER ELECTRICAL HEATERS (FOLDER PAR/HI)

The **SBA600** controls internal exchanger heaters 1 and 2, which act both for the antifreeze function (typically in machines with water-type internal exchanger) and integration for the heat pump/heating function (air and water).

The parameters for the internal exchanger heaters can be viewed and set in folder HI: Internal exchanger electrical heater parameters (see User interface and Parameters chapters).

The anti-freeze/integration heaters must be connected to a relay output(°) DO1..D04, D06 (see table).

- They are active only if the corresponding enabling parameter HI00, HI02=1 (see table)

(°) The heater control outputs are all and exclusively those outputs with ON/OFF control.

The heaters can be used in a variety of ways depending on the type of system. We can have one or two internal exchangers and one or two circuits.

In the case of a single exchanger on a single/double circuit: in antifreeze, defrost and integration the heaters are controlled equivalently.

In the case of a double exchanger on a double circuit: in antifreeze and defrost the two heaters are controlled differently according to the variables of the relevant cooling circuit; in integrated use they are controlled equivalently.

For greatest configurability:

- the number of antifreeze heaters and integration heaters can be set independently;
- the control analogue output can be determined individually;
- the heaters (1 or 2) can be used only for antifreeze, only for integration/heating, or for both functions at the same time.

Heaters	Parameter	Description	value	
			0	1
Antifreeze (Standby mode)	HI00	Enable internal exchanger heater regulator in standby for antifreeze	Heaters disabled	Heaters enabled
See Heaters in defrost paragraph	HI01	Enable force heaters on during defrost	See parameters table Hi01	
Antifreeze	HI10	Select probe for antifreeze internal exchanger + heater 1	See parameters table Hi10 and Hi11	
Antifreeze	HI11	Select probe for antifreeze internal exchanger + heater 2		
Integrated use	HI20	Enable integrated use of internal exchanger heaters	See parameters table Hi20	

14.1 Internal antifreeze heater

Enabling

The two internal exchanger antifreeze heaters are enabled with parameters



- **HI10 - Select probe for antifreeze internal exchanger + heater 1**
- **HI11 - Select probe for antifreeze internal exchanger + heater 2**

General conditions of operation

- In Off the internal exchanger antifreeze heaters are immediately and always off.
- In Stand-by the internal exchanger antifreeze heaters are active if so set in parameter **Hi00: Enable internal exchanger antifreeze heaters in standby**.
- In On, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - In Defrost the internal circuit heaters are controlled by parameter **Hi01: Enable force heaters on during defrost**. See dedicated paragraph
 - The internal circuit heaters are immediately turned off during heater block alarms (see alarms table).

N.B.: There are no safety times for heater on/off

14.1.1 Internal circuit antifreeze heater control

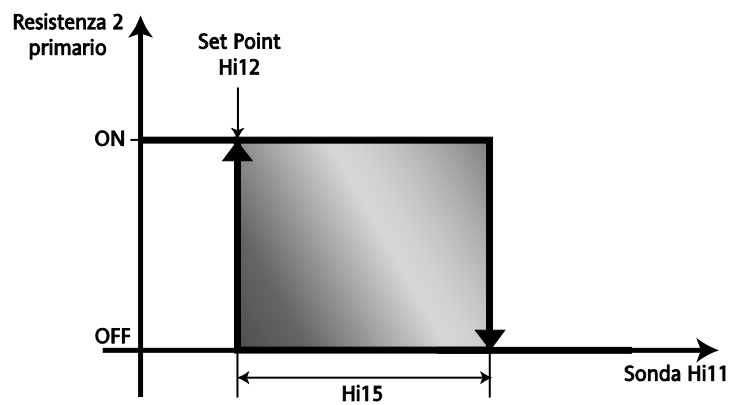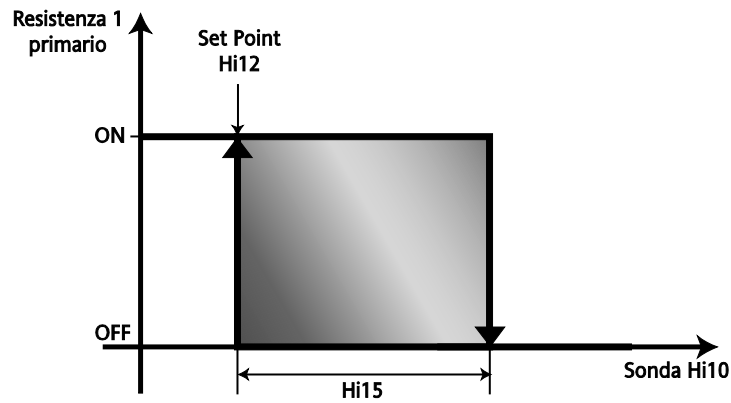

Parameter	Parameter	
Control sensor	Hi10	Select probe for antifreeze internal exchanger + heater 1
	Hi11	Select probe for antifreeze internal exchanger + heater 2
SetPoint	Hi12	Primary intercooler heaters regulator setpoint for anti-freeze
	Hi13	Primary intercooler heaters regulator maximum setpoint for anti-freeze
	Hi14	Primary intercooler heaters regulator minimum setpoint for anti-freeze
Hysteresis	Hi15	Primary intercooler heaters regulator hysteresis for anti-freeze

Parameters table Hi10 and Hi11

Value Hi10 / Hi11	Probe
0	No sensor (antifreeze heater disabled)
1	Internal exchanger water/air inlet temperature
2	Internal exchanger water/air outlet temperature
3	Circuit 1 internal exchanger water outlet temperature
4	Circuit 2 internal exchanger water outlet temperature
5	Circuit 1 and 2 internal exchanger water outlet minimum temperature

N.B.: depending on settings, the heaters can be turned on together (using the same probe) or separately (using different probes).

N.B.: In case of control probe error, the machine is blocked

14.2 Configuration of integration heaters

Enabling

With parameter **Hi20**: *Select heater mode for internal exchanger in integration mode* to activate the regulator for heaters in integration mode.

Either 1 or 2 heaters will be controlled, depending on the value of parameter **Hi26**: *Primary intercooler heater 2 switch-on setpoint differential in integration*: 1 heater if **Hi26** = 0, 2 heaters if **Hi26** ≠ 0.

General conditions of operation

- In Off the compressors are switched off immediately and always.
- In Stand-by the integration heaters are switched off immediately and always (note that since there are two controllers on the same heaters, the same heaters may stay on in Standby if so required by the antifreeze heater controller).
- In On, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself).
- In *Defrost* the internal circuit heaters are controlled by parameter **Hi01** *Enable force heaters on during defrost*. See dedicated paragraph.
- The internal circuit heaters are immediately turned off during heater block alarms.
- In DHW mode regulation occurs on the *real* DHW setpoint in place of the *real* Heat setpoint.
- In Anti-Legionnaire's Disease DHW mode regulation occurs on the DHW setpoint for Anti-Legionnaire's Disease instead of the *real* Heat setpoint.

Operating mode

The integration heaters are active only in Heat mode; regulation is based on the setpoint obtained by *subtracting* a differential from the *real* Heat setpoint.

This differential can be calculated in a variety of ways by configuring parameter **Hi20**: *Select heater mode for internal exchanger in integration mode*

Parameter table **Hi20**

Value Hi20	Description
0	Integration heaters disabled
1	Integration heaters with setpoint differential proportional to external temperature
2	Integration heaters with setpoint differential in steps on external temperature
3	Integration heaters with setpoint differential fixed

14.2.1 Integration heater differential

The integration heater regulation setpoint is calculated by subtracting a differential from the real Heat setpoint


$$\text{Integration heater setpoint} = \text{real Heat setpoint} - \text{integration heater differential}$$

The Integration Heater Differential is calculated in a variety of ways: proportional, step, or fixed.

N.B.: When the heat pump is blocked, the differential for heaters in integrated use assumes a fixed value equivalent to the value of parameter **Hi23**: *Heater differential in integration mode with heat pump lock*. This serves to better control the power steps of the integration heaters in special circumstances.


Integration heaters with differential setpoint proportional to external temperature

Case **H20** = 1.

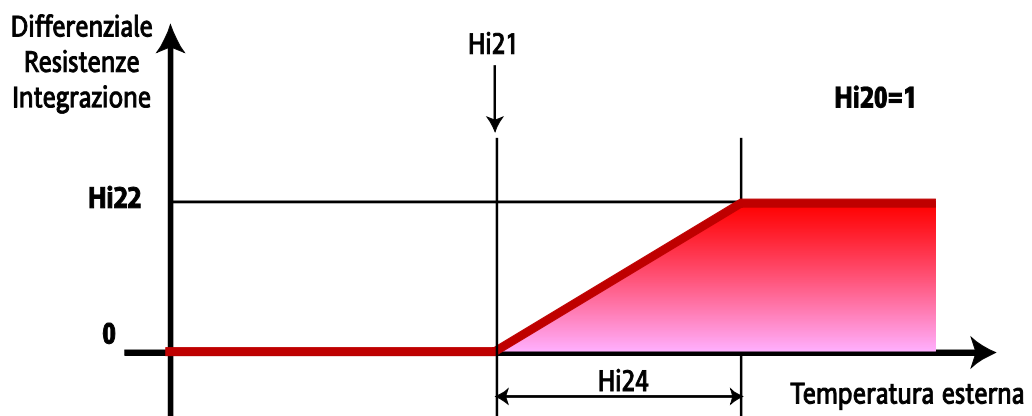

Parameter	Parameter	
Control sensor	//	External temperature
SetPoint	Hi21	Primary intercooler heaters dynamic differential setpoint in integration
	Hi22	Primary intercooler heaters maximum dynamic differential in integration
	Hi24	Primary intercooler heaters dynamic differential proportional band in integration
Hysteresis	//	

Integration heaters with differential in steps on external temperature
Case **Hi20 = 2**.

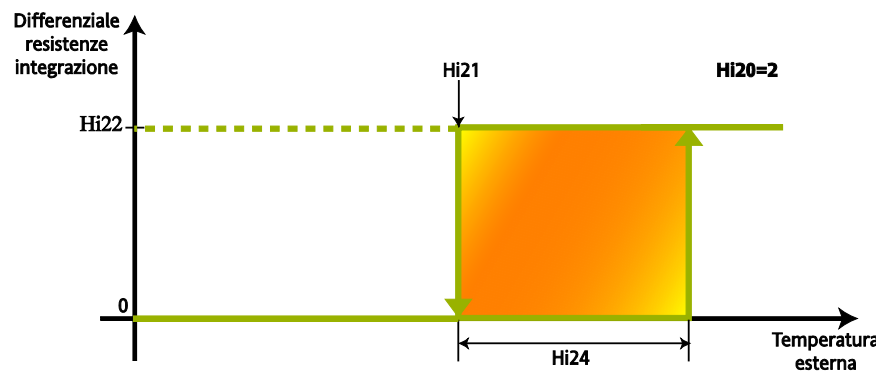

Integration heater differential fixed, independent of external temperature
Case **Hi20 = 3**.



N.B.: In case of error or lack of configuration of the external probe, the differential value is set to fixed values **Hi22** or **Hi23** depending on circumstances.


14.2.2 Integration heater regulation

Regulation uses the integration heater setpoint calculated with the integration heater differential as explained in the preceding paragraph. The expression step here refers to activation of internal exchanger heater 1 or 2. The analogue input used for regulation is the main temperature controller probe for Heat mode.


Depending on the value of **Hi26: Primary intercooler heater 2 switch-on setpoint differential in integration** it can be decided whether or not to activate the second heater in integration.

N.B.: if activating both heaters "simultaneously" is of interest (using two outputs to keep the thermal cut-outs separate), simply award a small value to **Hi26** although a value other than 0 and greater than hysteresis Hi25 (hysteresis cannot be larger than the differential value, otherwise the hysteresis value considered will coincide with the differential value).

With **Hi26** different from 0

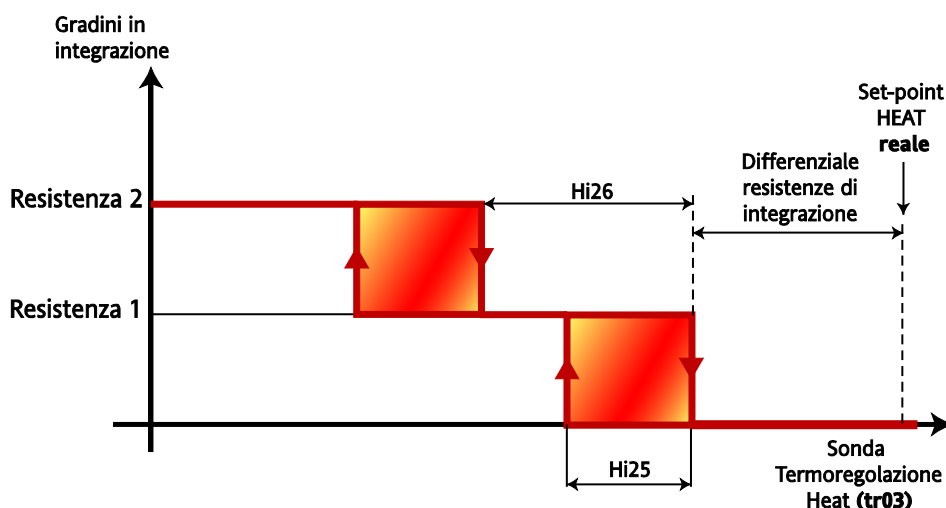

With **Hi26** = 0

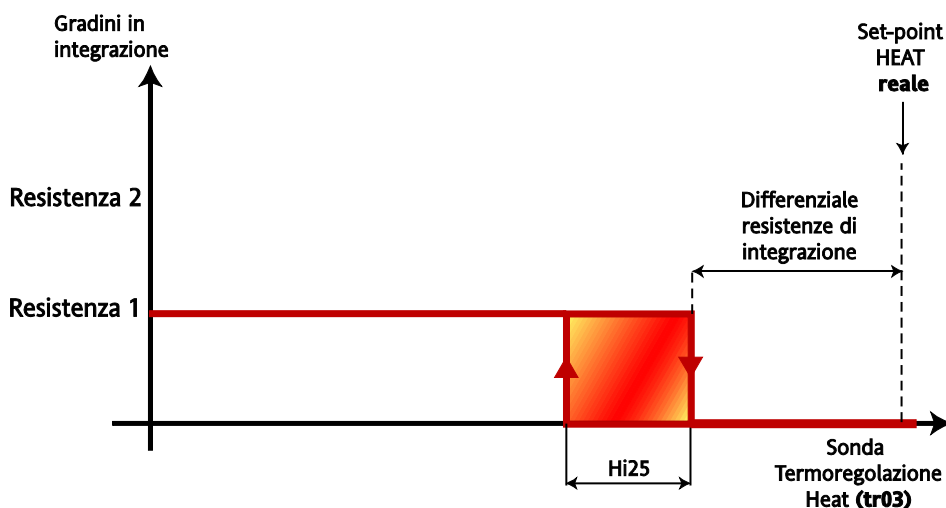

Parameter	Parameter	
Control sensor HEAT	tr03	Select temperature control probe in Heat
SetPoint	//	Integration heater setpoint
Hysteresis	Hi25	Primary intercooler heaters regulator hysteresis in integration
	Hi26	Primary intercooler heater 2 switch-on setpoint differential in integration

14.3 Heaters in defrost mode

Parameter **Hi01**: *Enable force heaters on during defrost* determines the operation of the internal exchanger heaters during defrost and dripping.
One or both of the heaters can be forced on, or heater 1 can be linked to defrosting circuit 1 and heater 2 to circuit 2.

Parameter table **Hi01**

Value	Description
0	Free operation (no forcing)
1	Heater 1 forced on
2	Both heaters forced on
3	Heater 1 forced on for defrost circuit 1, heater 2 for defrost circuit 2 (double exchanger)

N.B. For cases with values 1 and 2, the heaters are switched on if at least one of the two circuits is in defrost or drip status (typically used in case of single exchanger).

15 EXTERNAL EXCHANGER ELECTRICAL HEATERS (FOLDER PAR/HE)

The external exchanger heater parameters can be viewed and modified in folder **HE** (see User Interface and Parameters chapters).

The following must be configured

- at least one digital output as external exchanger 1 heater with parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ± 25 .**
- at least one digital output as external exchanger 2 heater with parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ± 26 .**

See chapter System configuration (folder PAr/CL-Cr-CF) / Configuration of digital outputs

The **SBW600** controls external exchanger heaters 1 and 2 with antifreeze function (as heat pumps with water external exchanger).

The heater control outputs are all and exclusively those outputs with ON/OFF control.

The heaters can be used in a variety of ways depending on the type of system. We can have one or two external exchangers (one or two circuits).

For greatest configurability:

- the number of antifreeze heaters can be set
- the control analogue output can be determined individually

Enabling

The external exchanger heater 1 antifreeze probe is enabled and selected with parameter **HE10 - Select probe for antifreeze external exchanger + heater 1.**

The external exchanger heater 2 antifreeze probe is enabled and selected with parameter **HE11 - Select probe for antifreeze external exchanger + heater 2.**

General conditions of operation

- In **Off** the external exchanger antifreeze heaters are immediately and always off.
- In **Standby** the external exchanger antifreeze heaters are active if so configured with (**HE00 - Enable external exchanger antifreeze heaters in Standby**).
- In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - The external circuit heaters are immediately turned off during heater block alarms


N.B.: There are no safety times for heater on/off.

Table A - external exchanger heater parameters

heaters	Parameter	Description	value				
			0		1		
External exchanger (Standby mode)	HE00	Enable external exchanger antifreeze heaters in standby	Heaters disabled		Heaters enabled		
Heaters	Parameter	Description	value				
			0	1	2	3	4
External exchanger Enable heater 1	HE10	Select probe for antifreeze external exchanger + heater 1	No sensor (antifreeze heater disabled)	External exchanger average temperature inlet circuit 1 and 2	Recovery (or external) exchanger water temperature	Recovery (or external) exchanger water outlet temperature	External temperature
External exchanger Enable heater 2	HE11	Select probe for antifreeze external exchanger + heater 2					
Heaters	Parameter	Description	value				
External exchanger	HE12	Open-system intercooler heaters switch-on setpoint for anti-freeze	Range defined by parameters HE14 ... HE13 Hysteresis defined by parameter HE15				

External exchanger heaters

Regulation occurs as shown in the diagram:

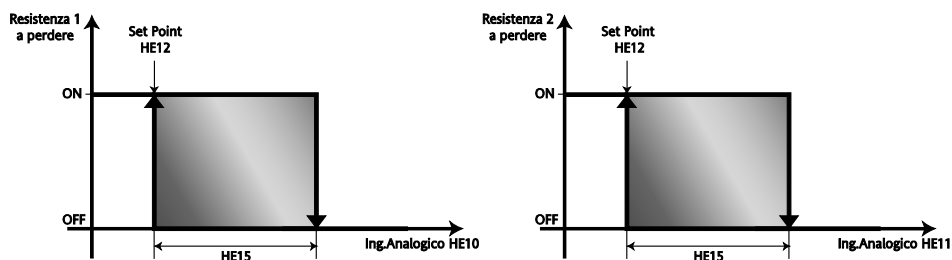

HE10	Analogue input – see table A
HE11	Analogue input – see table A
HE12	Setpoint - see table A
HE13	Primary open-system intercooler heaters regulator maximum setpoint for anti-freeze
HE14	Primary open-system intercooler heaters regulator minimum setpoint for anti-freeze
HE15	Open-system intercooler heaters regulator hysteresis for anti-freeze

N.B.: depending on the settings, the heaters can be turned on together or separately.

N.B.: In case of control probe error, the machine is blocked.

16 AUXILIARY OUTPUT (FOLDER PAR/HA)

Auxiliary output parameters can be viewed and configured in folder **HA** (see User Interface and Parameters chapter).

The following must be configured

- at least one digital output as Auxiliary Output with parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ± 32** .

The auxiliary output controller can be used, for example, to control heaters in machines with air condensation to evaporate the condensation water.

Enabling

The parameter (**HA00 - Select probe for auxiliary output regulator**) is used to enable the auxiliary output regulator.

Table A - meaning of parameter HA00:

Value HA00	Probe
0	No probe (auxiliary output disabled)
1	External temperature
2	External exchanger temperature circuit 1
3	External exchanger temperature circuit 2
4	External exchanger inlet water temperature
5	External exchanger outlet water temperature
6	NOT USED


General conditions of operation

- In **Off**, the auxiliary output is always switched off immediately.
- In **Standby**, the auxiliary output is always switched off immediately.
- In **On**, as well as the main regulation function specified in the paragraphs below, the following situation is also possible (with priority over the main regulation): the auxiliary output is always switched off immediately when it is subject to a blocking alarm.

N.B.: There are no safety times for the switching on and off of the auxiliary output.

Auxiliary heaters

Regulation occurs as shown in the diagram:

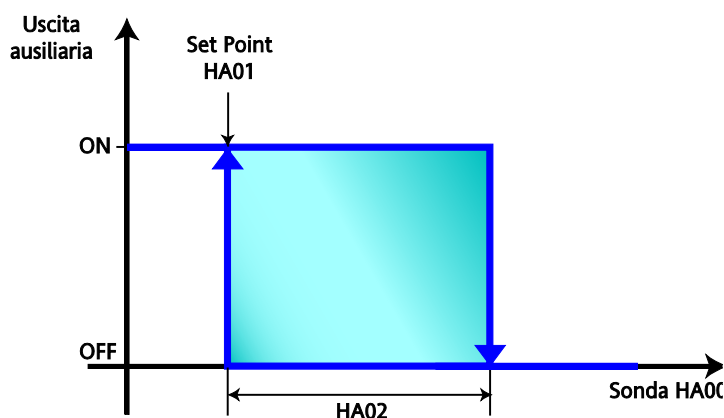

Parameter	Description
HA00	Control probe – see table A
HA01	Auxiliary output regulator setpoint
HA02	Auxiliary output regulator hysteresis
Auxiliary output	Auxiliary output

N.B.: In case of probe error, the machine is blocked.

16.1.1 Auxiliary output regulation conditional on defrosting

Regulation of the defrosting conditional auxiliary output is the same as regulation of the normal auxiliary output, except for the fact that it is activated only at the start of a defrost cycle (either of the two possible circuits) and it is forced to off after a time equal to 3 times parameter **df22- Maximum defrost time**.

17 BOILER (FOLDER PAR/BR)

Via a suitably configured digital output device **SB600** controls the pump or the permissive signal for a water heater or boiler to supply hot water which can be used for heating or as a back-up for the heat pump (hot water).
The device also controls a second digital output, which is delayed with respect to the primary digital output.

The configurable outputs to pilot the boiler are all of and only the outputs with ON/OFF piloting.

Device SA600 also controls an analogue output (value = ± 58)

There are different types of system hence different ways of using the boiler, especially in domestic applications.

17.1 Boiler configuration

The boiler is used as a heating power step for both the chiller and the heat pump.
Combined with the integration/heating heaters and the compressors (in heat pump mode) it produces hot water on the internal circuit.

For maximum configurability, the boiler and other component parameters can be set separately. This makes it possible to determine when to use the boiler power step for heating and when to inhibit it.

In both heating and integration modes, the boiler setpoint can be set as a differential (fixed or proportionally variable depending on the ambient temperature) with respect to the *real* setpoint in heating mode.

N.B. Normally, when there is no heat pump (heating mode), the differential is set as fixed and to zero (the regulation setpoint coincides with the real heat mode setpoint).

N.B.: by setting the *Water heater maximum dynamic differential* to 0, the setpoint coincides with the real heating setpoint.

Enabling

With parameter **br00**: *Select boiler mode* different from zero to enable the water heater regulator.

General conditions of operation

- In **Off** the boiler is switched off immediately and always.
- In **Stand-by** the boiler is switched off immediately and always.
- In **On**, as well as the main regulation function specified in the paragraphs which follow, the following situation is also possible (*with priority* over the main regulation).
- The boiler is turned off immediately in case of boiler lock alarm (see alarms table).
- In Domestic Hot Water mode the boiler regulates in relation to the *real* DHW setpoint instead of the *real* Heat setpoint.
- In ACS for Anti-Legionnaire's Disease mode, the boiler regulates on the Sanitary Water setpoint for Anti-Legionnaire's Disease instead of the *real* Heat setpoint.

N.B.: There are no safety times for boiler on/off.

Operating mode

The boiler regulator is active only in Heat mode; regulation is based on the setpoint obtained by subtracting a differential from the *real* Heat setpoint.

The boiler differential can be calculated in several ways, selectable by configuring the parameter *Select Boiler Mode* **br00**.

Table for parameter **br00**:

Value br00	Description	
0	Boiler disabled	
1	Boiler with differential Setpoint proportional to external temperature	Diagram A
2	Boiler with differential Setpoint in steps dependent on external temperature	Diagram B
3	Boiler with differential Fixed setpoint	Diagram C

17.1.1 Boiler differential

Boiler regulation is performed on a setpoint calculated by *subtracting* a differential from the real Heat setpoint.


Boiler setpoint = real Heat setpoint – Boiler differential

In case of heat pump block, the Boiler differential assumes the fixed value of parameter **br03**: *Boiler dynamic differential with heat pump lock* This serves to improve the control of the boiler power step in special cases.

Boiler differential setpoint proportional to external temperature

Example **br00= 1**

Diagram A

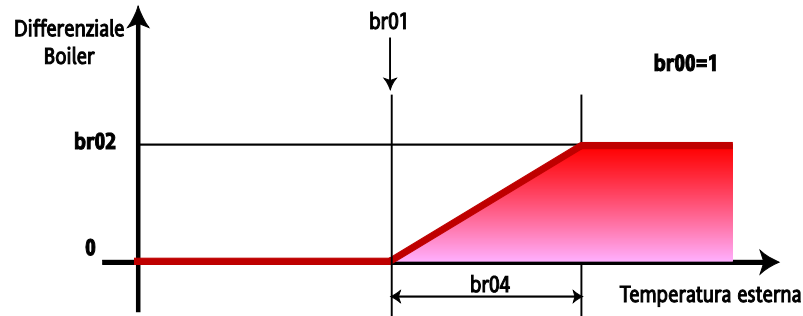


Parameter	Parameter	
Control sensor	//	External temperature
Setpoint	br01	Boiler dynamic differential setpoint
	br02	Maximum boiler dynamic differential
	br04	Boiler proportional band dynamic differential

Boiler differential in steps as a function of external temperature

Example **br00 = 2**

Diagram B

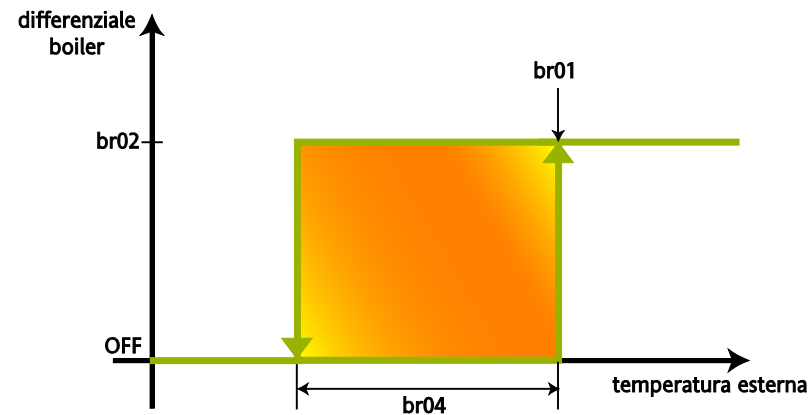


	Parameter	
Control sensor	//	External temperature
Setpoint	br01	Boiler dynamic differential setpoint
	br02	Maximum boiler dynamic differential br02
	br04	Boiler proportional band dynamic differential
Hysteresis	br05	Boiler regulator hysteresis

Boiler differential fixed, independent of external temperature

Example **br00= 3**


Diagram C

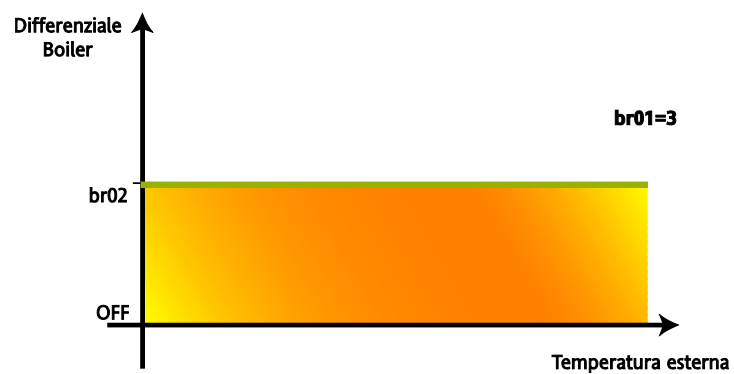

N.B.: In case of error of the external probe, the differential value is set to br02 or br03 (both fixed) depending on circumstances.


17.1.2 Boiler regulation

The regulation uses the Boiler setpoint calculated with the boiler differential as explained in the previous paragraph.

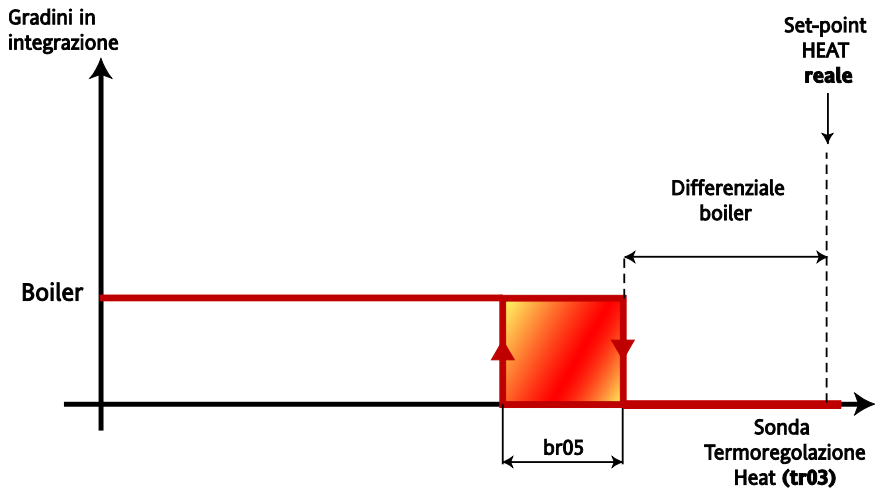

	Parameter	
Boiler differential	br00	See Boiler differential section
HEAT regulator probe	tr03	Select temperature control probe in Heat
Setpoint	//	Boiler setpoint
Hysteresis	br05	Boiler regulator hysteresis


In parallel, an analogue output can be activated on the boiler, which will be modulated as follows:

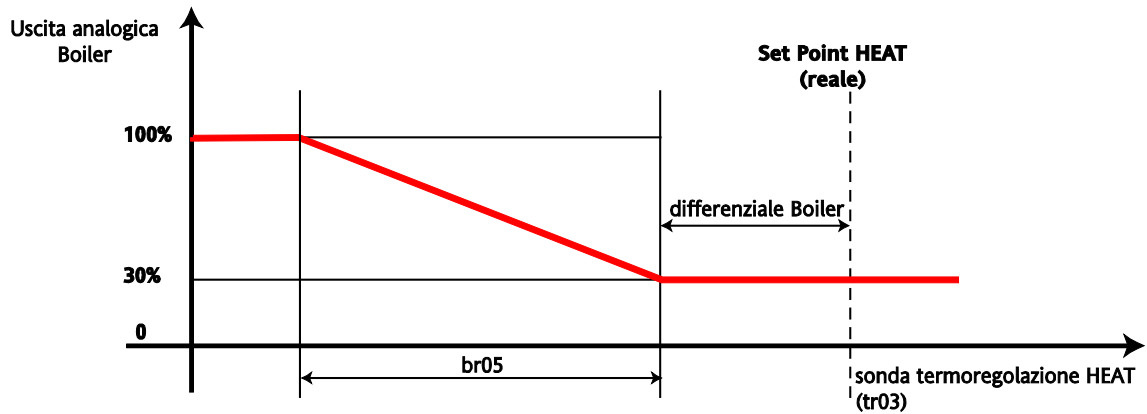

17.1.3 Boiler regulation, second digital output

The second digital output is delayed by 120 seconds (value cannot be changed) with respect to the primary digital output; this output can be used for a second pump or to enable a second boiler, or if it is necessary to pilot both a valve in the water circuit and a delayed enable signal to the boiler.

As explained below, the second output is not activated if the first remains active for less than 120 seconds; the second output is turned off (whether for regulation or for alarms or other reasons) at the same time as the first.

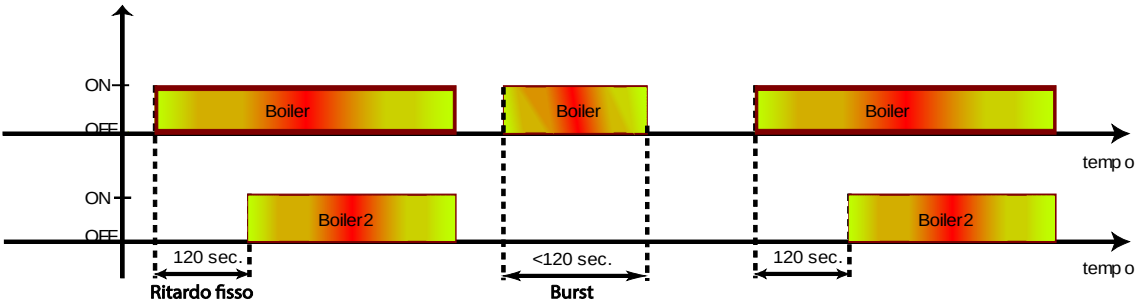

18 DEFROST (FOLDER PAR/DF)

Defrost parameters can be viewed and configured in the **df** folder (see User Interface and Parameters sections).

Defrosting is only possible in HEAT mode.

It is used to prevent ice from forming on the surface of the external exchanger.

Ice builds up on the external exchanger more often as a result of cold external air containing a high degree of humidity. This considerably reduces the thermodynamic efficiency of the machine and can also result in damage to the machine itself.

Enabling

Defrosting is enabled if:

- it is enabled via parameter (**df00 - Select defrost mode = 1,2**)

Parameter table **df00**

Value	Description
0	Defrosting disabled
1	Simultaneous defrost (only for dual-circuit systems)
2	Independent defrost (for single circuit systems and double circuit systems with separate condensation)

General conditions of operation

- In **Off** defrosting is disabled.
- In Stand-by defrosting is disabled.
- In **On**, as well as the main regulation function specified in the paragraphs which follow, the following situation is also possible (with priority over the main regulation): the defrost request is inhibited/cancelled if antifreeze with heat pump is active.

Types of defrost

SBW600 controls both Single defrosting for a single or double external exchanger, and Independent defrosting for the exchangers of two cooling circuits.

In the first case, single defrosting, the two circuits defrost at the same time when at least of them requires it. This mode applies to machines with single condensation (parameter **FE10: Enable single condensation = 1**). The circuit which completes defrosting first, before it resumes normal operation, waits (with compressors off) for the other circuit to complete defrosting.

N.B.: In the case of single condensation, two start probes must be configured (on for circuit 1 and one for circuit 2) along with two 2 defrost end probes. The times for starting defrosting are nonetheless independent.

In the case of independent defrosting each circuit defrosts separately.

The start and end of the defrost cycle depends on the values of the probes and the parameter settings described below;

Defrost	Parameter	Description
start	df01	Enable maximum power for non-defrost circuit
	df10	Select probe to enable interval count between defrost cycles
	df11	Setpoint to enable interval count between defrost cycles
	df12	Setpoint to clear cumulative time between defrost cycles
	df13	Cumulative time between defrost cycles
Output	df14	Minimum interval between defrost cycles
	df20	Select probe to disable defrost
	df21	Disable defrost setpoint
	df22	Maximum defrost time
	df23	Drip time
SetPoint	df30	Maximum dynamic defrost differential
	df31	Dynamic defrost differential setpoint
	df32	Defrost proportional band dynamic differential

Defrosting is done in heat mode, by reversing the cooling cycle, switching the position of the reversal valve and operating the circuit in chiller mode.

During defrosting, the reversal valves switch in the same way as for change-overs (see chapter Reversal valve management), with the time given in parameter **ST05 - Reversal valve switching delay**, and compressor on/off times which refer only to defrosting (parameter **CP27 - Defrost compressor/step delay minimum**).

In multi-circuit systems, defrosting can be run separately (*independently*) or at the same time (*single*) for the various cooling circuits, depending on the general operational requirements of the system.

Analogue inputs for defrosting start/end

Defrosting can be started in relation to the pressure or temperature measured by the probe selected in parameter **df10**:
Select probe to enable interval count between defrost cycles.

Defrosting can be ended in relation to the pressure or temperature measured by the probe selected in parameter **df20**:
Select probe to disable defrost

In the case of a double circuit, each circuit must have an analogue input configured for the requested function.

Defrosting function analogue inputs

Description
External exchanger temperature circuit 1
External exchanger temperature circuit 2
High pressure input circuit 1
High pressure input circuit 2
Low pressure input circuit 1
Low pressure input circuit 2
External exchanger pressure circuit 1
External exchanger pressure circuit 2

Parameters table **df10** and **df20**

Value	Description
0	No probe
1	External exchanger temperature (circuit 1 and 2)
2	High pressure input (circuit 1 and 2)
3	Low pressure input (circuit 1 and 2)
4	External exchanger pressure (circuit 1 and 2)

18.1 Defrost

18.1.1 Defrost start

Defrosting can be started in relation to the pressure or temperature measured by the probes selected in parameter *Select probe to enable interval count between defrost cycles* **df10**.

If there is a probe error or no probe is configured, start of defrosting depends solely on the effective operating time of the compressors and the parameter *Cumulative time between defrost cycles* **df13**.

The time between defrosts must be at least equal to the value of parameter *Minimum interval between defrost cycles* **df14**.
N.B.: If **df00** = 2 in systems with two circuits, the minimum time between two defrost cycles is applicable to both circuits, so defrosting cannot occur on both circuits simultaneously.

The conditions required for starting defrosting of a circuit are as follows:

- When the pressure or temperature detected by the start defrost probe on the circuit drops below the value of the start defrost setpoint and the circuit is supplying at least one power step, the cumulative defrost delay counter is started, the value of which can be set with parameter **df13**: *Cumulative time between defrost cycles*.
- The start defrost setpoint is a dynamic value calculated on the basis of parameter **df11**: *Setpoint to enable interval count between defrost cycles* (see relevant section).
- When the pressure or temperature read by the defrost start probe for the circuit returns above the value of the defrost start setpoint of the circuit is no longer delivering any power steps, the cumulative defrost delay count is stopped.
- The count is reset to zero after a defrost cycle or after a reset (e.g. power down).
- The cumulative defrost delay count is also reset when the temperature or pressure of the probe configured as defrost start probe rises above the value set in parameter **df12**: *Setpoint to clear cumulative time between defrost cycles*.
- When the cumulative defrost delay count terminates (when the time set in the parameter elapses), the circuit runs a defrost cycle.

Given the above, the start time for the defrost cycle corresponds to the time at which the count ends (before valve reversal).

N.B.: In the case of mode changeover, the count is suspended but not reset. In this way, at the next mode changeover (e.g. from OFF or Standby to Heat), the count resumes from its preceding value.

In the case of *independent* defrosting or a single circuit, defrosting starts only when the compressor safety times are reset, and the conditions for starting defrosting are satisfied (the circuit is delivering at least one power step, etc.).

In the case of *single* defrosting, defrosting starts only when the compressor safety times of both circuits are reset and the conditions for starting defrosting on the requesting circuit are satisfied. The two circuits defrost in a fully harmonised manner.

The defrost stage starts with the sequence of switching of the inversion valve of the circuits in question with procedures similar to those of the mode changeover (see the paragraph Inversion valves management).
The pause time after switching of the inversion valve before restarting the compressors at maximum capacity is equivalent to **St07 – Reversal valve switching from Defrost to Heat delay**.

N.B.:

If the parameters

St06 – Reversal valve switching from heat to Defrost delay = 0 and

St07 – Reversal valve switching from Defrost to heat delay = 0

Valve inversion occurs on the fly ("fast inversion") even when the compressors are running, without any form of safety.

For consistent operation in all situations, the parameter dF14 must be set to a value greater than parameter dF22, which in turn must be set to a value greater than or equal to 3 (minutes).

18.1.2 Defrosting cycle

After cycle reversal, the compressors are *all on* (max. available power). If there is an alarm which inhibits operation of one or more compressors, defrosting proceeds anyway (as in the case of defrosting during a simple stop).

In the case of independent defrosting of the two circuits, with parameter **dF01: Enable maximum power for non-defrost circuit**, the capacity of the alternative circuit (the one not being defrosted) can be forced to maximum for compensation purposes.

18.1.3 End defrost and coil drainage

Defrost terminates:

Due to temperature/pressure:	if (after St07 delay counting in start defrost phase) the temperature or pressure of the end defrosting probe of the circuit rises above the value set in parameter dF21: Disable defrost setpoint .
Due to duration:	if defrosting does not end due to temperature or pressure within the maximum time set in parameter dF22: Maximum defrost time .
By digital input:	if the Circuit 1 Defrost End and Circuit 2 Defrost End digital inputs are configured and active.

If the probe is in error or not configured, defrosting may end in the two other modes (duration and digital input).

The end of defrosting is always independent for each circuit, depending on the analogue or digital end defrost inputs for the circuit in question.

Defrosting end with the reversal valve switching sequence for the circuit in question in the same way as for the start of defrosting (**St06 / St07**) apart from coil drainage.

The compressors are switched off according only to the time set in parameter **Cp27: Defrost compressor/step delay minimum**.

Before the valve reverses, coil drainage runs for a period given in **dF23**.

In this phase the compressors stay off and the external exchanger fan of the circuit is run at maximum power.

After the drip stage (if performed), if time St06 is less than dF23, valve switching is immediate and circuit defrosting is terminated.

The end of the defrosting phase corresponds to the moment the valve is reversed.

After inversion of the valve the compressor will restart after time **St07**.


N.B.: after the end of defrosting, the compressor safety times are no longer regulated by **CP27** (the compressor start sequence of the circuits after defrosting observes normal timings).

N.B.: If all parameters **St06**, **St07** and **dF23** are set to zero, inversion of the valve occurs "on the fly" ("fast inversion"), even when the compressors are running, without any form of safety.

In the case of *single* defrosting on two circuits, the compressors are available for temperature control only if both circuits have stopped defrosting.

In the case of *independent* defrosting, the compressors of the circuit which has stopped defrosting are immediately - available for temperature control.

The circuit for which compensation is active (if either) is controlled by the Heat temperature controller on termination of defrosting.

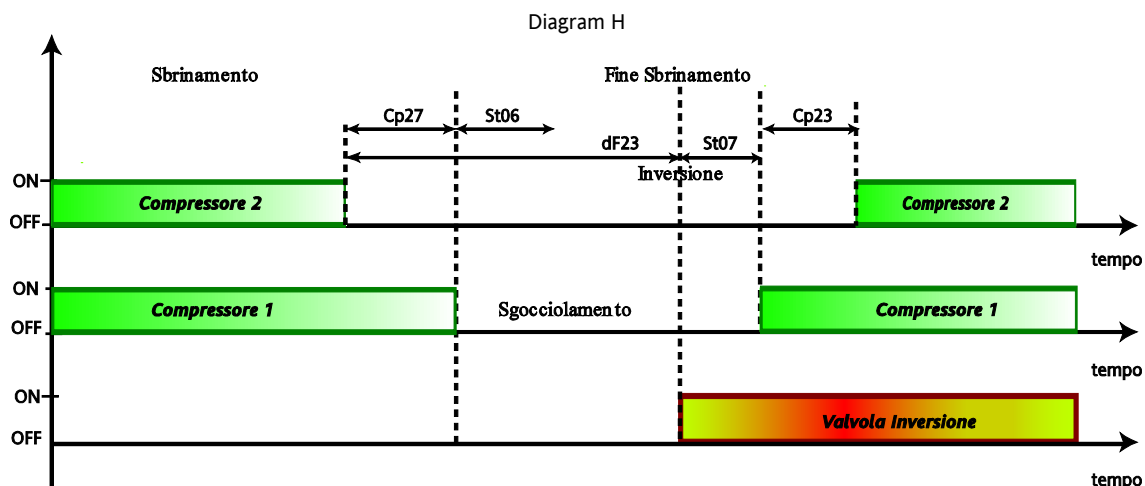

18.2 Start defrost setpoint



In very dry and cold climates, it is good to be able to vary the reference temperature for the start of defrosting as a function of the external temperature.

This regulator linearly compensates the defrosting start temperature or pressure with a positive or negative differential value according to the external temperature.

The real defrost start setpoint is calculated by adding this dynamic differential to the value of parameter **dF11**: *Setpoint to enable interval count between defrost cycles*.

Enabling

The controller is enabled by setting parameter **dF30**: *Maximum dynamic defrost differential* to a value other than 0. Also, an analogue input must be configured as external temperature.

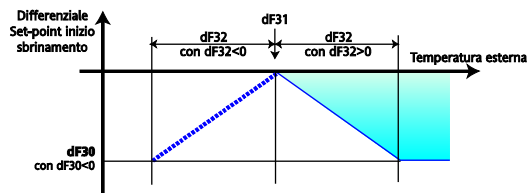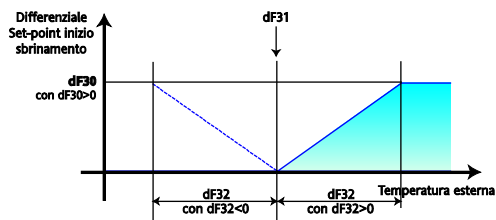

Defrost	Parameter	Description
External temperature		External temperature
Differential	dF30	Maximum dynamic defrost differential
SetPoint	dF31	Dynamic defrost differential setpoint
	dF32	Defrost proportional band dynamic differential

N.B.: In case of error of the external probe, the differential value is set to zero (compensation disabled).

18.3 Defrost alarm management

For the actuation of loads during alarms, see the diagnostics section.

To summarise, and specifically for defrosting, if probe errors or alarms occur which lock the compressors, the start defrost and end defrost cycles are already defined and are typically based on parameter timings. E.g. if during defrosting the compressors are made unavailable by alarms, defrosting will terminate when the maximum time expires. It may terminate differently if the compressors become available again during the defrosting cycle.

18.4 Manual defrost

EnergySBW600 can force defrost manually by pressing and holding the [UP] key.

Manual defrost is possible when:

- **dF00** = 1,2
- **UI20 -Enable defrost function from key**
- if the external exchanger temperature/pressure is below the value set in parameter **dF01 Enable maximum power for non-defrost circuit**

Defrost starts in the sequence described in the section Start Defrost.

- The defrost LED is blinking.

End defrost takes place as described in the section about "End Defrost".

18.5 Power failure during defrost

If a power failure happens during defrost, the procedure will be cancelled. All timings will be cancelled and restarted.

19 DYNAMIC SETPOINT (FOLDER PAR/DS)

Temperature control parameters can be viewed and configured in folder **dS** (see User Interface and Parameters section). The regulation algorithm may be used to modify the set point automatically on the basis of outdoor conditions. This modification is obtained by adding a positive or negative value to the setpoint (offset or differential) based on:

- Analogue input set as dynamic setpoint input.
N.B.: valid only for AIL3 (CL32=25) / AIE3 (CE32=25) or AIL4 (CL33=25) / AIE4 (CE33=25)

or by

- external or ambient temperature

This function has two purposes: to save energy and to operate the machine under particularly harsh outdoor temperature conditions.

Enabling

Dynamic setpoint

a) Depending on ambient or external temperature, the dynamic setpoint is enabled if:

- The activation / selection of the dynamic differential parameter **dS00= 1 or 2**
- an analogue input is configured as Ambient temperature (value = 10) or as External temperature (value = 9) (if both are configured, temperature control is performed in relation to the Ambient temperature).

b) As a function of the dynamic setpoint input

- probe AI3 (analogue inputs) is configured as a dynamic setpoint input (**CL32=25**) / **CE32=25**) or
- probe AI4 (analogue inputs) is configured as a dynamic setpoint input (**CL33=25**) / **CE33=25**)

The function is enabled independently with respect to the differential on dedicated input, with the parameter External temperature controller dynamic differential selection dS00, in addition, an analogue input must be configured as Ambient temperature or as External temperature (if both are configured, regulation occurs on ambient temperature).

N.B.:

- These two options (a) and (b) are independent.
- If the external temperature probe is in error or the ambient temperature probe is not configured with the external probe in error, the associated dynamic differential is cancelled (function "disabled").
- The dynamic setpoint input must be a voltage (V) or current (I) input, and not an NTC temperature probe. The Min and Max values of the graphs are associated with the Min (start of scale value) and Max (full scale value) values of the input itself. If the dynamic setpoint input is in error, the associated dynamic differential is annulled (function disabled).




When the function is active, the Economy LED lights up (if configured: **UI07=1**)

19.1 Modification (decalibration) of the setpoint as a function of the dynamic setpoint input

19.1.1 Modification (decalibration) of the setpoint as a function of the dynamic setpoint input with positive offset

The figure shown above shows decalibration in both cooling and heating modes:

Modification based on the dynamic setpoint input with positive offset

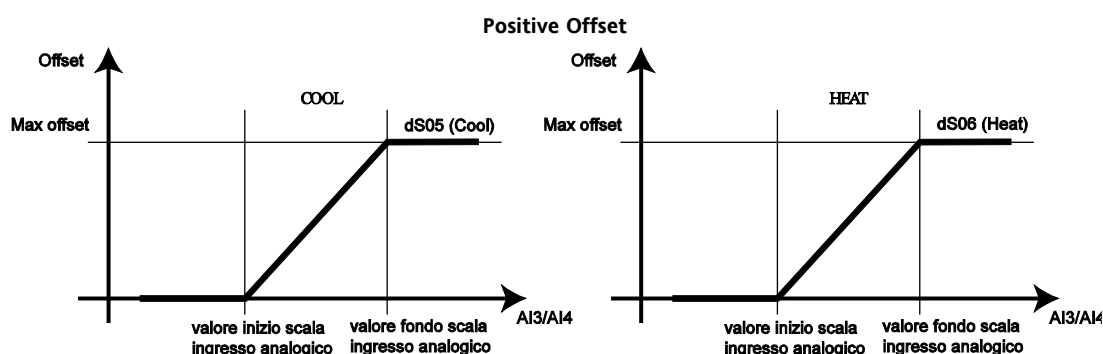

N.B.

The dynamic setpoint input must be a voltage input (V) or a current input (I); it cannot be an NTC temperature probe, i.e. **CL02/CL03= 3,4,5 or 6**.


The Min and Max values of the graphs are associated with the Min (start of scale value) and Max (full-scale value) values of the input itself, in other words

- Min = CL11 for AI3; CL13 for AI4
- Max = CL10 for AI3; CL12 for AI4

19.1.2 Modification (decalibration) of the setpoint based on the dynamic setpoint input with negative offset

See above

Modification in accordance with the input for dynamic setpoint with negative offset

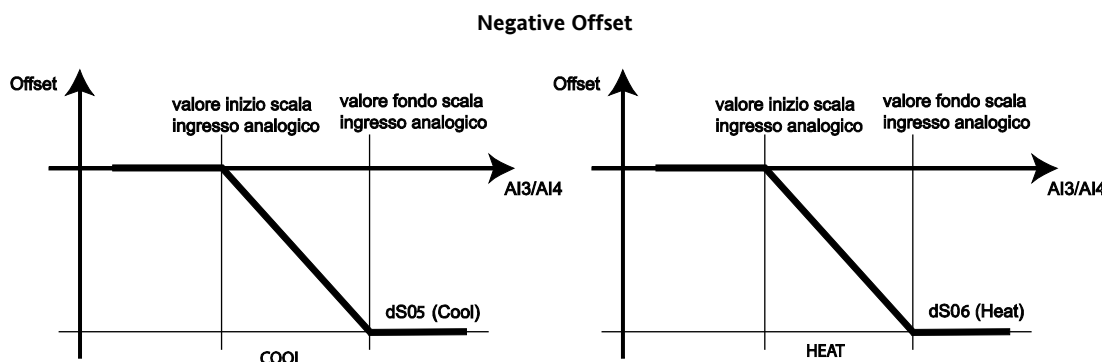

19.2 Modification (decalibration) of the setpoint based on the external temperature

Decalibration of the setpoint in accordance with the external temperature may occur in a proportional manner or with fixed decalibration; the setting is performed by configuring parameter **dS00 - External temperature controller dynamic differential selection**.

This allows enabling/selecting the temperature controller dynamic digital differential


- 0 = disabled
- 1 = Proportional
- 2 = Fixed (by steps)

19.2.1 Modification (decalibration) of the setpoint based on the external temperature (dS00=1)

Proportional offsetting of set-point with positive differential (offset).

The figure shown above shows decalibration in both cooling and heating modes:


Modification based on the external temperature with positive offset

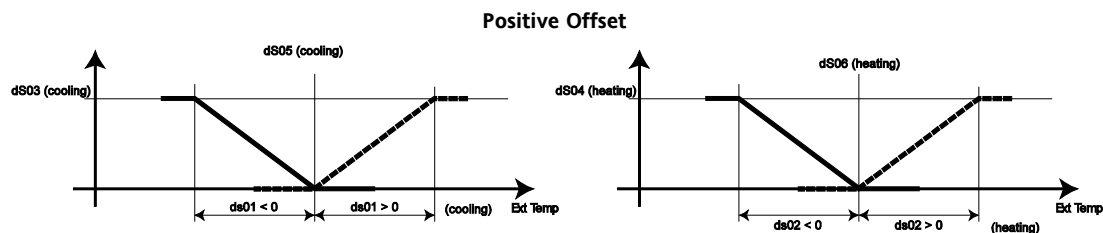

Proportional offsetting of set-point with negative differential (offset).


See above

Modification depending on outdoor temperature with negative offset

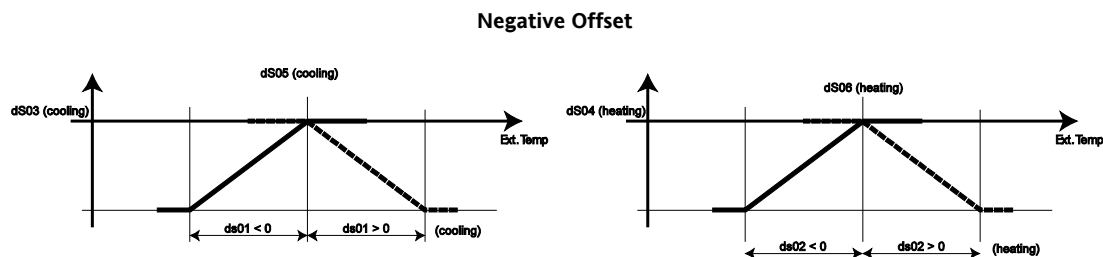

Cool	Heat	
dS01	dS02	Temperature control proportional band dynamic differential in Cool / Heat
dS03	dS04	Maximum temperature control dynamic differential in Cool / Heat
dS05	dS06	Temperature control dynamic setpoint differential in Cool / Heat
		Ext Temp: ambient or external temperature

19.2.2 Fixed modification (decalibration) of the setpoint (dS00=2)

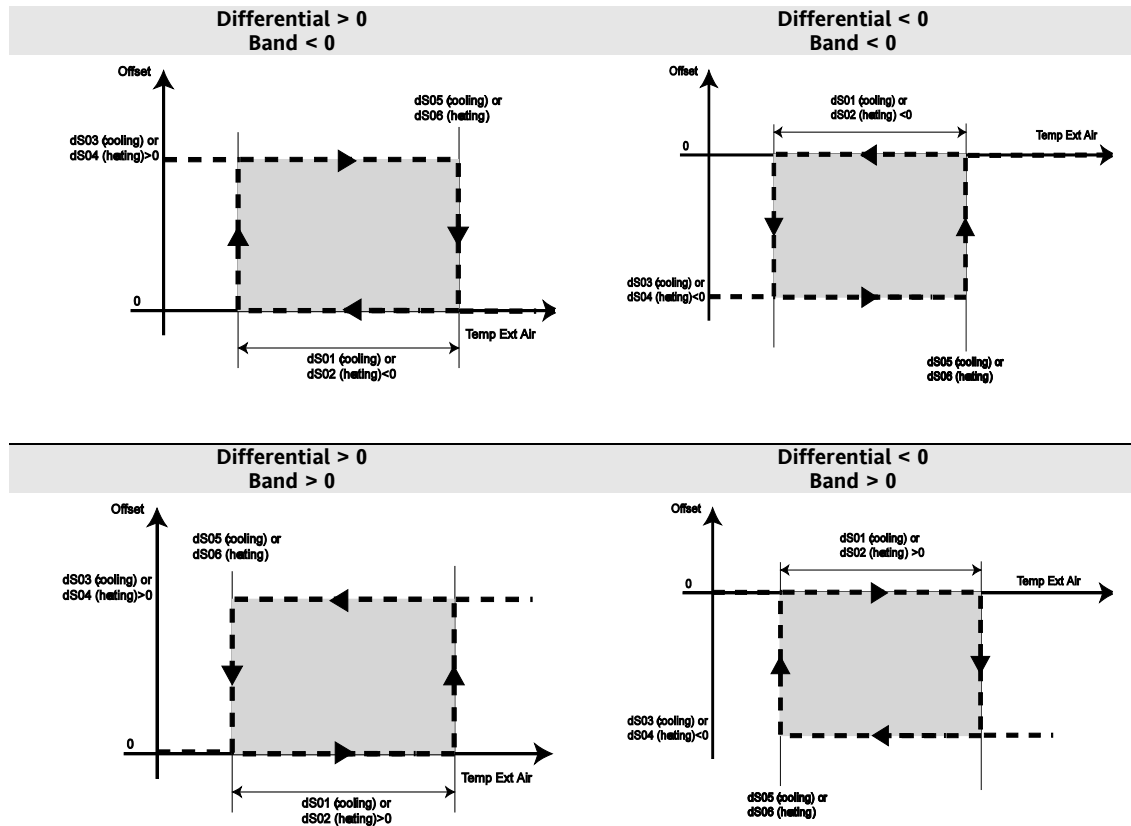

Cool	Heat	
dS01	dS02	Temperature control proportional band dynamic differential in Cool / Heat
dS03	dS04	Maximum temperature control dynamic differential in Cool / Heat
dS05	dS06	Temperature control dynamic setpoint differential in Cool / Heat
		Temp Ext Air: ambient or external temperature
		Offset: Differential



20 ADAPTIVE CONTROL (FOLDER PAR/AD)

Chillers generally contain a water accumulation tank. These provide the thermal inertia required to avoid frequent compressor starts and stops during periods in which there is little need for cooling from the conditioned rooms (frequent starts/stops reduce the compressor lifetime). A water accumulator increases the thermal capacity and provides the inertia required to extend running time. Water accumulators nevertheless represent a significant cost and also increase the minimum dimensions of the machine.

Adaptive function parameters can be viewed and configured in the **Ad** folder (see chapters on User Interface and Parameters).

By adjusting the setpoint and hysteresis, the Adaptive function simulates electronically the inertia of a water accumulator, meaning it can be used less.

Enabling

Use parameter **Ad00 - Select no accumulation mode**

when set not equal to zero enables the function and enables selecting the amount to which the adaptive function temperature differential is to be added or subtracted.

		0	1	2	2
Ad00	Select no accumulation mode	Accumulation disabled	Dynamic	Hysteresis	Setpoint + hysteresis

General conditions of operation

- In Off the adaptive function is disabled.
- In Stand-by the adaptive function is disabled.
- In On the adaptive function is enabled.

MT minimum time and ET real time

Note that compressor on/off times must respect safety time delays:

The function analyses actual running time of the compressor (ET) comparing it with the preset minimum running time (MT).

Minimum time
MT

The minimum time (MT) is set in parameter **Ad06 - Compressor on reference time for accumulation compensation**

Parameter	Description
MT	
Ad06	Compressor on reference time for accumulation compensation

Real time ET

Real running time (ET) is recorded automatically by the device

Type of plant	ET
Single circuit 2 / 4 compressors Segmented compressors	Count [first compressor on / first power stage, last resource switched off]
Double circuit 1 / 2 compressors Segmented compressors	Count [first compressor on / first power stage, last resource switched off] Independently of the circuits
Ordinary compressor	Count [compressor on, compressor off]

20.1 Adaptive function with setpoint modification

ET<MT example

If ET<MT:

when the compressor switches off, the operating setpoint is changed to a value equal to the adaptive offset (AO) according to the formula below:

- $AO = ((MT - ET) * Ad01) / 10 + Ad02$

Where:

Ad01	Accumulation compensation constant
Ad02	Accumulation compensation differential

Adaptive function
Setpoint
modification
in cooling

COOLING MODE

• ET<MT example

If the real running time (ET) is less than the minimum time (MT), each time the compressor switches off, the adaptive offset is subtracted from the setpoint.

Cycle 0

- Setpoint for cycle 0: $SET(0) = SET\ (COOL)$
- Hysteresis for cycle 0: $HYSTERESIS\ (0) = HYSTERESIS\ (COOL)$
- Compressor ON $SET\ (0)+HYSTERESIS\ (0) \rightarrow SET\ (COOL) +HYSTERESIS\ (COOL)**$
- Compressor OFF $SET\ (0)$

Cycle 1

- Setpoint for cycle 1: $SET(1) = SET\ (0) - AO\ (1) = SET\ (COOL)-AO(1)$
- Compressor ON $SET\ (0)+HYSTERESIS\ (0) \rightarrow SET\ (COOL) +HYSTERESIS\ (COOL)**$
- Compressor OFF $SET\ (0) - AO(1) = SET\ (COOL)** - AO(1)$

Cycle 2

- Setpoint for cycle 2: $SET(2) = SET\ (1) - AO\ (2)$
- Compressor ON $SET\ (0)+HYSTERESIS\ (0) \rightarrow SET\ (COOL) +HYSTERESIS\ (COOL)**$
- Compressor OFF $SET\ (0) - AO(2) = SET\ (COOL)** - AO\ (2)$

...

• ET>MT example

See differential regression

Adaptive function
Modification of
setpoint in heating


HEATING MODE

Same as heating example. The offset is ADDED to the setpoint:

- $SET(0) = SET\ (HEAT)$
- $SET(1) = SET(HEAT)+AO(1)$
- $SET(2) = SET(HEAT)+AO(2)$


...

Note that in both modes, the compressor on temperature is the same for each operating cycle, even when the adaptive function is activated.
This extends the zone between the setpoint and on temperatures, reducing the number of times the compressor switches on and off and thereby reducing any overlap with safety times.

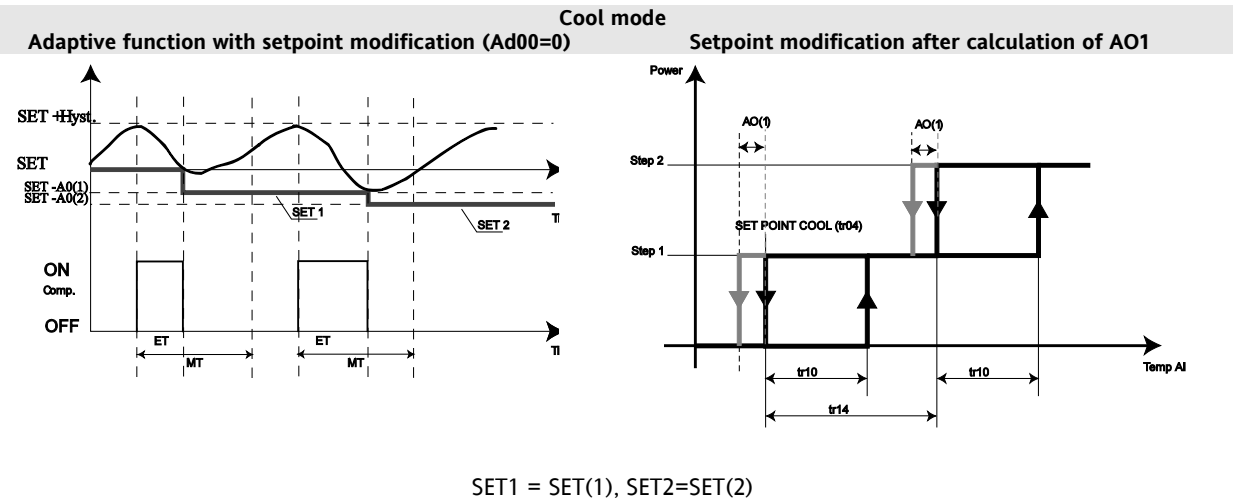


20.2 Adaptive function with hysteresis modification

Adaptive function with hysteresis modification (Ad00=1)

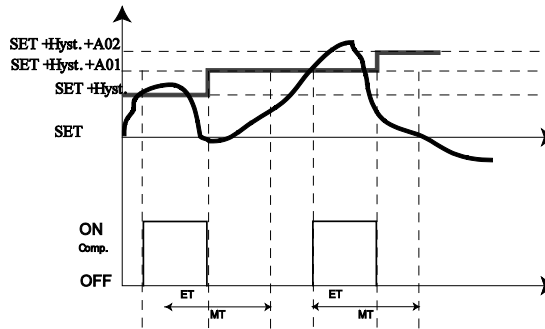


Setpoint modification after calculation of AO1

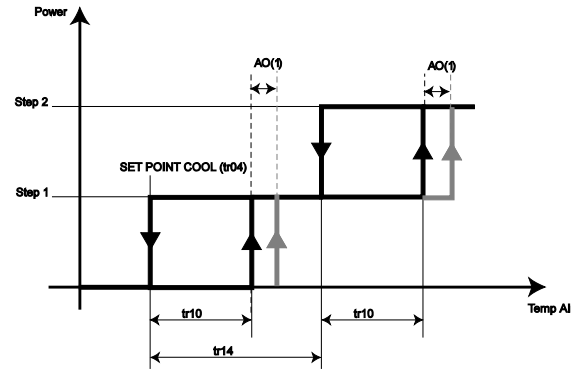


20.3 Adaptive function with setpoint and hysteresis modification

Adaptive function with setpoint and hysteresis modification (Ad01=2)

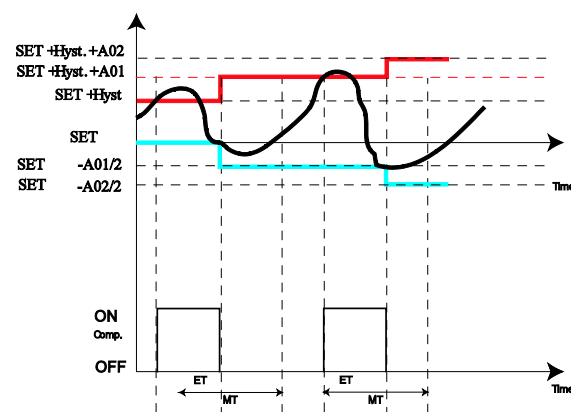

Setpoint and hysteresis modification after calculation of AO1

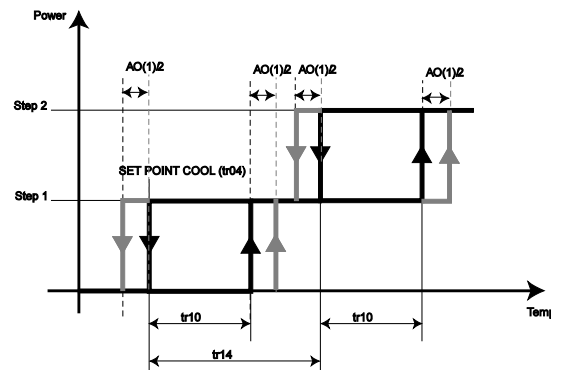

20.4 Setpoint regression

ET ≥ MT example


If $ET \geq MT$:

If the cycle time is long enough (and greater than MT), regression of the real setpoint occurs for each interval of Ad05 (from the start of the cycle), the setpoint is modified by the value set in Ad02.

- in cooling, the setpoint (real for cycle N) is increased:
after Ad05: $SET(N) + Ad02$
after $2 \cdot Ad05$: $SET(N) + 2 \cdot Ad02$
and so on until the maximum value (setpoint / hysteresis)
- in heating, the setpoint is reduced as above, down to the minimum value (setpoint / hysteresis)

So for long cycle times, balancing of the "adaptive" function is achieved, making these cycle times compatible with the compressor times.

Cool mode Setpoint regression

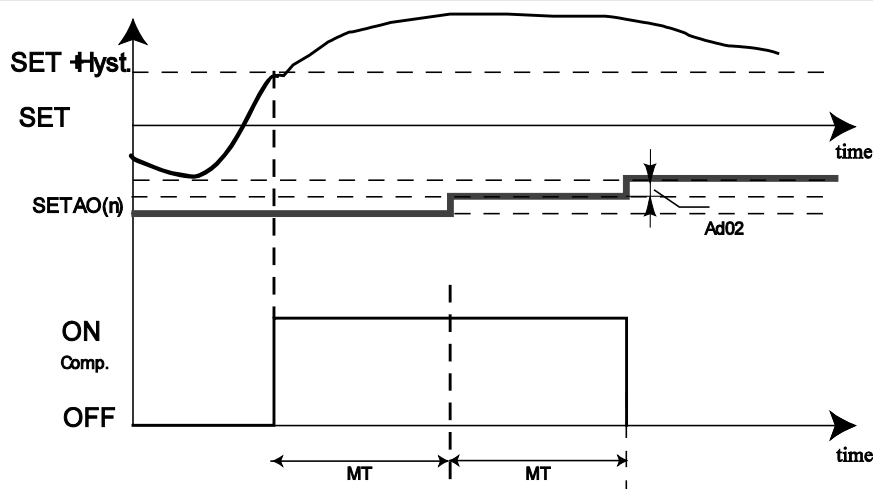

Parameter	Description	Parameter
Ad01	Accumulation compensation constant	See Modify setpoint offset calculation formula
Ad02	Accumulation compensation differential	See Modify setpoint offset calculation formula
Ad03	Accumulation compensation block setpoint in Cool	See Setpoint regression
Ad04	Accumulation compensation block setpoint in Heat	See Protection in cooling mode
Ad05	Time compressor on for accumulation compensation regression	See Protection in heating mode
Ad06	Compressor on reference time for accumulation compensation	See setpoint regression
		See MT

20.5 Protection

COOL

If the outlet temperature < Ad03 during general cycle n, the controller performs the following actions:

- Switches off the compressor (or compressors)
- Clears the adaptive offset AO(n) = 0; the next cycle recommences with the original setpoint and hysteresis

This adjustment can be considered a precursor of the antifreeze alarm (the cycle stops without generating an alarm) in the event the adaptive function leads to a very low real setpoint.

We recommend setting Ad03 > AL12 Internal circuit antifreeze alarm regulator setpoint

HEAT

If the outlet temperature > Ad04 during general cycle n, the controller performs the following actions:

- Switches off the compressor (or compressors)
- Clears the adaptive offset AO(n) = 0; the next cycle recommences with the original setpoint and hysteresis

This adjustment can be considered a precursor of the high pressure alarm (the cycle stops without generating an alarm) in the event the adaptive function leads to a very high real setpoint.

To set **Ad06**, we recommend referring to the high pressure safety devices in use (pressure switch configuration, type of refrigerant used, and so on).

N.B.: if the plant is of the two circuit type and two water temperature sensors are configured on circuit 1 and 2 primary output, consider the minimum of the two values.

21 ANTIFREEZE WITH HEAT PUMP (FOLDER PAR/AF)

Anti-freeze parameters can be viewed and configured in folder **AF** (see User Interface and Parameters chapters).

The anti-freeze function with heat pump serves to prevent breakdowns due to internal heat exchanger icing (typically in machines with water-type internal heat exchangers).

SBW600 enables control of machines with one or two cooling circuits and one or two internal heat exchangers.

The anti-freeze function with heat pump is controlled separately for each cooling circuit.

The function is always active in any machine operating state, i.e. cooling, heating and standby.

Anti-freeze function with heat pump is enabled

- via parameter (**AF00 - Select antifreeze probe with circuit 1 heat pump** ≠ 0)
- via parameter (**AF01 - Select antifreeze probe with circuit 2 heat pump** ≠ 0)

The Heating LED flashes when this function is active.

Mode change is disabled when this function is enabled

Defrosting is disabled when this function is enabled

Analogue inputs for anti-freeze function with heat pump

The analogue inputs used for regulation are selected distinctly for each cooling circuit, using parameters

AF00 - Select antifreeze probe with circuit 1 heat pump

AF01 - Select antifreeze probe with circuit 2 heat pump

N.B.: For machines with a single circuit **AF01 - Select antifreeze probe with circuit 2 heat pump** must be set = 0.

Value AF00 / AF01	Probe
0	No sensor (Anti-freeze with Heat Pump function disabled)
1	Internal exchanger water/air inlet temperature
2	Internal exchanger water/air outlet temperature
3	Circuit 1 internal exchanger water outlet temperature
4	Circuit 2 internal exchanger water outlet temperature
5	Circuit 1 and 2 internal exchanger water outlet minimum temperature

General conditions of operation

- In **Off** the anti-freeze function with heat pump is disabled.
- In **Stand-by** the anti-freeze function with heat pump is enabled, as in **On**.
- In **On**, further to the principal regulation specified in the following paragraphs, the following situation (with priority over the principal regulation itself) may occur: anti-freeze function with heat pump inhibited during defrosts.

N.B.:

The valve reverses with a delay **ST05 - Reversal valve switching delay**.


Furthermore, during the anti-freeze phase, the compressors run at maximum power and are turned off and on with reference only to the delay **CP27 - Defrost compressor step/delay minimum**

Heat pump activation

- The function is enabled (°) if the measured temperature
 - o **Circuit 1:** by the anti-freeze with heat pump probe for circuit 1 < **AF02 - Setpoint for antifreeze regulator with heat pump**
 - o **Circuit 2:** by the anti-freeze with heat pump probe for circuit 2 < **AF02 - Setpoint for antifreeze regulator with heat pump**


(°) the heat pump is activated if previously switched off; if previously activated, it remains active

Circuit 1

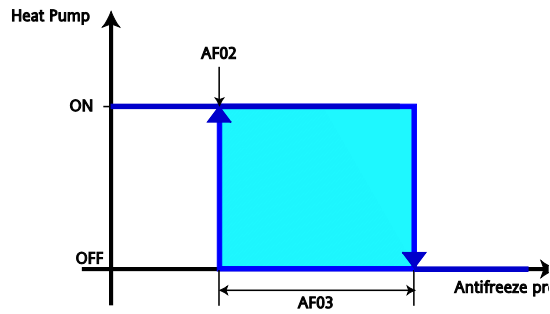

Heat Pump = pompa di calore
 Anti-freeze probe
 antifreeze probe with circuit 1 heat pump
 (AF00)

Circuit 2

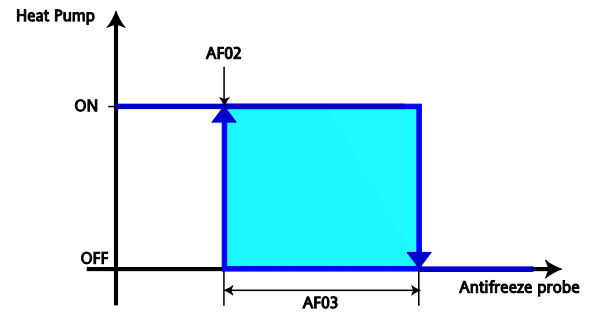

Heat Pump = pompa di calore
 Anti-freeze probe
 anti-freeze probe with circuit 2 heat pump
 (AF01)

Parameter	Description
AF02	Setpoint for antifreeze regulator with heat pump
AF03	Antifreeze regulator hysteresis with heat pump
Control sensor	AF00 (circuit 1) / AF01 (Circuit 2)

22 SANITARY WATER AND ANTI-LEGIONNAIRE'S DISEASE (FOLDER PAR/AS)

Small/medium installations (typically residential installations) require "integrated" management of sanitary water (also referred to as ACS) by means of the heat pump system (for heating and cooling the interior environment). In practice, this involves controlling the sanitary water temperature (ACS temperature) in a dedicated accumulator.

The switch between 'normal' mode (heating/cooling) and ACS mode can occur in 2 ways, depending on the type of system:

- With ACS Valve: the flow will be diverted from the heating/cooling circuit to the ACS accumulator
- With ACS Pump: the heating/cooling circuit pump will be switched off and the ACS accumulator pump switched on

Type of system

The type of system is configured using parameter **AS00 - Select ACS mode**

Enabling

When parameter **AS00 - Select ACS mode** is different from zero, the regulator is *enabled*.

The possible values of parameter **AS00** are:

- 0 = Disabled
- 1 = Enabled only heat pump for sanitary water system with sanitary water valve
- 2 = Enabled only sanitary water heater
- 3 = Enabled sanitary water heat pump and heater system with sanitary water valve
- 4 = Enabled only heat pump for sanitary water system with sanitary water pump
- 5 = Enabled only sanitary water heater
- 6 = Enabled sanitary water heat pump and heater system with sanitary water pump

Refer also to the following table where the AS00 values are indicated in relation to the type of system used

	Parameter	Description	value			
			0	1 or 4	2 or 5	3 or 6
Enabling	AS00	Select external circuit mode ACS	disabled	Heat pump	only sanitary water heater	Heat pump + sanitary water heater
system		Sanitary water valve		AS00 = 1 system with sanitary water valve		AS00 = 3 system with sanitary water valve
		Sanitary water pump		AS00 = 4 system with sanitary water pump		AS00 = 6 system with sanitary water pump

Notes.

- The term heat pump actually refers to the entire machine (e.g. including the integrated internal exchanger heaters, if any)
- Since the behaviour of the sanitary water heater is independent of the type of system, the values 2 and 5 determine the behaviour of the device.
- With the parameters *Anti-legionnaire's disease period duration, day 1 - day 2*, etc. **AS25, AS26...** different from zero (at least one must be non-zero) the Anti-legionnaire's disease function is *enabled*; furthermore, the RTC must be present and enabled for operation (it must not be faulty or not set; for further details refer to the specific alarms)

General conditions of operation

- In **Off** the regulator is *switched off* immediately and continuously.
- In **Standby** the regulator is on, with exclusive reference to activation of the ACS antifreeze heater
- In **On**, in addition to the main control specified in subsequent paragraphs, the following situations are also possible (with priority given to the main control itself):
 - If there is an *error* in the sanitary water temperature sensor, the regulator (valve/pump and ACS heater management) is *disabled*
 - The ACS valve / pump is immediately switched off in the event of valve / pump shutdown alarms
 - The ACS heater is immediately switched off in the event of heater shutdown alarms
 - on start-up of SBW600 (power on or reboot from OFF or Stdby), ACS mode is inhibited for 120 seconds in order to prevent multiple settings competing on start-up, with impulsive activations of the loads (e.g. internal pump).
- In **AS** the regulator is active

Sanitary Water Setpoint

Regulation occurs on the actual ACS Setpoint.

The Actual Setpoint is determined by the following contributing factors:

- At start-up of the instrument, the Sanitary Water Setpoint = **AS01 - ACS setpoint**
- If Time Bands are active (**tE00 - Enable time band operation** = 1) the Sanitary Water Setpoint will be determined by the **ACS Setpoint** of the corresponding event / profile (see Time Bands section (folder PAR/tE))
- If **AS11 - Sanitary water set point dynamic constant** is different from zero, then the Dynamic ACS Setpoint function is activated on the Sanitary Water Setpoint

22.1 Sanitary Water in HEAT mode


Sanitary water consent

In **Sanitary Water mode**, the machine's operation is governed by the **request/consent** concept. Consent may be given (with resulting switchover from normal mode to the mode determined by the Sanitary Water regulator) *if and only if* all of the following conditions are satisfied:

- Sanitary Water Setpoint not reached (a function of the temperature of the ACS accumulator – See **diagram A**)
- the time **AS10 - ACS minimum deactivation/activation time** has elapsed
- NO Anti-Legionnaire's Disease period is in progress*

*example: Saturday 21.30 AS40 different from 0; AS41 = 22, AS42 = 0

This request, which was described above, takes priority over the “normal” ACS heating request.

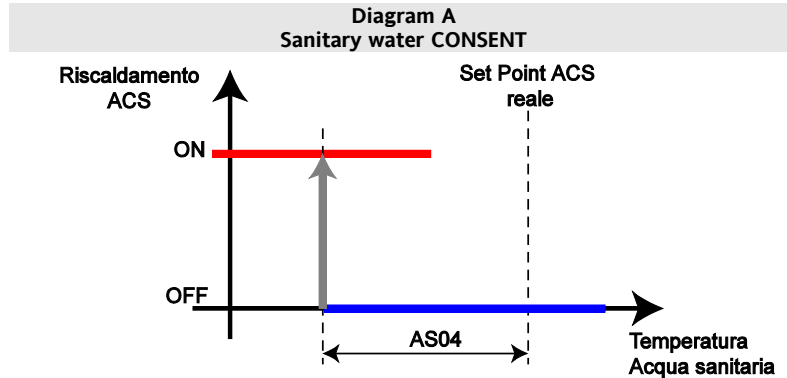

Parameter	Description
AS04	ACS hysteresis
AS01	ACS setpoint
AS02-AS03	N.B.: using the parameters: AS02 - ACS minimum setpoint AS03 - ACS maximum setpoint It is possible to limit the maximum and minimum configuration values of AS01
SetPoint	Actual ACS setpoint
Control sensor	Sanitary water temperature

Regulation, machine in HEAT

In the event of a sanitary water heating request:

- the machine remains in Heat Pump mode (and maintains the same control sensor that it uses in normal Heat mode) but modifies the control setpoint from actual Heat Setpoint to **AS01 - ACS Setpoint (ACS)** with **AS05 - ACS disengage setpoint differential**
- the ACS valve / pump is activated with the following actions:
 - machine with ACS valve: the ACS valve is activated without switching off the internal pump
 - machine with ACS pump: the ACS pump is activated at the same time the internal pump is switched off; to prevent flow switch alarms, it is necessary to re-enter the time **AL14 - Flow switch alarm bypass**

ACS heater: see corresponding paragraph

ACS disengage

Once the machine has been “engaged” to heat sanitary water for Anti-Legionnaire's disease, it will continue to do so until *at least one* of the following conditions is satisfied:

- the ACS accumulator sensor reaches the actual ACS setpoint - **see figure B**
- the Heat control sensor (which typically is not the ACS accumulator sensor) reaches a certain value, equal to the **AS01 - ACS Setpoint (ACS)** plus a specifiable differential, which takes account of the temperature difference that may exist between the ACS accumulator and the position of the Heat control sensor, parameter AS05 – **see figure C**
- the time set using parameter **AS09 - ACS maximum activation time** has elapsed
- an Anti-Legionnaire's Disease period is starting

When normal mode and the actual Heat (or Cool) setpoint are restored, except in the event of request/consent for machine operation in ACS for Anti-Legionnaire's Disease – see corresponding paragraph
All considerations made with regard to actions adopted during switchovers apply

If normal operating mode is restored, the ACS valve / pump is switched off with the following actions:

- machine with ACS valve: the ACS valve is switched off, the internal pump will continue to function if required for normal operating mode
- machine with ACS pump: the internal pump is activated at the same time the ACS pump is deactivated; to prevent flow switch alarms, it is necessary to re-enter the time **AL14 - Flow switch alarm bypass**

Diagram B
sanitary water DISENGAGE
SETPOINT REACHED

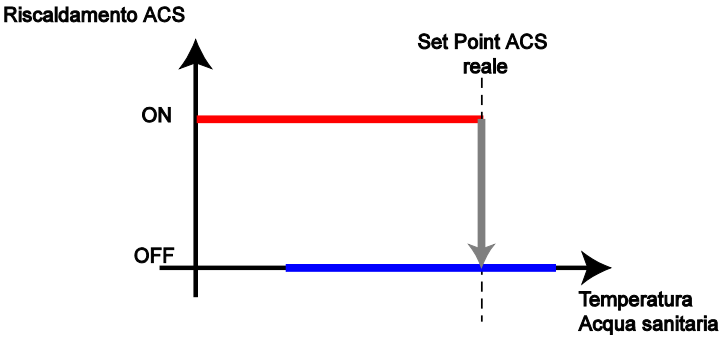


Diagram C
sanitary water DISENGAGE

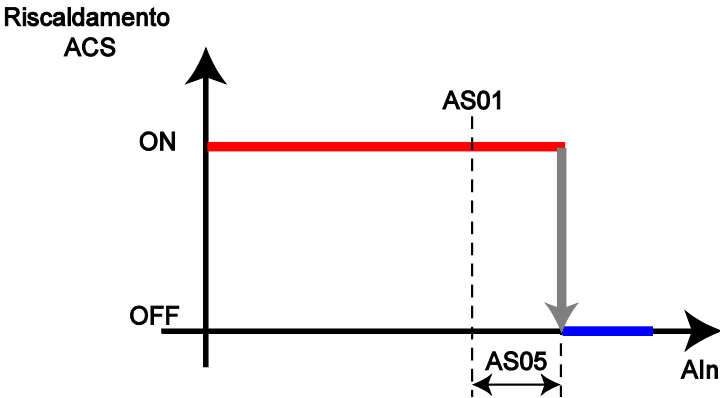


Diagram	Parameter	Description
	AS02-AS03	N.B.: using the parameters: AS02 - ACS minimum setpoint AS03 - ACS maximum setpoint It is possible to limit the maximum and minimum configuration values of AS01
B	SetPoint	Actual ACS setpoint
B	Control sensor	Sanitary water temperature
C	AS05	ACS disengage setpoint differential
C	AS01	ACS setpoint
C	Control sensor AIn	HEAT control sensor

22.1.1 Sanitary water heater in Heat/Cool mode*

* behaviour independent from mode


Sanitary water heat regulation occurs on the actual ACS setpoint, with

- fixed differential **AS07 - ACS heater differential**
- hysteresis **AS06 - ACS heater hysteresis**, as shown in the figure

The analogue input used for regulation is exclusively the sanitary water temperature

Once enabled, the ACS heater is *independent* (setpoint differential aside, *it does not influence and is not influenced by the machine's other regulators, and the concepts relating to ACS consent do not apply to it*)

Differential AS07 is cancelled if the unit is in Heat Pump Lock

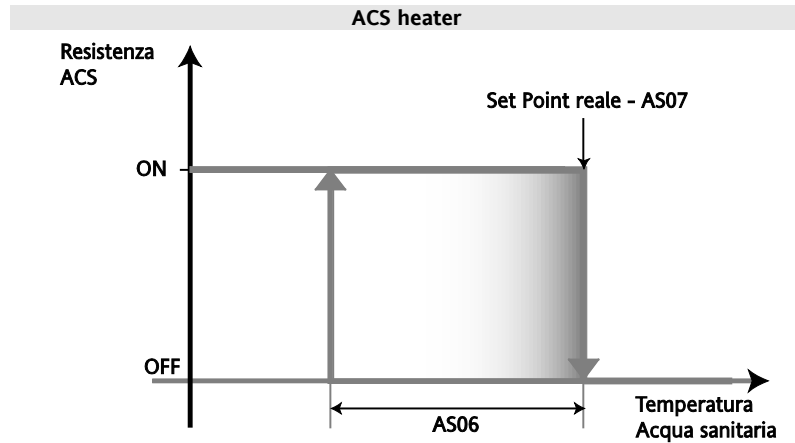


Parameter	Description
AS06	ACS heater hysteresis
AS07	ACS heater differential
Setpoint	Actual Setpoint – AS07
Control sensor	Sanitary water temperature

22.2 Sanitary Water, Cool mode

In the event of an **ACS heating** request, the machine switches temporarily from Chiller to Heat Pump (for Heat Pump operation see HEAT Mode), and remains in this mode until it is “disengaged”, when normal Cool mode is restored, with actual Cool Setpoint.

In this case, special attention must be paid to the switchovers, since both the reversal valve (already discussed in the corresponding section) and the ACS valve / pump must respect the times indicated below


Diagram	Parameter	Changeover
A	St05 different from 0	COOL - ACS
B		ACS - COOL
C	St05 = 0	COOL - ACS
D		ACS - COOL

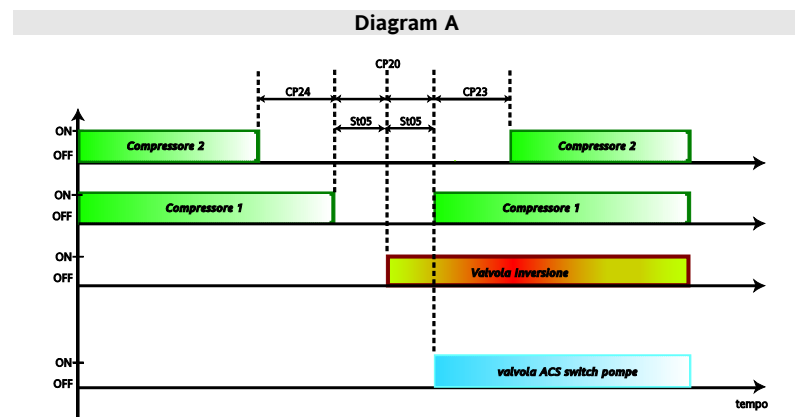

Parameter	Description
St05 different from 0	Reversal valve switching delay
CP20	Minimum off/on for same compressor
CP23	Minimum on/on time for same compressor
CP24	Minimum off/off time for different compressors

The switchover occurs with the following measures



- **machine with ACS valve:** the ACS valve is activated after the time **St05 - Reversal valve switching delay** from the valve switchover (to switch-on of the first compressor, unless other safety timings further delay said compressor), without switching off the internal pump. If in normal mode the compressors are switched off, the internal exchanger water pump can also be switched off (e.g. operation enabled on request): in this case the pump will switch on at the same time the ACS mode is activated, resulting in the delayed switch-on of the compressors due to the need for pre-pumping.
- **machine with ACS pump:** the ACS pump is activated after the time **St05 - Reversal valve switching delay** from the valve switchover (to switch-on of the first compressor, unless other safety timings further delay said compressor): the internal pump is switched off at the same time; to prevent flow switch alarms it is necessary to re-enter the time **AL14 - Flow switch alarm bypass**

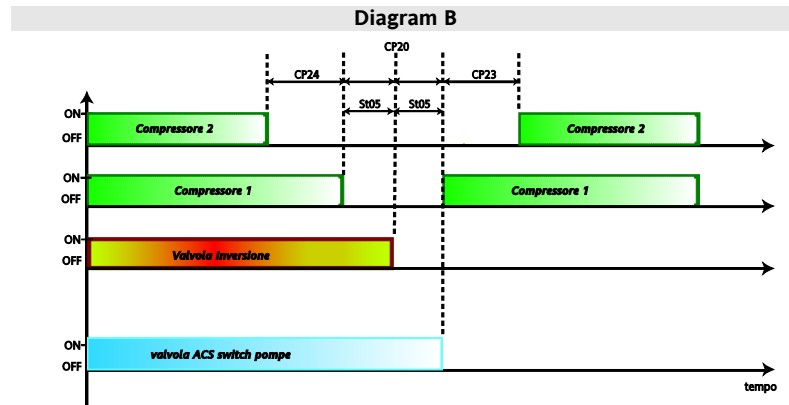

Parameter	Description
St05 different from 0	Reversal valve switching delay
CP20	Minimum off/on for same compressor
CP23	Minimum on/on time for same compressor
CP24	Minimum off/off time for different compressors

The switchover occurs with the following measures

- **machine with ACS valve:** the ACS valve is deactivated after the time **St05 - Reversal valve switching delay** from the valve switchover (to switch-on of the first compressor, unless other safety timings further delay said compressor), without switching off the internal pump (this water pump may be switched off according to normal mode logic (e.g. operation enabled on request and compressors off)).
- **machine with ACS pump:** the internal exchange pump is activated after the time **St05 - Reversal valve switching delay** from the valve switchover (to switch-on of the first compressor, unless other safety timings further delay said compressor), the ACS is switched off at the same time; to prevent flow switch alarms it is necessary to reset the time **AL14 - Flow switch alarm bypass**.

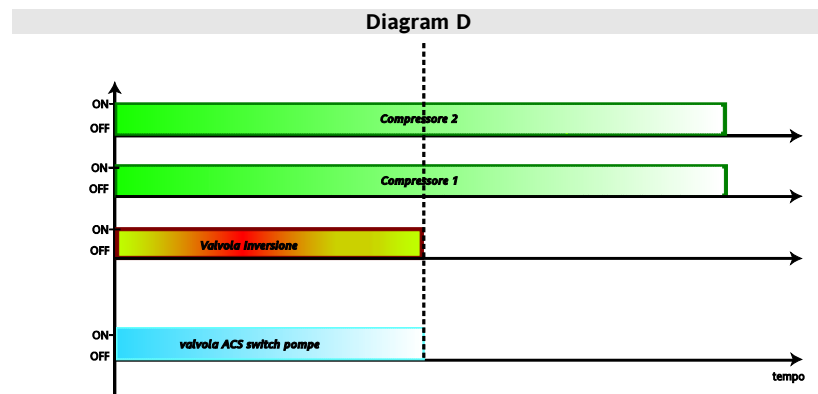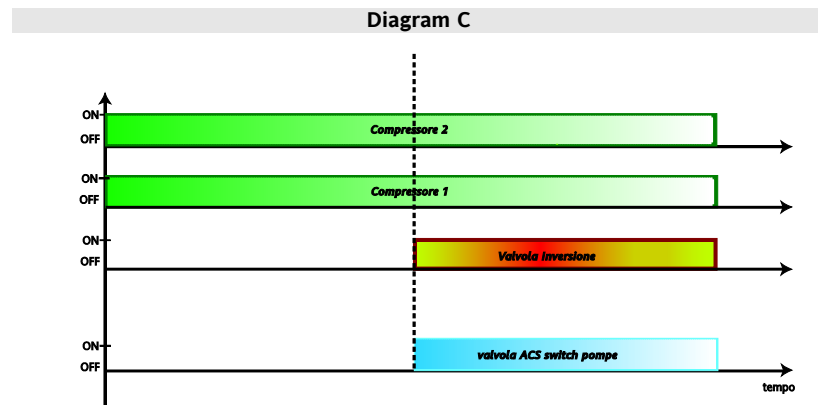

Parameter	Description
St05 = 0	Reversal valve switching delay

22.2.1 Dynamic ACS setpoint

The Dynamic ACS Setpoint function modifies the *actual* ACS setpoint according to the system's thermal efficiency. It may occur that (e.g. due to incorrect dimensioning of the system) the machine never manages to reach the *actual* ACS setpoint.

Based on previous considerations, in this case the machine would exit ACS mode either due to timeout expired (**AS09 - ACS maximum activation time**) or due to Heat control setpoint reached (**AS01 + AS05**).

The Dynamic ACS Setpoint function calculates and updates the maximum sanitary water temperature which the system can achieve under those particular conditions. In this way, the system is in any case "guaranteed" to exit from ACS mode due to attainment of the ACS Setpoint

Enabling

This function is *enabled* by setting parameter **AS11 - Sanitary water set point dynamic constant** to a value different from zero.

You must also configure all of the following analogue inputs as

- water delivery temperature.
- water return temperature.
- ACS temperature

The Dynamic ACS Setpoint function will calculate the new ACS setpoint as the smallest value between

- Actual Setpoint
- (*) ACS maximum water temperature achievable as a function of the system

Where (*) is a function of the parameters

AS11 - ACS setpoint dynamic constant

AS12 - Sanitary water system maximum temperature

22.3 Sanitary water regulation, AS mode

During operation in Heat or Cool mode, the controller/machine (heat pump) meet ACS (or ACS for AL) heating needs if there is a request and provided the necessary conditions are met, otherwise they meet system needs (Heat or Cool).

AS mode is useful in the event that (e.g. due to the current season or the type of system) it is not necessary to control system requirements. In other words in AS mode, the controller/machine (heat pump) are only activated if there is a need for ACS (or ACS for AL) heating, according to the same process as that described previously, otherwise there is no actuation.

The above indications also apply to defrost (must be managed as normal!).

22.4 Anti-Legionnaire's Disease

The Anti-Legionnaire's Disease function eliminates Legionnaire's disease bacteria, which reside in water sources; these bacteria are typically destroyed if the water temperature rises above 60°C *for a certain period of time*.

Anti-Legionnaire's Disease period

An anti-legionnaire's disease period can be activated on each day of the week with a configurable start time and duration:

Description	Duration of event. (0= disabled) Parameter	Event (start) hour Parameter	Event (start) minutes Par
day 1 (Monday)	AS25	AS26	AS27
day 2 (Tuesday)	AS28	AS29	AS30
day 3 (Wednesday)	AS31	AS32	AS33
day 4 (Thursday)	AS34	AS35	AS36
day 5 (Friday)	AS37	AS38	AS39
day 6 (Saturday)	AS40	AS41	AS42
day 7 (Sunday)	AS43	AS44	AS45

N.B.

The Anti-Legionnaire's disease period (event duration) must have a suitable duration, otherwise there is a risk that **AS20 - ACS setpoint for anti-legionnaire's disease** will never be met (in this case an automatic reset Anti-legionnaires alarm E048 is generated when the setpoint is reached)

ACS setpoint for anti-legionnaire's disease


Regulation always occurs on the ACS setpoint for anti-legionnaire's disease AS20

ACS consent for anti-legionnaire's disease

In the same way as for the "normal" ACS regulator, the **request/consent** concept applies to **machine operation in ACS for Anti-Legionnaire's Disease**. Consent may be given (with resulting switchover from normal mode, or from ACS mode, to the mode determined by the ACS regulator for Anti-Legionnaire's disease) *if and only if* all of the following conditions are satisfied:

- Anti-Legionnaire's disease period in progress*
*example: Saturday 22.30 AS40 different from 0; AS41 = 22, AS42 = 0
- ACS setpoint for Anti-Legionnaire's Disease not reached (a function of the temperature of the ACS accumulator – **See diagram A**
- the time **AS23 - ACS minimum deactivation/activation time for anti-legionnaire's disease** has elapsed

This request, which was described above, takes priority over the "normal" **ACS heating request**.

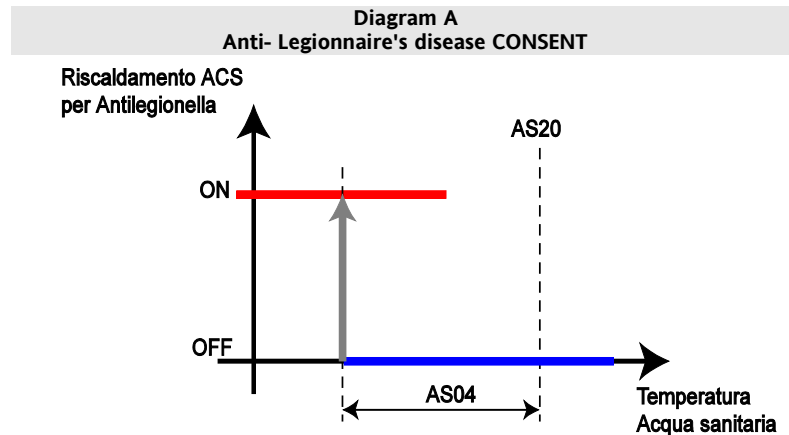

Parameter	Description
AS04	ACS hysteresis
AS20	ACS setpoint for anti-legionnaire's disease
AS21-AS22	N.B.: with the parameters : AS21 - Minimum ACS setpoint for anti-legionnaire's disease AS22 - Maximum ACS setpoint for anti-legionnaire's disease it is possible to limit the maximum and minimum configuration values of AS20
Control sensor	Sanitary water temperature

Notes

Consent is not subject to compliance with safety times*, since the aim is to bring the ACS to the temperature specified for Anti-Legionnaire's Disease, with priority over everything else

*times controlled by defining Anti-Legionnaire's disease periods using parameters AS25...AS45

Typically **AS20 - ACS setpoint for anti-legionnaire's disease** > **AS01 - ACS setpoint** which means that the machine will switch to managing ACS heating for Anti-Legionnaire's Disease as soon as the Anti-Legionnaire's Disease period starts (all the more so if the machine was in Cool mode).

Regulation

HEAT

The machine operates in much the same way as for the ACS case, except that a different setpoint is adopted: in the event of a request for ACS heating for Anti-Legionnaire's disease:

- the machine remains in Heat Pump mode (and maintains the same control sensor that it uses in normal Heat mode) but modifies the control setpoint from Actual Heat Setpoint to **AS20 - ACS setpoint for anti-legionnaire's disease** with the same **AS05 - ACS disengage setpoint differential**
- the ACS valve / pump is activated (or remains active) with the same actions as those indicated in the ACS case.

COOL

The machine operates in a similar way and must switch from chiller to heat pump and vice versa.
All considerations made with regard to actions adopted during switchovers apply.

ACS Disengage for Anti-Legionnaire's Disease

Once the machine has been "engaged" to heat sanitary water for Anti-Legionnaire's disease, it will continue to do so until *at least one* of the following conditions is satisfied:

- the ACS accumulator sensor reaches the ACS setpoint for Anti-Legionnaire's disease, parameter AS20 - **see figure B**
- the Heat control sensor (which typically is not the ACS accumulator sensor) reaches a certain value, equal to the ACS Setpoint for Anti-Legionnaire's Disease plus a specifiable differential, which takes account of the temperature difference that may exist between the ACS accumulator and the position of the Heat control sensor, parameter AS05 - **see figure C**
- the Anti-Legionnaire's Disease period is finished

when normal mode and the actual Heat (or Cool) setpoint are restored, except in the event of request/consent for machine operation in ACS mode, for which the machine's behaviour has already been described in detail.
All considerations made with regard to actions adopted during switchovers apply.

N.B. Once the request for ACS heating for Anti-Legionnaire's Disease is exhausted, typically the conditions for having an ACS heating request are not satisfied, but this may occur if the Anti-Legionnaire's Disease period has a limited duration. In this case, normal mode will not be restored but the machine will operate in ACS mode, for which the machine's behaviour has already been described in detail.

Diagram B
Anti-Legionnaire's Disease
DISENGAGE
SETPPOINT REACHED

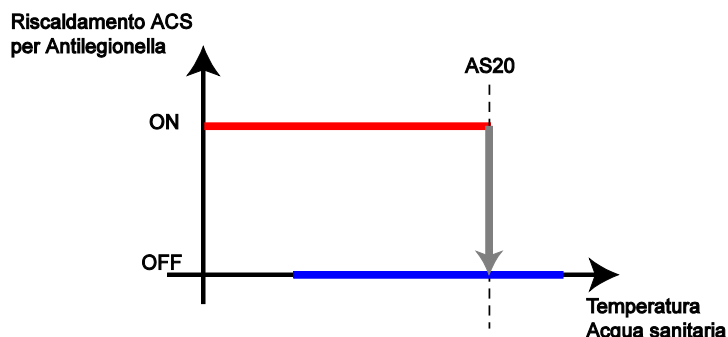


Diagram C
Anti-Legionnaire's Disease
DISENGAGE

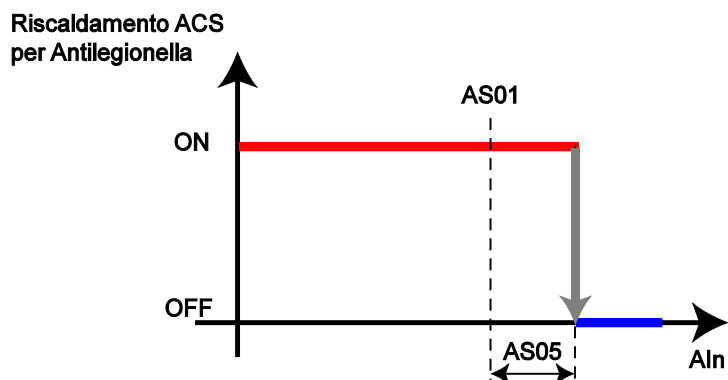


Diagram	Parameter	Description
C	AS05	ACS disengage setpoint differential
B-C	AS20	ACS setpoint for anti-legionnaire's disease
B-C	AS21-AS22	N.B.: with the parameters : AS21 - Minimum ACS setpoint for anti-legionnaire's disease AS22 - Maximum ACS setpoint for anti-legionnaire's disease it is possible to limit the maximum and minimum configuration values of AS20
B	Control sensor	Sanitary water temperature
C	Control sensor AIn	HEAT control sensor


N.B.

Diagram C Case: if the Heat control sensor is disengaged (i.e. the sanitary water did not reach the Anti-Legionnaire's Disease setpoint), the conditions for a new ACS consent for Anti-Legionnaire's Disease may immediately exist. In order to prevent the machine fluctuating between normal mode and ACS for Anti-Legionnaire's Disease mode, there must be a minimum ACS OFF-ON safety time for Anti-legionnaire's disease defined by parameter **AS23 - ACS minimum deactivation/activation time for anti-legionnaire's disease**.

22.4.1 ACS Heater for Anti-Legionnaire's Disease

The ACS heater is regulated in the same way as described for ACS heating, except that: the setpoint adopted is **AS20 - ACS setpoint for anti-legionnaire's disease**

Differential AS07 is cancelled if the unit is in Heat Pump Lock

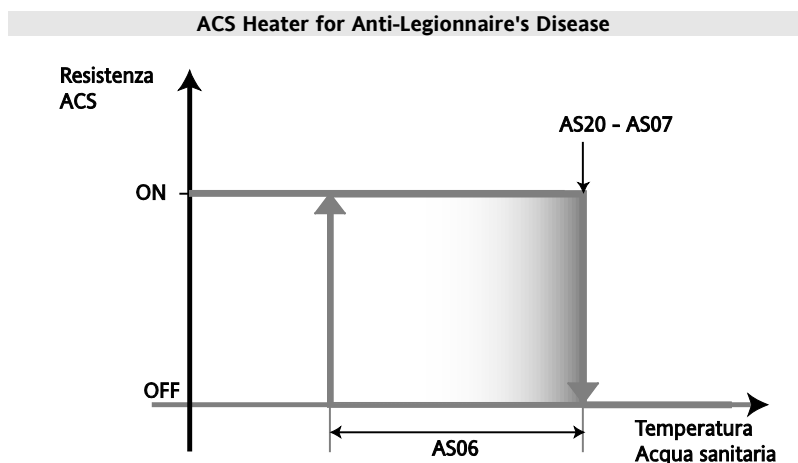


Parameter	Description
AS06	ACS heater hysteresis (for anti-legionnaire's disease)
AS07	ACS heater differential
AS20	ACS setpoint for anti-legionnaire's disease
Control sensor	Sanitary water temperature

22.5 Sanitary Water Antifreeze

In specific situations (e.g. machine in standby) it is necessary to guard against the risk of the ACS water freezing. For this purpose, only the ACS heater (which must be present*) is used and the machine's operation mode is not modified (e.g. if in Cool, it remains in Cool).

* at least one digital input must be configured as ACS Electrical Heater by means of parameters **CL90...CL97 / CL80-CL81 if digital / CL61...CL63 if digital = ±28**.

The heater is regulated on parameter **AS08 - ACS antifreeze setpoint**, as shown in the figure below. The analogue input used for regulation is exclusively the sanitary water temperature

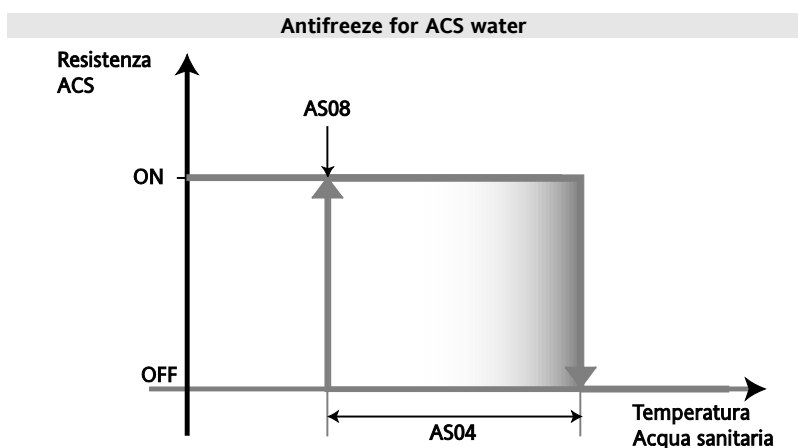

Parameter	Description
AS04	ACS hysteresis
AS08	ACS antifreeze setpoint
Control sensor	Sanitary water temperature

23 BLOCK HEAT PUMP (FOLDER PAR/HP)



The block heat pump function allows for **energy savings** by disabling the heat pump in specific operating conditions, such as:

- when the installation is not working efficiently due to the external temperature (**Block heat pump by external temperature**)
- when on account of specific electricity supply contracts it would be useful to disable the heat pump at peak charge times (**Block heat pump with digital input**)

Block heat pump 1 and 2 parameters table

Parameter	Description	External temperature	Differential External Temperature Set Point	Parameter (analogue input)
Block 1				
HP00	Select probe for block heat pump 1	X (=1)		x
HP01	Heat pump 1 lock setpoint	x		x
HP02	Heat pump 1 lock hysteresis	x		x
HP03	Heat pump 1 lock maximum dynamic differential		x	
HP04	Heat pump 1 lock dynamic differential setpoint		x	
HP05	Heat pump 1 lock dynamic differential proportional band		x	
Block 2				
HP10	Select heat pump lock probe 2	X (=1)		x
HP11	Heat pump 2 lock setpoint	x		x
HP12	Heat pump 2 lock hysteresis	x		x

If the external temperature is too low, heat pump performance will not be acceptable; the following are thus available:

Heat pump lock based on external temperature

Heat pump lock based on external temperature

- set a set point (**HP01 / HP11**) below which the heat pump will be disabled.
- Set the parameters **HP00 / HP10 Select heat pump lock probe 1 / 2 = 1**


Heat pump lock based on regulation temperature

Heat pump lock based on regulation temperature

- set a set point (**HP01 / HP11**) above which the heat pump will be disabled.
- Set the parameters **HP00 / HP10 Select heat pump lock probe 1 / 2 = 1**

Value	Probe	Mode
0	No probe (block pump disabled)	-
1	External temperature	Heating
2	Internal exchanger water/air inlet temperature	Cooling
3	Internal exchanger water/air outlet temperature	Cooling
4	Circuit 1 and 2 internal exchanger water outlet average temperature	Cooling
5	Recovery (or external) exchanger inlet water temperature	Cooling
6	Recovery (or external) exchanger water outlet temperature	Cooling
7	Circuit 1 and 2 external exchanger average temperature	Cooling

N.B.: The Economy LED illuminates with a steady light on the display to indicate heat pump lock (set **UI07 - Standby LED configuration = 2**)

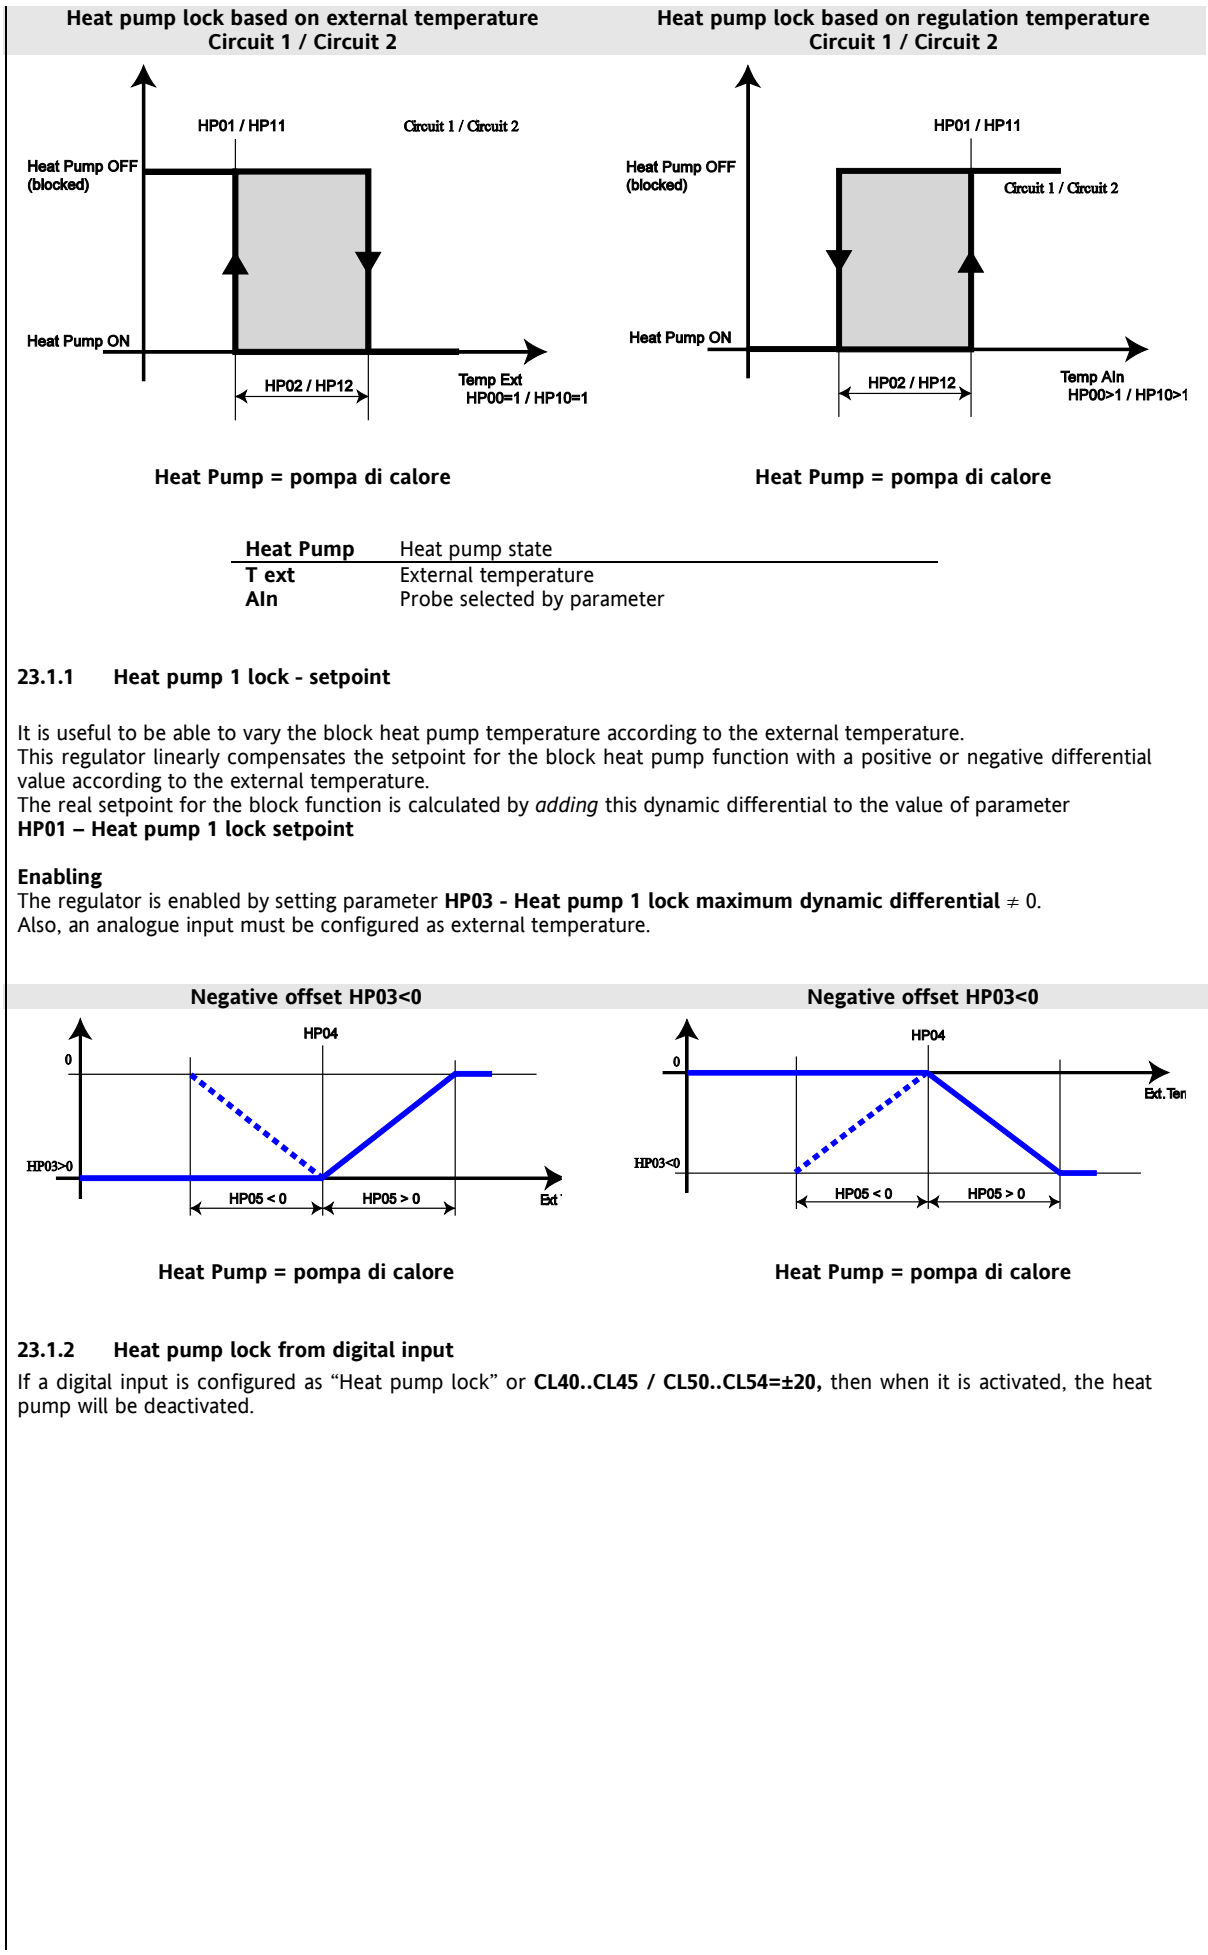

24 FORCED POWER STAGE (FOLDER PAR/PL)

Power limitation parameters can be viewed and set in folder **PL** (see User Interface and Parameters chapters).

24.1 Working modes

The power limitation function:

- protects the machine from high and low temperature situations when used with the temperature control probe;
- protects the machine from high pressure situations, when used with the high pressure probe;
- protects the machine from low pressure situations, when used with the low pressure probe;
- prevents the machine from operating with low efficiency when used with external temperature.

Enabling

- Power limitation **on external temperature*** is enabled by parameter (**PL00** - Power limitation proportional band on external temperature $\neq 0$)
- Power limitation **on temperature*** is enabled by parameter (**PL10** - Power limitation proportional band on water/air temperature $\neq 0$)
- Power limitation **on pressure **** is enabled by parameter (**PL20** - Power limitation proportional band on pressure $\neq 0$)

* The external temperature and temperature power limitation act on the power steps independently of the circuits.

** In the case of machines with two circuits, power limitation is controlled on each circuit separately, as a function of their parameters.

General conditions of operation

Function active in Cool/Heat mode

1. In **Off** the power limitation function is disabled.
2. In **Standby** the power limitation function is disabled.
3. In **On** power limitation acts by switching off the power steps in observance of the set safety timings. The same applies to their turning back on when returning from limitation

N.B.: when limitation is active, no special message indicates this on the display

N.B.: if the control input is not configured or in error, the individual power limitation controllers are disabled. Apart from probe errors, in this situation there is no special indication on the display

Parameter	Parameter	Description	See diagram	
COOL	HEAT		COOL	HEAT
PL00		Power limitation proportional band on external temperature External SETPOINT. COOL temperature		
PL01	PL02	External temperature setpoint for power limitation in Cool / Heat External SETPOINT. HEAT temperature	A A'	B B'
PL11		Power limitation probe selection on water/air temperature	See table, parameter PL11	
PL12		High temperature setpoint for power limitation PL12 High temperature SETPOINT	C	
PL13		Low temperature setpoint for power limitation Low temperature SETPOINT	D	
PL20		Power limitation proportional band on pressure		
PL21		High pressure setpoint for power limitation High Pressure SETPOINT	E E' E''	
PL22		Low pressure setpoint for power limitation Low Pressure SETPOINT	F F' F''	

Table, parameter PL11

Value	Probe
0	No probe (regulator disabled)
1	Internal exchanger water/air inlet temperature
2	Internal exchanger water/air outlet temperature
3	Circuit 1 and 2 internal exchanger water outlet average temperature
4	Recovery (or external) exchanger inlet water temperature
5	Recovery (or external) exchanger water outlet temperature
6	Circuit 1 and 2 external exchanger average temperature

Power limitation - 2 compressors

Diagrams A' B' E' E'' F' F'' represent the inhibition/enabling of two power steps (two compressor machine or power stage compressor).


The pressure or temperature interval between inhibition/enabling of one step and the next depends on the proportional band and the number of resources present in the circuit.

The switching on/off of steps respects the operating logic set.

Power limitation - 4 compressors


The external temperature and temperature power limitation act on the power steps independently of the circuits.

24.2 Power limitation - by external temperature (Cool and Heat)

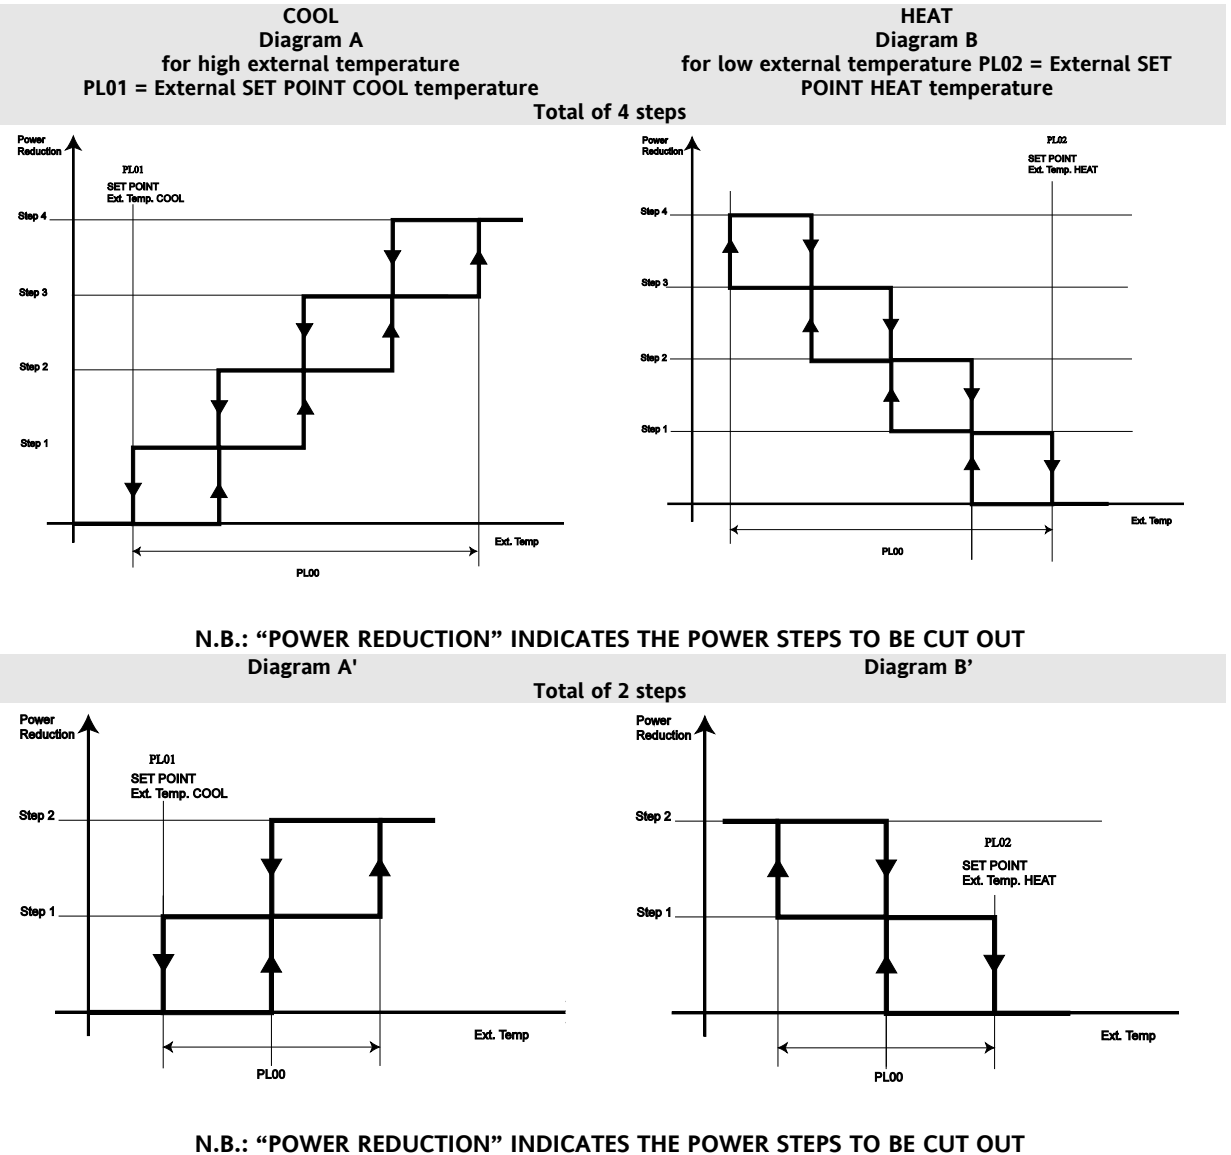

24.3 Power limitation – by temperature (Cool and Heat)


Example of power limitation on temperature in a 4 step machine

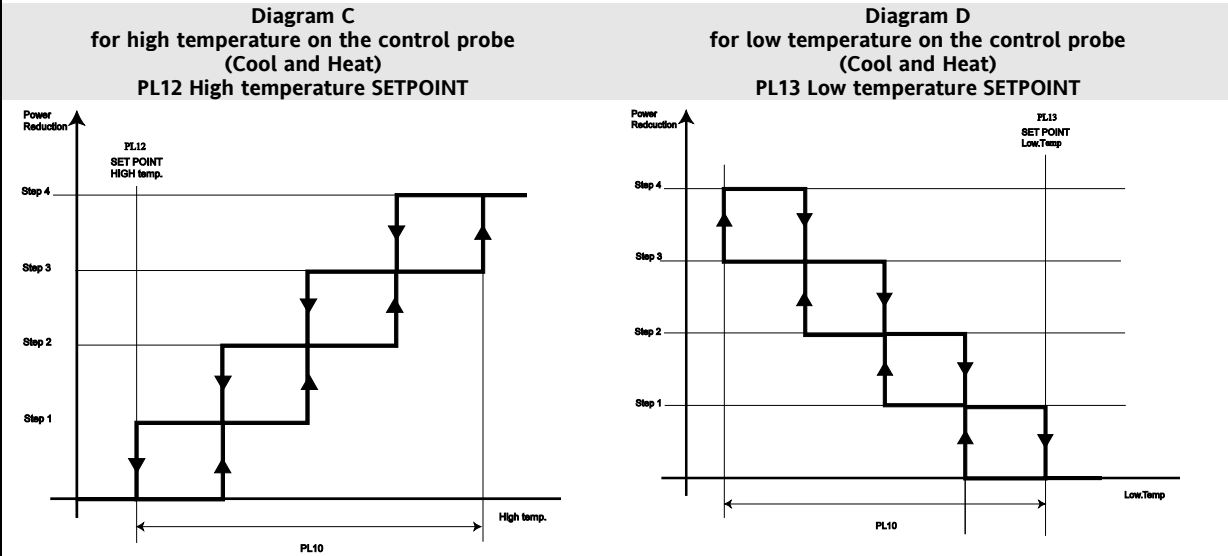

N.B.: “POWER REDUCTION” INDICATES THE POWER STEPS TO BE CUT OUT


24.4 Power limitation - by high pressure probe (Cool and Heat)

Example of power limitation on high pressure in a 4 step/1 circuit machine

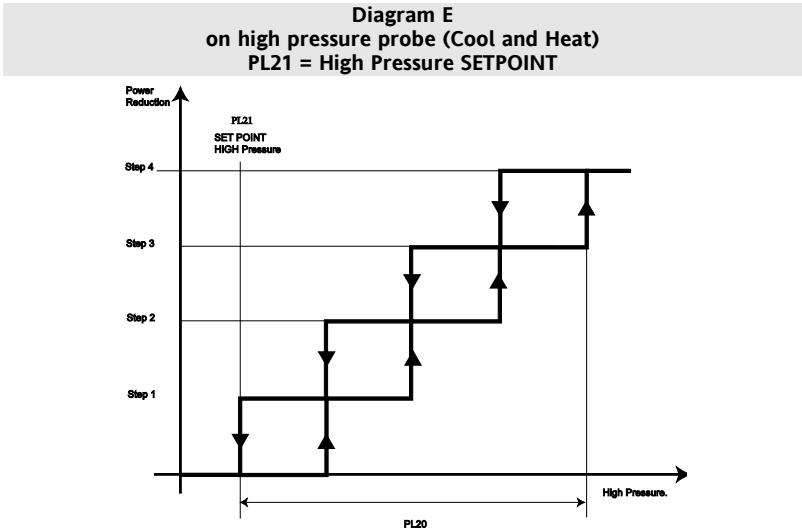


N.B.: "POWER REDUCTION" INDICATES THE POWER STEPS TO BE CUT OUT

Example of power limitation on high pressure in a 2 step/2 circuit machine

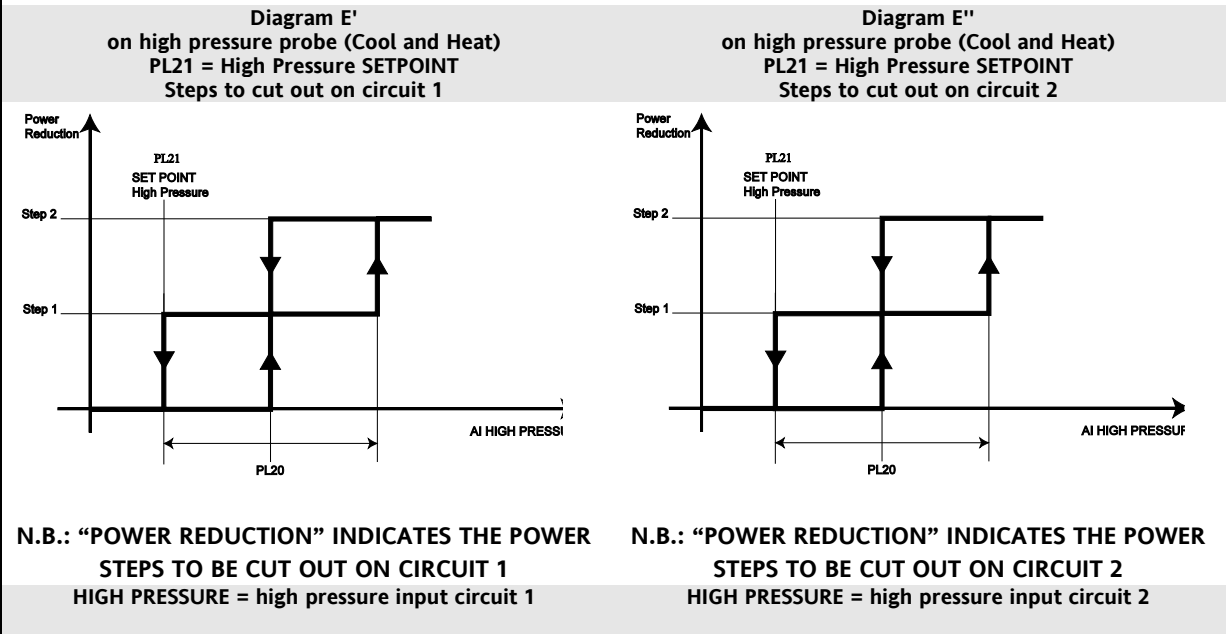


24.5 Power limitation - by low pressure probe (Cool and Heat)

Example of power limitation on low pressure in a 4 step/1 circuit machine

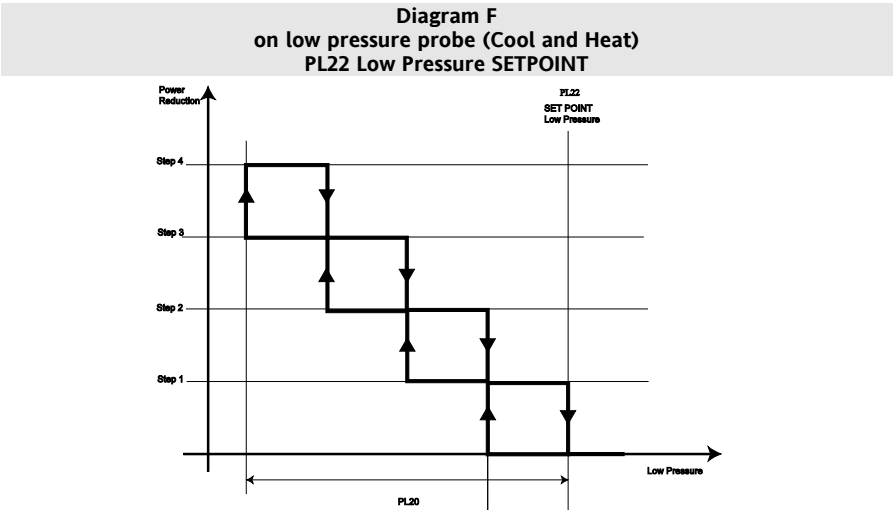

N.B.: “POWER REDUCTION” INDICATES THE POWER STEPS TO BE CUT OUT

Example of power limitation on low pressure in a 2 step/2 circuit machine

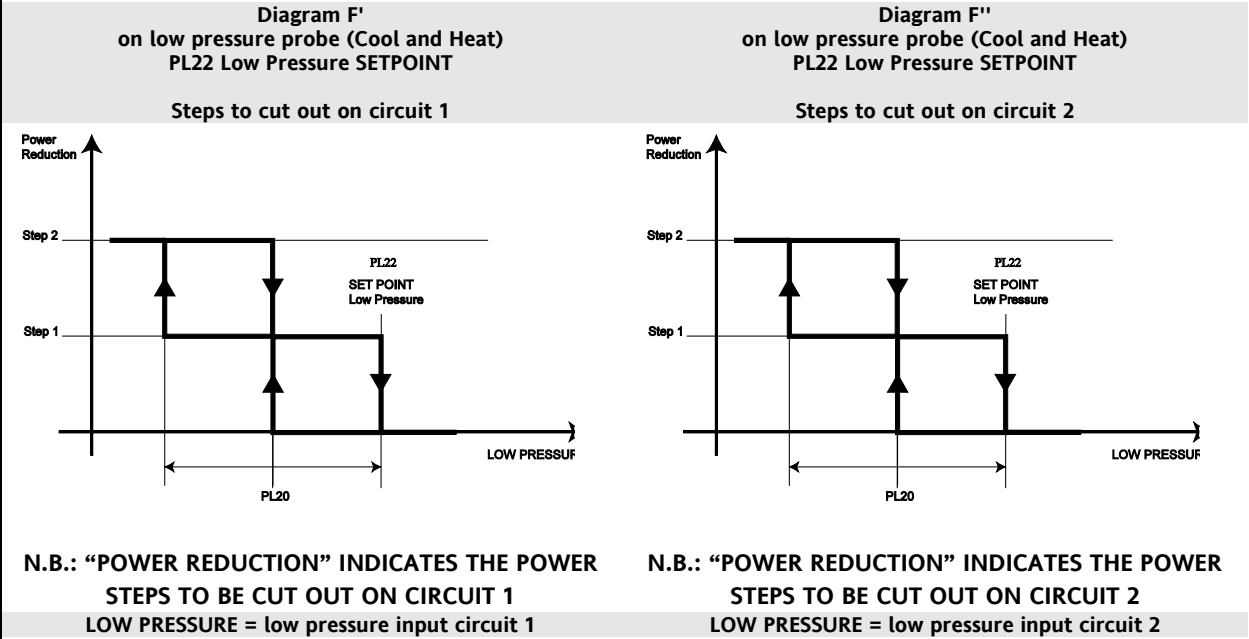

24.6 Power limitation to 50%

Function enabled by configuring

- a digital input as 50% power limitation or by setting one of parameters CL40...CL45 = ± 1
- or an analogue input when configured as digital input CL46...CL54 = ± 1

Activating the digital input halves the availability of power steps, thus reducing energy consumption.

Power limitation to 50% is independent of the forced power stages described above

The limitations act in parallel, and the number of steps limited is the maximum of the two limitation functions

With the SB600 this results in a large number of possible situations: the first column shows the power steps *normally* available (without alarms or blocks, a value which depends exclusively on how the SB600 is *configured*, not on the particular situation at any given time), while the second column shows the residual power steps with 50% power limitation active.

Number of power steps <i>configured</i>	Number of power steps available with <i>limitation to 50% active</i>	Notes
1	1	No effect
2	1	
3	2	
4	2	

By step we mean the power equivalent of a compressor power stage; the selection of the step is subordinate to the compressor controller mechanism (e.g. limitation to 50% makes no distinction between the power stages of different circuits).

In other words, the selection of which power step to turn off is made by the power stage on/off logic described in the chapter Compressors.

Example 1

SB device configured with two power steps, one per circuit (= one compressor per circuit): the activation of the input has no effect if only one compressor is running at the time; if the input stays active, it will affect any request for activation of the compressor of the other circuit (it will impede it).

Example 2

SB device configured with four power steps (one power stage compressor per circuit): activation of the input has no effect if only 1 or 2 power stages are active at the time (whether both or only one compressor is running), as for the previous example. It will have an effect if 3 or 4 power stages are active and 1 or 2 steps are turned off according to the compressor controller logic (either both compressors or only one remains active).

As for other forms of limitation, the step off/on sequence is subordinate to the safety timings.

The function has no effect on other resources, and is not indicated on the display in any way.

25 TIME BANDS (FOLDER PAR/TE)

SBW600 allows for differentiated operation based on the time and the days of the week.

In fact, you can “define” time bands (e.g. in order to save energy at night, when less energy is requested by the system), by programming specific “profiles” and “events” throughout the course of the week.

You can define the hour and minute of each event, at which point a new “time band” triggers the activation of a specific mode (ON or STANDBY) and specific Cool / Heat setpoints.

The Time Band control parameters can be viewed and configured in the **tE** folder (see User interface section and Parameters section).

Enabling

The function may be enabled using parameter **tE00 - Enable time band operation**.

		Parameter	Description	
			0	1
Enabling	tE00	Enable time band operation	Time bands disabled	Time bands enabled

General conditions of operation

- **tE00 - Enable time band operation = 1**
- The RTC must be present (**models /C**)
- The time must be checked first and adjusted if necessary (see the chapter entitled How to set the clock (CL), in the User Interface section (folder PAR/UI)).

N.B.: This DOES NOT affect the Heat/Cool mode change or even the system / ACS mode change but only the Cool and Heat setpoint values defined by the indicated parameters, as well as the mode change from ON to STANDBY and vice versa.

The mode change procedure always occurs in accordance with the basic regulation times and rules.

Time Band Operation

Up to 3 profiles are available for each day of the week. They may be selected from the following parameters:

Parameter	Description	1	2	3
tE01	day 1 (Monday)	Profile 1	Profile 2	Profile 3
tE02	day 2 (Tuesday)	Profile 1	Profile 2	Profile 3
tE03	day 3 (Wednesday)	Profile 1	Profile 2	Profile 3
tE04	day 4 (Thursday)	Profile 1	Profile 2	Profile 3
tE05	day 5 (Friday)	Profile 1	Profile 2	Profile 3
tE06	day 6 (Saturday)	Profile 1	Profile 2	Profile 3
tE07	day 7 (Sunday)	Profile 1	Profile 2	Profile 3

Up to 4 events can be associated with each profile – see the following table:

Description	Description	Profile 1	Profile 2	Profile 3
EVENT 1		tE10..tE15	tE38..tE50	tE66..tE71
	Hour / Minutes	tE10..tE11	tE38..tE39	tE66..tE67
	ON/Standby operating mode	tE12	tE40	tE68
	Cool setpoint	tE13	tE41	tE69
	Heat setpoint	tE14	tE42	tE70
	ACS setpoint	tE15	tE43	tE71
EVENT 2		tE17..tE22	tE45..tE50	tE73..tE78
	Hour / Minutes	tE17...tE18	tE45..tE46	tE73..tE74
	ON/Standby operating mode	tE19	tE47	tE75
	Cool setpoint	tE20	tE48	tE76
	Heat setpoint	tE21	tE49	tE77
	ACS setpoint	tE22	tE50	tE78
EVENT 3		tE24..tE29	tE52..tE57	tE80..tE85
	Hour / Minutes	tE24...tE25	tE52..tE53	tE80..tE81
	ON/Standby operating mode	tE26	tE54	tE82
	Cool setpoint	tE27	tE55	tE83
	Heat setpoint	tE28	tE56	tE84
	ACS setpoint	tE29	tE57	tE85
EVENT 4		tE31..tE36	tE59..tE64	tE87..tE92
	Hour / Minutes	tE31...tE32	tE59..tE60	tE87..tE88
	ON/Standby operating mode	tE33	tE61	tE89
	Cool setpoint	tE34	tE62	tE90
	Heat setpoint	tE35	tE63	tE91
	ACS setpoint	tE36	tE64	tE92

ACS = Sanitary water

Each event will have:

- A start time defined by 2 parameters:
 - o Event start time
 - o Event stop time
- Operating mode
 - o ON
 - o Stand-by

SBW600 will enter ON or standby when the time coincides with the start of the time band

- Cool mode temperature controller setpoint
- Heat mode temperature controller setpoint
- Sanitary Water setpoint

The Cool mode setpoint will be active with SBW600 in Cool mode when the time coincides with the predefined event (start of the time band).

Similarly, the Heat mode setpoint will be active with SBW600 in Heat mode when the time coincides with the start of the time band.

N.B.: the SBW600 device does NOT change mode but will use the setpoints indicated if in Cool/Heat mode.

26 ALARMS AND TROUBLESHOOTING (FOLDER PAR/AL)

Alarms

The "Energy SBA600" performs full installation diagnostics and reports a variety of alarms.

Parameters for alarm activation and resetting can be viewed and configured in folder **AL (parameters AL00...AL82)** (see User Interface and Parameters section).

Automatic reset

Automatic reset

For automatic reset alarms, normal operation is restored as soon as the cause of the alarm has been removed.

Manual reset

Manual reset

Alarms can be manually reset by pressing and releasing the [UP + DOWN] keys

Normal operation can only be reset

- by pressing a key on the instrument keyboard and
- only if the cause of the alarm has been removed.



Alarm mute

Alarms can be acknowledged by pressing any key.

N.B.: acknowledging an alarm has no effect on the alarm generated other than on the alarm LED, which goes from fixed to flashing.

An alarm has two effects:

- It blocks the services concerned
- Message on the keyboard display alternates with a message on the main display

The next two sections summarize alarms grouped by type (digital or analogue).

Alarm code and alarm parameters are in bold (folder PAr/AL)

For some alarms, the signal can be excluded for a preset interval, set in the relative parameter.

Number of trips

The number of interventions per sampling period is defined in parameter **AL00 – Time interval in which alarm events are counted.**

Number of trips


For some alarms, the number of events occurring are counted: if, in a period of time defined in **AL00** a threshold set in a parameter is exceeded, the alarm changes from automatic to manual reset.

Alarms are counted every $AL00/32$ (minutes) = sampling time.

AL00 and hence also $AL00/32$ is expressed in minutes.

Example: **AL10-High pressure alarm circuit 1**: if the number of events per hour is set to **AL10**, for the alarm to change from automatic to manual reset, the count must reach the number set in **AL10**.

Example AL10=3

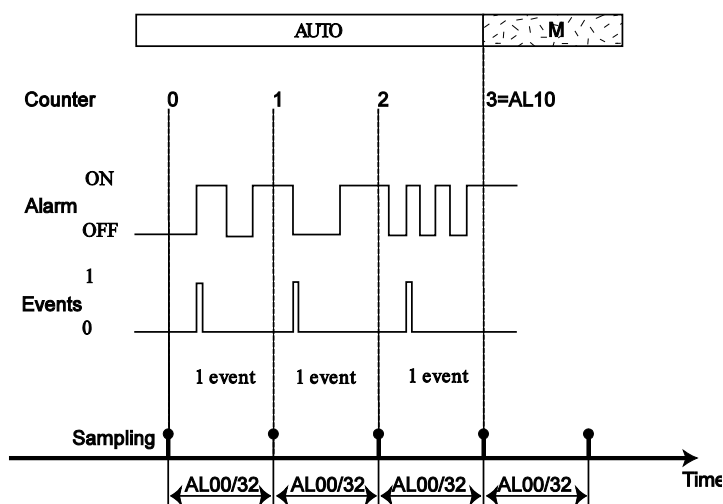

			Event =No. Events
A: automatic reset	Sampling	$AL00/32$ sampling time	1
M: manual reset	Time: time		2
	Alarm: alarm		3 (=AL10)

N.B.:

- if, during the sample time $AL10/32$ several alarm events of the same type occur (e.g. **High pressure alarm circuit 1**), only 1 event will be counted.
- If the alarm condition is active for several sample times, only 1 event is counted.
- If the alarm event is active for a period greater than **AL00**, the counter resets to zero.

Alarm code	Name of alarm	Bypass activation event	Bypass time	Automatic alarm activation time	Manual alarm activation time	Exit alarm deactivation time	Number of interventions per sample time
E001	Circuit 1 high pressure alarm	None	not present	not present	not present	not present	AL10
E002	Circuit 2 high pressure alarm	None	not present	not present	not present	not present	AL10
E005	Circuit 1 low pressure alarm	Circuit compressor activated or reversal of 4-way valve (NOTE 1) (NOTE 4)	AL11 (NOTE 4)	not present	not present	not present	AL12
E006	Circuit 2 low pressure alarm	Circuit compressor activated or reversal of 4-way valve (NOTE 1) (NOTE 4)	AL11 (NOTE 4)	not present	not present	not present	AL12
E020 (NOTE 2)	Primary circuit flow switch alarm	Internal circuit pump activation (One of the two pumps)	AL14	AL15	AL16	AL15	not present
E025 (NOTE 3)	Primary circuit pump thermal switch alarm	External circuit pump activation	AL17	AL18	AL19	AL18	not present
E010	Compressor 1 thermal switch	Compressor 1 switched on	AL20	not present	not present	not present	AL21
E011	Compressor 2 thermal switch	Compressor 2 switched on	AL20	not present	not present	not present	AL21
E012	Compressor 3 thermal switch	Compressor 3 switched on	AL20	not present	not present	not present	AL21
E013	Compressor 4 thermal switch	Compressor 4 switched on	AL20	not present	not present	not present	AL21
E015 (NOTE 2)	Compressor 1 oil pressure switch	Compressor 1 switched on	AL22	not present	not present	Not present	AL23
E016 (NOTE 2)	Compressor 2 oil pressure switch	Compressor 2 switched on	AL22	not present	not present	Not present	AL23
E017 (NOTE 2)	Compressor 3 oil pressure switch	Compressor 3 switched on	AL22	not present	not present	Not present	AL23
E018 (NOTE 2)	Compressor 4 oil pressure switch	Compressor 4 switched on	AL22	not present	not present	Not present	AL23
Er40	Primary exchanger fan thermal switch	None	not present	not present	not present	Not present	AL24
Er41	External exchanger fan thermal switch Circuit 1	None	not present	not present	not present	Not present	AL25
Er42	External exchanger fan thermal switch Circuit 2	None	not present	not present	not present	Not present	AL25
E021	Primary circuit pump 1 thermal switch	None	not present	Not present	not present	Not present	AL26
E022	Primary circuit pump 2 thermal switch	None	not present	Not present	not present	Not present	AL26
E026	Disposable circuit pump thermal switch	None	not present	Not present	not present	Not present	AL27
E050	Primary exchanger electric heater 1 thermal switch	None	Not present	Not present	not present	Not present	not present
E051	Primary exchanger electric heater 2 thermal switch	None	Not present	Not present	not present	Not present	not present

Alarm code	Name of alarm	Bypass activation event	Bypass time	Automatic alarm activation time	Manual alarm activation time	Exit alarm deactivation time	Number of interventions per sample time
	thermal switch						
E056	Auxiliary output alarm	None	Not present	Not present	not present	Not present	not present

(NOTE 1) The bypass is activated by the reversal of the 4-way valve only if at least one compressor is on

(NOTE 2) The alarm is enabled only if the associated resource (e.g. a given compressor or pump) is active

(NOTE 3) The alarm is enabled only if the associated resource (e.g. specific compressor or specific pump) is active only in heating mode.

(NOTE 4) The alarm is enabled only if the associated resource (e.g. specific compressor or specific pump) is active only in heating mode.

(NOTA 4) Low pressure digital alarm related to dedicated circuit is not active if Pump-down valve of the relevant circuit is active (valve closed, Pump-down ongoing, and after CP33 time after desactivation)

**if CP33 is $\neq 0$ (pump down enabled), bypass AL11 must be $\neq 0$


26.1.1.1 Flow switch alarm

Management of digital flow switch alarms E020 & E025 differs from that of other digital alarms: alarm events are not considered, only the activation time of the digital input is taken into account. See the following examples
N.B. The external circuit flow switch alarm is not active in Cool.

Example of external circuit pump automatic reset flow switch alarm


Alarm generated with activation of digital input D.I. during bypass; the count **AL15 - Flow switch activation time for internal circuit automatic alarm**

only starts when **AL14 - Low switch bypass time after internal circuit water pump enabled** is decremented to 0.

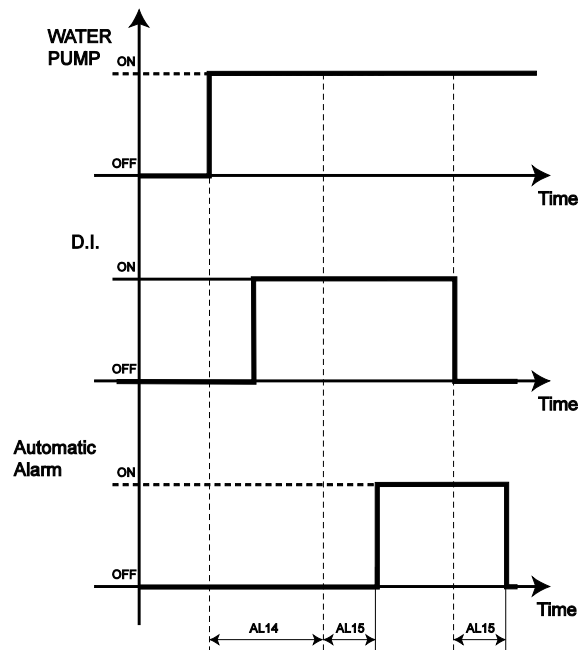

Example 2 of external circuit pump automatic reset flow switch alarm


Alarm generated with start of next alarm event after the bypass has elapsed

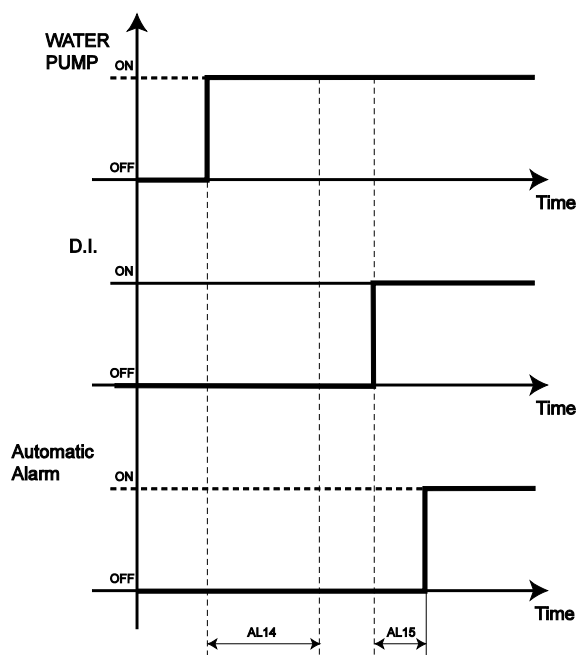

Example of external circuit pump manual reset flow switch alarm

AL15 - Flow switch activation/deactivation time on internal circuit automatic alarm

AL16 - Enable flow switch time for primary circuit manual alarm

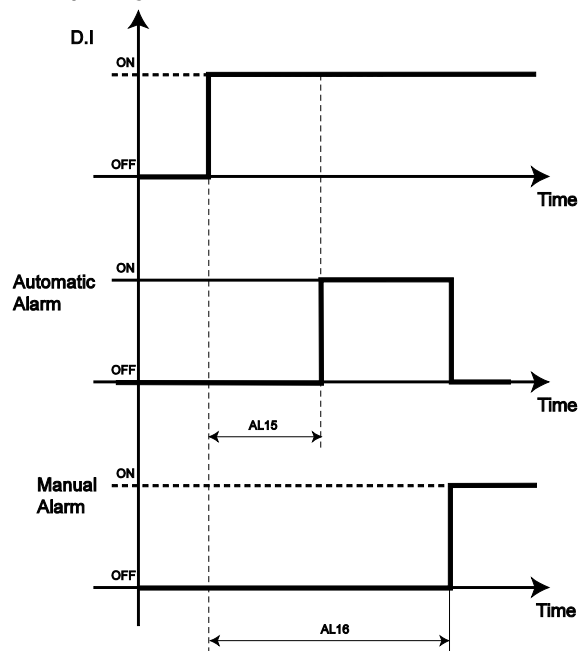

Analogue alarms

26.1.2 Analogue alarms

NOTES

(NOTE 1) If No. trips = 1, the alarm is always manual reset type.

(NOTE 2) Alarm bypass is active in heating mode only.

(NOTE 3) An offset of 6°C (value cannot be changed) is added to the activation setpoint AL51 during the defrost stage.

Alarm code	Name of alarm	Bypass activation event	Bypass time	SET activation	Hysteresis	Automatic alarm time (NOTE 1)	No. of trips	Control Probe
E003	Circuit 1 analogue high pressure alarm	None	None	AL40	AL41	Not present	AL42	Circuit 1 high pressure probe
E004	Circuit 1 analogue high pressure alarm	None	None	AL40	AL41	Not present	AL42	Circuit 1 high pressure probe
E007	Circuit 1 analogue low pressure alarm	A circuit 1 compressor is switched on or reversal of the 4-way valve	AL43	AL44	AL45	Not present	AL46	Circuit 1 low pressure probe
E008	Circuit 2 analogue low pressure alarm	A circuit 2 compressor is switched on or reversal of the 4-way valve	AL43	AL44	AL45	Not present	AL46	Circuit 2 low pressure probe
E030	Primary circuit antifreeze	On/Off (local or remote), input in heat mode (NOTE 2)	AL50	AL51 (NOTE 3)	AL52	Not present	A53	Internal exchanger water/air outlet temperature
E031	External circuit antifreeze	On/Off (local or remote), input in heat mode (NOTE 2)	AL54	AL55	AL56	Not present	A57	External exchanger outlet water temperature
E032	“Vacuum” circuit 1	None	None	AL59	AL60	AL58	manual reset	Low pressure input circuit 1
E033	“Vacuum” circuit 2	None	None	AL59	AL60	AL58	manual reset	Low pressure input circuit 2
E035	High temperature	None	None	AL47	AL48	AL49	Automatic reset	Internal exchanger water/air outlet temperature

26.1.3 Vacuum alarm

Enabling

An analogue input shall be set as “Low pressure input circuit 1”. (value **23**)


For 2 circuit plants an analogue input shall be set as e “Low pressure input circuit 2”. (value **24**)

General conditions of operation

Manual reset only.

The alarm is delayed by a time set by AL58 - Activation time of low pressure alarm from analog input, regardless of the compressors from power on (and / or the valve pump-down deactivation) of the specific circuit.

The activation is associated with the AL59 - Setpoint of vacuum alarm regulator from analog input and AL60- Hysteresis of vacuum alarm regulator from analog input.

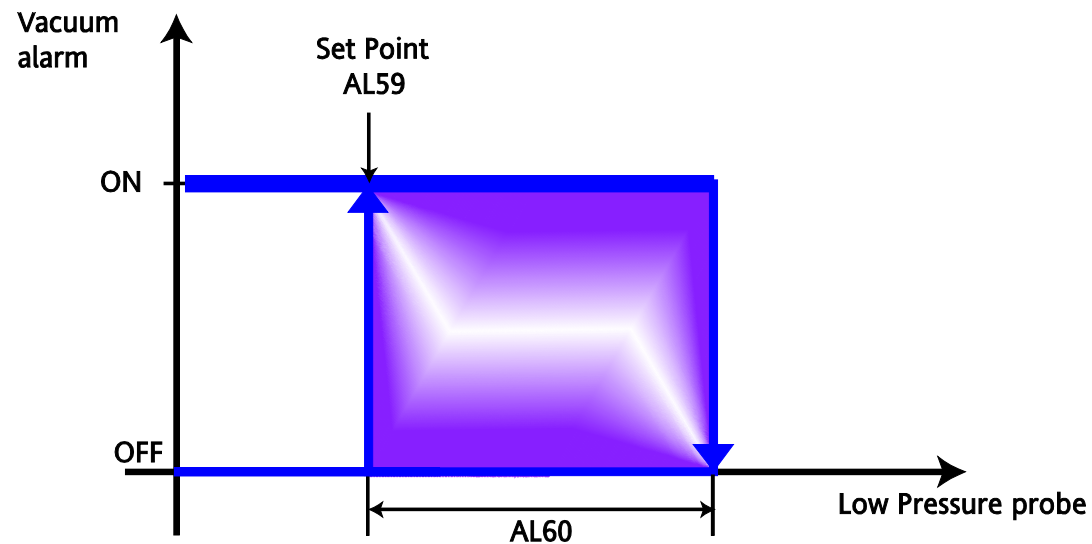

Notes.

If probe / probes are in error, unit will be blocked.

The vacuum alarm has the same effects of low pressure alarm, exclusively on the corresponding circuit. Compared to the alarm low pressure, typically this alarm has lower setpoint and acts with different timing.

26.1.4 Alarms Table

- The alarm signal consists of a code, the format being “E0nn” (nn is a 2-figure number identifying the type of alarm, e.g. E000, E025, E039...).
- In the case of multiple simultaneous alarms only the one with the lowest code will be displayed (e.g. simultaneous alarms E000 and E001). The display will show only E000 alternated with the main display page
- If the measurement on the main display is incorrect, in the event of an alarm, the alternate alarm code will alternate with “----”.

All possible alarms are listed in the table below with their respective codes and the relative utilities blocked:

Alarm table key

column	Alarm code	Name of alarm	notes
	N.B.: the codes are shown in ascending order (E000, E001) but there may be some gaps (there is no E006)		
alarm	CMP 1/2 PUMP 1/2 D A	Compressor 1/power step 2 Pump 1/2 digital input	
Reset	AUTO OFF COMP1 OFF COMP2 OFF COMP3 OFF COMP4	automatic OFF compressor 1 OFF compressor 2 OFF compressor 3 OFF compressor 4	
UTILITY	OFF (1) OFF (2) OFF RES1 OFF RES2	When used for temperature control When used for temperature control and/or antifreeze OFF heater 1 OFF heater 2	

Alarms Table

Alarms Table

Alarm Code	Name of Alarm	Notes	Digital/Analogue	Alarm type	SANITARY WATER VALVE	SANITARY WATER HEATER	COMPRESSORS	EXTERNAL EXCHANGER FAN	RECIRCULATION FAN	INTERNAL CIRCUIT PUMP	EXTERNAL CIRCUIT PUMP	INTERNAL EXCHANGER HEATERS	EXTERNAL EXCHANGER HEATERS	OUTPUT AUXILIARY	BOILER
E000	General alarm		D	AUTO	OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF	OFF
E001	Circuit 1 digital high pressure		D	Events			OFF (1)								
E002	Circuit 2 digital high pressure		D	Events			OFF (1)								
E003	Circuit 1 analogue high pressure		A	Events			OFF (1)								

Alarm Code	Name of Alarm	Notes	Digital/Analogue	Alarm type	SANITARY WATER VALVE	SANITARY WATER HEATER	COMPRESSORS	EXTERNAL EXCHANGER FAN	RECIRCULATION FAN	INTERNAL CIRCUIT PUMP	EXTERNAL CIRCUIT PUMP	INTERNAL EXCHANGER HEATERS	EXTERNAL EXCHANGER HEATERS	OUTPUT AUXILIARY	BOILER
E004	Circuit 2 analogue high pressure		A	Events			OFF (1)								
E005	Circuit 1 digital low pressure		D	Events			OFF (1)	OFF (2)	OFF						
E007	Circuit 1 analogue low pressure		A	Events			OFF (1)	OFF (2)	OFF						
E008	Circuit 2 analogue low pressure		A	Events			OFF (1)	OFF (2)	OFF						
E009	Machine low charge		A	Events			OFF	OFF (2)	OFF						
E010	Compressor 1 thermal switch	CMP 1	D	Events			OFF COMP1								
E011	Compressor 2 thermal switch	CMP 2	D	Events			OFF COMP2								
E012	Compressor 3 thermal switch	CMP 3	D	Events			OFF COMP3								
E013	Compressor 4 thermal switch	CMP 4	D	Events			OFF COMP4								
E015	Compressor 1 oil pressure switch	CMP 1	D	Events			OFF COMP1								
E016	Compressor 2 oil pressure switch	CMP 2	D	Events			OFF COMP2								
E017	Compressor 3 oil pressure switch	CMP 3	D	Events			OFF COMP3								
E018	Compressor 4 oil pressure switch	CMP 4	D	Events			OFF COMP4								
E020	Primary circuit flow switch		D	Time	OFF for manual reset alarm		OFF	OFF		OFF for manual reset alarm		OFF			OFF
E021	Primary circuit pump 1 thermal switch	Pump 1	D	Events			OFF (3)	OFF (3)		OFF Pump 1		OFF (3)			OFF (3)
E022	Primary circuit pump 2 thermal switch	Pump 2	D	Events			OFF (3)	OFF (3)		OFF Pump 2		OFF (3)			OFF (3)
E025	External circuit flow switch		D	Time			OFF	OFF if alarm with manual reset			OFF for manual reset alarm		OFF		
E026	Disposable circuit pump thermal switch		D	Events			OFF				OFF		OFF		
E030	Primary circuit antifreeze		A	AUTO			OFF	OFF							
E031	External circuit antifreeze		A	AUTO			OFF	OFF							
E032	Vacuum circuit 1		A	Manual			OFF (1)	OFF (2)	OFF						
E033	Vacuum circuit 2		A	Manual			OFF (1)	OFF (2)	OFF						

Alarm Code	Name of Alarm	Notes	Digital/Analogue	Alarm type	SANITARY WATER VALVE	SANITARY WATER HEATER	COMPRESSORS	EXTERNAL EXCHANGER FAN	RECIRCULATION FAN	INTERNAL CIRCUIT PUMP	EXTERNAL CIRCUIT PUMP	INTERNAL EXCHANGER HEATERS	EXTERNAL EXCHANGER HEATERS	OUTPUT AUXILIARY	BOILER
E035	High temperature		A	AUTO			OFF								
E040	Primary exchanger fan thermal switch		D	Events			OFF		OFF			OFF			
E041	Circuit 1 external heat exchanger fan thermal switch		D	Events			OFF (2)	OFF (1)					OFF (2)		
E042	Circuit 2 external heat exchanger fan thermal switch		D	Events			OFF (2)	OFF (1)					OFF (2)		
E045	Faulty clock			AUTO											
E046	Time lost			AUTO											
E047	LAN communication absent			AUTO											
E048	Anti-legionnaires alarm			AUTO											
E050	Primary exchanger electric heater 1 thermal switch		D	AUTO								OFF RES.1			
E051	Primary exchanger electric heater 2 thermal switch		D	AUTO								OFF RES.2			
E056	Auxiliary output thermal switch		D	AUTO										OFF	
E060	Primary exchanger water or air input temperature probe faulty			AUTO	See Probe Errors Table										
E061	Primary exchanger water or air output temperature probe faulty, and/or Circuit 1 primary exchanger water outlet temperature probe faulty, and/or Circuit 2 primary exchanger water outlet temperature probe faulty			AUTO	See Probe Errors Table										
E062	Circuit 1 external exchanger temperature probe faulty, and/or Circuit 2 external exchanger temperature probe faulty			AUTO	See Probe Errors Table										
E063	Faulty disposable exchanger water or air input temperature probe			AUTO	See Probe Errors Table										
E064	Faulty disposable exchanger water or air output temperature probe			AUTO	See Probe Errors Table										
E065	Faulty ambient temperature probe			AUTO	See Probe Errors Table										
E066	Sanitary water temperature probe faulty			AUTO	See Probe Errors Table										

Alarm Code	Name of Alarm	Notes	Digital/Analogue	Alarm type	SANITARY WATER VALVE	SANITARY WATER HEATER	COMPRESSORS	EXTERNAL EXCHANGER FAN	RECIRCULATION FAN	INTERNAL CIRCUIT PUMP	EXTERNAL CIRCUIT PUMP	INTERNAL EXCHANGER HEATERS	EXTERNAL EXCHANGER HEATERS	OUTPUT AUXILIARY	BOILER
E067	Faulty display probe (temperature / pressure)			AUTO	See Probe Errors Table										
E068	Faulty external temperature probe			AUTO											
E069	Faulty circuit 1 high pressure transducer or Faulty circuit 2 high pressure transducer			AUTO	See Probe Errors Table										
E070	Faulty circuit 1 low pressure transducer Faulty circuit 2 low pressure transducer			AUTO											
E071	Faulty compressor 1 discharge temperature probe			AUTO											
E073	Faulty dynamic setpoint input			AUTO											
E074	Faulty primary heat exchanger transducer circuit 1, and/or Faulty primary heat exchanger transducer circuit 2			AUTO	See Probe Errors Table										
E075	Faulty disposable exchanger transducer circuit 1, and/or Faulty disposable exchanger transducer circuit 2			AUTO	See Probe Errors Table										
E080	Configuration error			AUTO	OFF	OFF									
E081	Compressor operating hours exceeded (*)	CMP		Manual											
E085	Primary circuit pump operating hours exceeded (*)	PUMP		Manual											
E086	External circuit pump operating hours exceeded (*)	PUMP		Manual											
E090	Alarm log full warning			Manual											

(*)It will be possible to configure a digital output as Operating hours exceeded (value = ± 29), which will be activated when at least one of these alarms trips

(1) the resources of the associated circuit are switched off

(2) the resources of the associated circuit are switched off if separate condensation, all resources if single condensation. In digital and analogue low pressure alarms, the external exchanger fans are switched off only if the alarm is of the manual reset type

(3) if the device is configured for two internal water pumps, the resources are switched off only if both thermal switch alarms (pump 1 and pump 2) are active

26.1.5 XVD driver alarms

The XVD alarms are managed locally by each driver and they are signalled and recorded by the master SBA controller
The alarm codes are divided up as follows:

Alarm Code SBA	
E1xx	XVD1
E2xx	XVD2

Alarm Code	Name of Alarm	Type alarm	COMPRESSORS CIRCUIT 1	Part Number Alarm	Name of Alarm	Type alarm	COMPRESSORS CIRCUIT 2
E101	Input error dA/1 EEV1	AUTO		E201	Input error dA/1 EEV2	AUTO	
E102	Input error dA/2 EEV1	AUTO		E202	Input error dA/2 EEV2	AUTO	
E103	Input error dA/3 EEV1	AUTO		E203	Input error dA/3 EEV2	AUTO	
E104	Input error dA/4 EEV1	AUTO		E204	Input error dA/4 EEV2	AUTO	
E105	Valve EEV1 overheating probe (1rE1)	AUTO		E205	Valve EEV2 overheating probe (2rE1)	AUTO	
E106	Valve EEV1 saturation probe (1rE2)	AUTO		E206	Valve EEV2 saturation probe (2rE2)	AUTO	
E107	Alarm MOP XVD1	AUTO		E207	Alarm MOP XVD2	AUTO	
E108	XVD1 maximum valve opening alarm	AUTO		E208	XVD2 maximum valve opening alarm	AUTO	
E109	External alarm XVD1	AUTO		E209	External alarm XVD2	AUTO	
E110	NOLINK alarm XVD1	AUTO		E210	NOLINK alarm XVD2	AUTO	
E111	Motor protection alarm XVD1: current consumption too high	MANUAL	OFF	E211	Motor protection alarm XVD2: current consumption too high	MANUAL	OFF
E112	Motor protection alarm XVD1: winding 1 not connected	MANUAL	OFF	E212	Motor protection alarm XVD2: winding 1 not connected	MANUAL	OFF
E113	Motor protection alarm XVD1: winding 1 short-circuited	MANUAL	OFF	E213	Motor protection alarm XVD2: winding 1 short-circuited	MANUAL	OFF
E114	Motor protection alarm XVD1: winding 2 not connected	MANUAL	OFF	E214	Motor protection alarm XVD2: winding 2 not connected	MANUAL	OFF
E115	Motor protection alarm XVD1: winding 2 short-circuited	MANUAL	OFF	E215	Motor protection alarm XVD2: winding 2 short-circuited	MANUAL	OFF

N.B.: switch off driver XVD and switch it on again for a manual reset

26.1.5.2 XVD driver probe errors

Label		Cause	Effect	Solution
E101 E201	Probe AI1 faulty	Measured values are outside the nominal range	Report only if the relative backup probe is configured AI2 ---	Check the probe wiring ---
		Regulating probe faulty/short-circuited/open	If this is not done see E106 ---	Replace probe. ---
E102 E202	Probe AI2 faulty		Same as E101 (probe dAi1).	when the error condition ceases, regulation continues normally
E103 E203	Probe AI3 faulty	Same as E101	Report only. if the relative backup probe is configured AI4 ---	Same as E101
			If this is not done see E105 Same as E101 (probe Ai3)	
E104 E204	Probe 1AI4 faulty			
E105 E205	Evaporator outlet probe error (1rE1) Evaporator outlet probe error (2rE1)	Probes AI3 AI4 are both in error	% valve opening =dE16. Example dE50= 0	
E106 E206	Gas saturation probe error (1rE2) Gas saturation probe error (2rE2)	Probes AI1, AI2 are both in error	% valve opening =dE16. --- Example dE50= 1 Valve closed	

26.1.5.3 XVD driver alarms

Label	Cause	Effect	Solution
E107 Alarm MOP XVD1	Saturation temperature > MOP setpoint (dE52) for longer than dE53.	Only if dE50=1	Wait for return Saturation temperature < dE52
E108 XVD1 maximum valve opening alarm	% maximum valve opening $drE7 \geq dE10$ for longer than dE13.	Valve closed	Wait for return % maximum opening of valve $drE7 < dE10$
E109 External alarm XVD1	Activation of digital input configured as external alarm. See paragraph dL40/dL41=±3	Report only.	Deactivation of digital input set as external alarm
E110 NOLINK alarm XVD1	Serial communication failed	Valve closed	Restore communication.
E111 Motor protection alarm XVD1: current consumption too high	Current consumption too high	Valve closed	Check motor phases. --- Check motor connection. ---
E112 Motor protection alarm XVD1: winding 1 not connected	Winding 1 disconnection.	Valve closed	Check correct setting parameters dE01..dE09, dE80 Check winding 1 connection (terminals 6-7) ---
E113 Motor protection alarm XVD1: winding 1 short-circuited	Winding 1 short-circuited.	Valve closed	Check correct setting parameters dE01..dE09, dE80 Check winding 1 connection (terminals 6-7) ---
E114 Motor protection alarm XVD1: winding 2 not connected	Winding 2 disconnection.	Valve closed	Check correct setting parameters dE01..dE09, dE80 Check winding 2 connection (terminals 4-5) ---
E115 Motor protection alarm XVD1: winding 2 short-circuited	Winding 2 short-circuited.	Valve closed	Check correct setting parameters dE01..dE09, dE80 Check winding 2 connection (terminals 4-5) ---

Probe errors table

Probe errors table

Temperature probe error	Use	Lock machine	Notes
Water/air inlet temperature Internal exchanger	Cool / Heat temperature controllers (proportional and differential)	YES	
	Change over	YES	
	Recirculation fan	NO	The fan switches ON/OFF depending on the compressor state
	Internal circuit water pump, antifreeze and/or Internal circuit heater, antifreeze	YES	
	Antifreeze with heat pump	YES	
	Block heat pump	YES	
	Power limitation	NO	
	Machine low charge alarm	NO	The alarm is disabled
Water/air outlet temperature Internal exchanger		YES	
Water outlet temperature probe Internal exchanger circuit 1		YES	
Water outlet temperature probe Internal exchanger circuit 2		YES	
External exchanger temperature circuit 1 and/or External exchanger temperature circuit 2	Cool / Heat temperature controllers (proportional and differential)	YES	
	External exchanger fans	NO	
	Antifreeze with external circuit heater	YES	
	Auxiliary output	NO	
	Defrost, input and output	NO	
	Block heat pump and/or Power limitation	YES	
Water inlet temperature external exchanger	Cool / Heat temperature controllers (proportional and differential)	YES	
	Antifreeze with external circuit heater	YES	
	Auxiliary output	NO	
	Block heat pump	YES	
	Power limitation	NO	
Water outlet temperature external exchanger		YES	
External temperature	Cool / Heat temperature controllers (differential)	YES	
	Change over	NO	
	Dynamic setpoint	NO	
	Internal circuit water pump, antifreeze	YES	
	Internal integrated heater, differential	NO	
	Auxiliary output	NO	
	External antifreeze heater	YES	
	Boiler, differential	NO	
	Block heat pump	YES	
	Power limitation	NO	
	Defrost, compensation	NO	

Temperature probe error	Use	Lock machine	Notes
Input for dynamic setpoint	Dynamic setpoint	NO	
Temperature display	Display	NO	
Sanitary water temperature	Sanitary water	NO	
Pressure probe error	Use	Lock machine	Notes
High pressure input circuit 1 and/or High pressure input circuit 2	External exchanger fans Defrost, input and output Power limitation	YES	
Low pressure input circuit 1 and/or Low pressure input circuit 2	External exchanger fans Defrost, input and output Power limitation	YES	
Input for dynamic setpoint	Dynamic setpoint	NO	
Internal exchanger pressure circuit 1 and/or Internal exchanger pressure circuit 2	External exchanger fans	YES	
External exchanger pressure circuit 1 and/or External exchanger pressure circuit 2	External exchanger fans Defrost, input and output	YES	
Pressure display	Display	NO	

26.2 Alarm log

The alarm log saved with the Device Manager software is a TXT format file; it can be read with any text editor and it can also be imported into Microsoft Excel® for clearer comprehension.

Guidelines for correct interpretation are provided below:

- Line 1: heading with the name of the Device Manager model used to download data from the device or the MFK.
- Line 2: date and time the data download took place.
- Line 3: column headings.

“Number” column:

incremental and circular index (FIFO); the alarm with index Eu00 is the most recent, while the Euxx index (max. xx: 98) indicates the oldest.

“Code” column:

lists the device alarm codes (as shown on the device display).

“Type” column:

indicates whether the alarm is reset automatically or manually.

The example below shows the recording of an alarm which changes from automatic reset to manual reset. The manual alarm reset was carried out from the functions menu, not by switching the device off and on again, because the alarm end date and time is also shown.

Eu56	E020	Reset Manual	State Closed	21.52	07-feb	21.52	07-feb
Eu57	E020	Reset Automatic	State Closed	21.52	07-feb	21.52	07-feb

“State” column:

indicates whether the alarm is still present (Open) or has been reset (Closed).

“Time Start” and “Date Start” columns:

indicate the alarm start time and date.

“Time End” and “Date End” columns:

indicate the alarm end time and date.

A lack of data (as shown below) indicates that the alarm is still ongoing.

If the device is switched off with a manual reset alarm, the log will not record this alarm reset procedure.

Number	Code	Type	State	Time Start	Date Start	Time End	Date End
Eu00	E068	Reset Automatic	State Open	20.20	04-mar	--:--	--/--
Eu01	E062	Reset Automatic	State Open	20.20	04-mar	--:--	--/--
Eu02	E061	Reset Automatic	State Open	20.20	04-mar	--:--	--/--

For manual reset alarms, the reset date and time correspond to the alarm reset and not to the change in the status of the digital input.

Eu56	E020	Reset Manual	State Closed	21.52	07-feb	21.52	07-feb
Eu57	E020	Reset Automatic	State Closed	21.52	07-feb	21.52	07-feb
Eu58	E020	Reset Manual	State Closed	21.51	07-feb	21.51	07-feb

N.B.: once error E090 (Alarm log full warning) has been generated (first alarm log entry), it is recorded in the log again each time the instrument is turned on and, like the other alarms currently present, each time the alarms are muted from the function menu (TA in FnC).

27 PARAMETERS (PAR)

Parameter setting allows full configurability of Energy SBA600 and the drivers for XVD Open stepper valves; They can be modified through:

- Multi Function key (MFK)
- Keys on the SBA600 front panel / SKW22(L)/SKP22(L) terminal
- PC and DeviceManager software

The following sections provide a detailed analysis of each parameter, divided into categories (folders).

Each folder is designated with a label showing two figures (example: CF, UI, etc).

All parameters are described in the Parameters / visibility table

The parameters for management of XVD Open drivers (folders **1L/1r/1F/1E**, **2L/2r/2F/2E**) are described in a specific table

UI parameters are also described in the paragraph User interface (UI) parameters

Visibility and Parameter Values

Energy SBA600 denotes a family of controllers.

There are 4+1 hardware models (see Appendix, Models section) with varying numbers of inputs and outputs.

The 4+1 hardware models are grouped into 3 DeviceManager models (version with 1 or 2 TRIACs and version with 5 relays). Depending on the model, some configuration parameters may not (usually) be visible and/or be of no significance given that the associated resource is not present.

Refer also to the following table:

model	Device Manager	Hardware	TCL1 TCE1	TCL2 TCE2	DOL6 DOE6
			CL73-CL76-CL79 CE73-CE76-CE79	CL75-CL78-CL81 (AOL2) CE75-CE78-CE81 (AOE2)	
	636	636			
	646	646/C 646/C/S	CL73-CL76-CL79 CE73-CE76-CE79		//
	655	655/C 655/C/S	//	//	CL95 CE95

Unless otherwise indicated, the parameter is always visible and modifiable, unless customized settings have been configured via serial.

N.B.: both parameters and folder visibility can be controlled (See Folder table).

If folder visibility is modified, the new setting will apply to all parameters in the folder.

27.1.1 Local I/O configuration parameters (CL) - Configuration Local

Table A Analogue Inputs Configuration

0	Input disabled	16	Temperature display
1	Water/air inlet temperature internal exchanger	17	NOT USED
2	Water/air outlet temperature internal exchanger	18	NOT USED
3	Water outlet temperature internal exchanger circuit 1	19	NOT USED
4	Water outlet temperature internal exchanger circuit 2	20	NOT USED
5	External exchanger temperature circuit 1	21	High pressure input circuit 1
6	External exchanger temperature circuit 2	22	High pressure input circuit 2
7	Water inlet temperature recovery (or external) exchanger	23	Low pressure input circuit 1
8	Water outlet temperature recovery (or external) exchanger	24	Low pressure input circuit 2
9	External temperature	25	Input for dynamic setpoint
10	Internal ambient temperature	26	Internal exchanger pressure circuit 1
11	Sanitary water temperature	27	Internal exchanger pressure circuit 2
12	Compressor 1 discharge temperature	28	External exchanger pressure circuit 1
13	NOT USED	29	External exchanger pressure circuit 2
14	NOT USED	30	Pressure display
15	NOT USED		

Table B Digital Inputs Configuration
Polarity is defined as indicated below:

	Value	Description
+	Positive	Active when contact closed
-	Negative	Active when contact open

0	Input disabled	±31	High pressure pressure switch C2
±1	Remote STD-BY	±32	Low pressure pressure switch C1
±2	Remote off	±33	Low pressure pressure switch C2
±3	Remote Summer/Winter	±34	Compressor 1 oil pressure switch
±4	Power step 1 request	±35	Compressor 2 oil pressure switch
±5	Power step 2 request	±36	Compressor 3 oil pressure switch
±6	Power step 3 request	±37	Compressor 4 oil pressure switch
±7	Power step 4 request	±38	NOT USED
±8	Digital input heat step 1 request	±39	External exchanger fan thermal switch C1
±9	Digital input heat step 2 request	±40	External exchanger fan thermal switch C2
±10	Digital input heat step 3 request	±41	Primary exchanger fan thermal switch
±11	Digital input heat step 4 request	±42	NOT USED
±12	Digital input cool step 1 request	±43	Compressor 1 thermal switch
±13	Digital input cool step 2 request	±44	Compressor 2 thermal switch
±14	Digital input cool step 3 request	±45	Compressor 3 thermal switch
±15	Digital input cool step 4 request	±46	Compressor 4 thermal switch
±16	Block compressor 1	±47	Internal circuit pump 1 thermal switch
±17	Block compressor 2	±48	Internal circuit pump 2 thermal switch
±18	Block compressor 3	±49	External circuit pump thermal switch
±19	Block compressor 4	±50	Internal exchanger electric heater 1 thermal switch
±20	Block heat pump	±51	Internal exchanger electric heater 2 thermal switch
±21	Power restricted to 50%	±52	Auxiliary output alarm
±22	Economy input	±53	NOT USED
±23	NOT USED	±54	NOT USED
±24	General alarm	±55	Primary circuit flow switch
±25	End of defrost C1	±56	External circuit flow switch (Recovery)
±26	End of defrost C2	±57	NOT USED
±27	NOT USED	±58	Display
±28	Remote AS		
±29	NOT USED		
±30	High pressure pressure switch C1		

N.B.: If more than one digital input in the table is configured with the same value, the function is activated when the input with the highest index is piloted.

Table C Digital Outputs Configuration
Polarity is defined as indicated below:

	Value	Description
+	Positive	Active when contact closed
-	Negative	Active when contact open

Value	Description	Type	Value	Description	Type
0	Output disabled	Digital	±31	Alarm	Digital
±1	Compressor 1	Digital	±32	EEV 1 ON command	Digital
±2	Compressor 2	Digital	±33	EEV 2 ON command	Digital
±3	Compressor 3	Digital	±34	Compressor Inverter 1	Digital
±4	Compressor 4	Digital	±35	NOT USED	Digital
±5	Reversal valve circuit 1	Digital	±36	NOT USED	Digital
±6	Reversal valve circuit 2	Digital	±37	NOT USED	Digital
±7	NOT USED	Digital	±38	Boiler 2	Digital
±8	NOT USED	Digital	±39	NOT USED	Digital
±9	Sanitary water valve	Digital	±40	NOT USED	Digital
±10	NOT USED	Digital	±41	NOT USED	Digital
±11	NOT USED	Digital	±42	NOT USED	Digital
±12	NOT USED	Digital	±43	NOT USED	Digital
±13	NOT USED	Digital	±44	NOT USED	Digital
±14	Internal circuit water pump 1	Digital	±45	NOT USED	Digital
±15	Internal circuit water pump 2	Digital	±46	NOT USED	Digital
±16	External circuit water pump	Digital	±47	NOT USED	Digital
±17	NOT USED	Digital	±48	NOT USED	Digital
±18	Recirculation fan	Digital	±49	NOT USED	Digital
±19	Fan external exchanger circuit 1	Digital	±50	NOT USED	Digital
±20	Fan external exchanger circuit 2	Digital	±51	NOT USED	Digital
±21	NOT USED	Digital	±52	NOT USED	Digital
±22	Auxiliary output conditional on defrosting	Digital	±53	NOT USED	Digital
±23	Electrical heater 1 internal exchanger	Digital	±54	NOT USED	Digital
±24	Electrical heater 2 internal exchanger	Digital	±55	NOT USED	Digital
±25	Electrical heater external exchanger 1	Digital	±56	Fan external exchanger circuit 1	Analogue
±26	Electrical heater external exchanger 2	Digital	±57	Fan external exchanger circuit 2	Analogue
±27	Auxiliary output	Digital	±58	Water heater	Analogue
±28	Sanitary Water Electric Heater	Digital	±59	Modulating internal circuit water pump 1	Analogue
±29	Operating hours exceeded	Digital	±60	Modulating internal circuit water pump 2	Analogue
±30	Water heater	Digital	±61	Analogue stage 1 for Compressor with Envelope control	Analogue
			±62	Analogue stage 1 for compressor	Analogue
			±63	Analogue stage 2 for Compressor	Analogue

If multiple outputs have been configured to run the same resource, these outputs will be activated in parallel.

27.1.2 Configuration parameters for XVD driver 1 (1r / 1F / 1L / 1E)

27.1.3 Configuration parameters for XVD driver 2 (2r / 2F / 2L / 2E)

Parameters with prefix 1 are relative to driver XVD1 while those with prefix 2 concern XVD2.

Exclusively parameters with prefix 1 are shown below; parameters with prefix 2 are identical. The table shows both parameters.

The resources of the 2 XVD drivers can be configured for use by the base in the same way as an expansion.

27.1.4 User interface parameters (UI) – User Interface

LED utilities table

LED symbol on display	LED SBW600 / LED SKW22 22L	Parameter SBW600 / SKW22 22L	Default SBW600 / SKW22 22L	Default SBW600	Default icon on front panel SBA600
	LED 1 / 11 (first from left)	UI00 / UI30	50 / 50	Power step 1	
	LED 2 / 12	UI01 / UI31	51 / 51	Power step 2	
	LED 3 / 13	UI02 / UI32	14 / 0	Internal circuit water pump	
	LED 4 / 14	UI03 / UI33	16 / 0	External circuit water pump	
	LED 5 / 15	UI04 / UI34	23 / 23	Internal exchanger electric heater 1	
	LED 6 / 16	UI05 / UI35	9 / 0	Valve or DHW pump	
	LED 7 / 17	UI06 / UI36	30 / 14	Water heater	
LED symbol on display	LED SBW600	Parameter SBW600	Default SBW600	Default SBW600	Default icon on front panel SBA600
	Economy LED	UI07=0 dS00=0	UI07=0 dS00=1	UI07=1 dS00=0 UI07=1 dS00=1	NOT enabled (LED off)
	Economy LED				Enabled (dynamic setpoint)

* the LED is permanently on when in AS mode and with heating in progress, blinking when in AS mode and with heating not active

See **Outputs: configuration table with the following exceptions:**

Value	Description	
±50	Power step 1 output	values used only for configuring the user interface LEDs, and associated with the power steps requested by the main temperature controller
±51	Power step 2 output	
±52	Power step 3 output	
±53	Power step 4 output	
...		
±70	internal pump 1 output or internal pump 2 output or both	Digital values used only for configuring the user interface LEDs
±71	external exchanger fan circuit 1 output or by external exchanger fan circuit 2 output or both	
±72	internal exchanger electric heater 1 output or by internal exchanger electric heater 2 output or both	
±73	external exchanger heater 1 output or by external exchanger heater 2 output or both	
±74	circuit 1 heat pump lock status or by circuit 2 heat pump lock status or both	

UI10 Fundamental state display selection

Selects fundamental state display

0	AiL1 analogue input	XVD1	20	Input 1rE1 (evaporator outlet temperature) XVD1
1	AiL2 analogue input		21	Input 1rE2 (saturation temperature) XVD1
2	AiL3 analogue input		22	Input 1rE3 (backup probe evaporator outlet temperature) XVD1
3	AiL4 analogue input		23	Input 1rE4 (backup probe evaporator temperature) XVD1
4	AiL5 analogue input		24	Input 1rE5 (superheating) XVD1
5	Analogue Input 1 Terminal AIR1		25	Input 1rE6 (refrigerant pressure) XVD1
6	Analogue Input 2 Terminal AIR2		26	Input 1rE7 (valve opening percentage) XVD1
7	AiE1 Analogue input		27	Input 1SP4 (superheating current setpoint) XVD1
8	AiE2 Analogue input	XVD2	28	Input 2rE1 (evaporator outlet temperature) XVD2
9	AiE3 Analogue input		29	Input 2rE1 (saturation temperature) XVD2
10	AiE4 analogue input		30	Input 2rE3 (backup probe evaporator outlet temperature) XVD2
11	AiE5 analogue input		31	Input 2rE4 (backup probe evaporator temperature) XVD2
12	Clock		32	Input 2rE5 (superheating) XVD2
13	Programmed setpoint		33	Input 2rE6 (refrigerant pressure) XVD2
14	Real Setpoint		34	Input 2rE7 (valve opening percentage) XVD2
15	Input 1AI1		35	Input 2SP4 (superheating current setpoint) XVD2
16	Input 1AI2		36	Clock
17	Input 1AI3		37	Programmed setpoint
18	Input 1AI4		38	Real Setpoint
19	Input 2AI1			


UI11 Select fundamental state display (terminal) SKW1

Selects terminal fundamental state display*

*Note: on display with 2 and a half digits + sign

Same as UI10

Which we will refer to as:

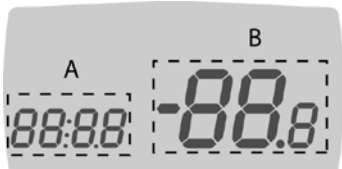Display	Display A	Display B*
	4-figure read-out For displaying time	Read-out with 2 and a half digits and +/- sign See parameter UI11

UI25 Setpoint edit function enable from main screen

Parameter allows you to enable Setpoint modification on the main display with the UP and DOWN keys

- 0 = Key not enabled for the function
- 1 = Key enabled for the function

Parameter	Key [press and hold]	Default icon on front panel	Parameter	Key [press and hold]	Default icon on front panel
UI20=1	[UP] = Domestic Hot Water / Manual defrost depending on model		UI24=1	[Set] = modify SetPoint	No (set key)
UI21=1	[esc] = change-over	mode	Parameter	Key (press and release)	Default icon on front panel
UI22=1	[set] = display	disp	UI25=1	UP / DOWN	No (UP and DOWN keys)
UI23=1	[DOWN] = Standby / Local ON/OFF according to model				

27.2 Parameters / visibility table, folder visibility table and client table

The **tables below** list all information required to read, write and decode all accessible resources in the device.

There are three tables:

- the **parameter** table lists all controller configuration parameters saved in the non-volatile memory, including visibility;
- the **folder** table lists all parameter folder visibility details;
- the **client** table includes all I/O and alarm status resources available in the volatile memory of the instrument.

Description of columns:

FOLDER indicates the label of the folder containing the parameter in question.

LABEL This indicates the label used to display the **parameters** in the menu of the controller.

ADDR VAL PAR ADDRESS

The integer portion represents the address of the MODBUS register containing the value of the resource to be read or written in the controller.

instrument The value after the decimal point indicates the position of the most significant data bit inside the register; if not indicated it is taken to be zero. This information is always provided when the register contains more than one information item, and it is necessary to distinguish which bits actually represent the data (the working size of the data indicated in the column DATA SIZE is also taken into consideration).

Given that the modbus registers have the size of one WORD (16 bit), the index number after the point can vary from 0 (least significant bit -LSb-) to 15 (most significant bit -MSb-)

Examples (in binary form the least significant bit is the first on the right)

VAL PAR ADDRESS	DATA SIZE	Value	Content of register
8806	WORD	1350	1350 (0000010101000110)
8806	Byte	70	1350 (0000010101000110)
8806.8	Byte	5	1350 (0000010101000110)
8806.14	1 bits	0	1350 (0000010101000110)
8806.7	4 bits	10	1350 (0000010101000110)

Important: when the register contains more than one piece of data, the write procedure is as follows:

- Read current value of register
- Modify bits for the resource concerned
- Write register

VIS ADDR VAL PAR ADDRESS

The same as above. In this case, the MODBUS register address contains the visibility value of the parameter. By default all parameters have:

- Data size bit
- Range 0...3
- **Visibility 3
- U.M. num.

**Value Meaning

- Value 3 = parameter or folder always visible
 - Value 2 = **manufacturer level**; these parameters can only be viewed by enter the manufacturer's password (see parameter UI18) (all parameters declared as always visible, parameters visible at the installation engineer level and manufacturer's level will be visible).
 - Value 1 = **installer level**; these parameters can only be viewed by enter the installer's password (see parameter UI17) (all parameters declared as always visible and parameters visible at the installation engineer level).
 - Value 0 = parameter or folder NOT visible.
- Parameters and/or folders with a level of visibility <>3 (password-protected) will be visible only if the correct password is entered (installer or manufacturer) following this procedure:
 - Parameters and/or folders with a level of visibility = 3 are always visible even without a password: in this case, the following procedure is not necessary.

Examples (in binary form the least significant bit is the first on the right):

Default visibility:

VAL PAR ADDRESS	DATA SIZE	Value	Content of register
49481.6	2 bits	3	65535 -----(1111111111111111)
49.482	2 bits	3	65535 (1111111111111111)
49482.2	2 bits	3	65535 (1111111111111111)
49482.4	2 bits	3	65535 (1111111111111111)
49482.6	2 bits	3	65535 (1111111111111111)

Let's modify the visibility of parameter CL04 (address 49482,6) from 3 to 0:

Visibility modified

VAL	PAR	ADDRESS	DATA SIZE	Value	Content of register
49481.6			2 bits	0	16383 (0011111111111111)

RESET (Y/N)	Indicates whether the device MUST be rebooted after the parameter has been changed. - Y=YES the device MUST be rebooted to save the change. - N=NO the device DOES NOT need to be rebooted after changing the parameter Example: ALL configuration parameters (folder CF) equal Y or the controller meaning the controller <u>MUST ALWAYS BE SWITCHED OFF THEN BACK ON AGAIN AFTER THEY HAVE BEEN CHANGED.</u>
R/W	Indicates the option of reading or writing the resource - R The resource is read-only - W The resource is write-only - RW The resource can be both read and written to
DATA SIZE	Indicates the size of the data in bits - WORD = 16 bit - Byte = 8 bit "n" bit = 0...15 bit based on the value of "n"
CPL	When the field indicates "Y", the value read by the register needs to be converted because the value represents a number with a sign. In the other cases the value is always positive or null To carry out conversion, proceed as follows: - If the value in the register is between 0 and 32.767, the result is the value itself (zero and positive values) - If the value in the register is between 32.768 and 65.535, the result is the value of the register – 65.536 (negative values)
RANGE	Describes the interval of values that can be assigned to the parameter. It can be correlated with other parameters in the instrument (indicated with the parameter label) N.B. If the real value is outside the permitted limits for the parameter (for example, because other parameters defining the limits have been changed), <u>the limit that has been passed</u> and not the real value will be displayed.
DEFAULT	Indicates the factory-set value for the standard model of the instrument. <u>Hardware model SBW646/C with 4 relays + TRIAC + 2 analogue outputs A01 AO2 PWM + 1 low voltage analogue output A03 is considered in this table.</u>
EXP	If = -1 the value read by the register is divided by 10 (value/10) to convert it to the values indicated in the RANGE and DEFAULT columns using the unit of measurement in the UM column, Example: parameter CL04 = 50.0. Column EXP = -1: - The value read by the device /DeviceManager is 50.0 - The value read from the register is 500 --> 500/10 = 50.0
U.M.	Measurement unit for values converted according to the rules indicated in the CPL and EXP columns.

27.2.1 Parameters / visibility table

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CF	CF01	49169	49468.6	BYTE			Y	RW	Select COM1 protocol Selection of COM1 (TTL) communication channel protocol: 0 = Eliwell; 1 = Modbus N.B.: • If CF01=0, parameters CF20/CF21 should be configured • If CF01=1, parameters CF30/CF31/CF32 should be configured	0 ... 1	1	num.
CF	CF20	49176	49470.4	BYTE			Y	RW	Eliwell protocol controller address CF20= address of the controller within the family (values valid from 0 to 14) CF21 = controller family (values from 0 to 14). The two values CF20 and CF21 represent the network address of the controller and the pair are indicated in the following format "FF.DD" (where FF=CF21 and DD=CF20).	0 ... 14	0	num.
CF	CF21	49177	49470.6	BYTE			Y	RW	Eliwell protocol controller family See CF21	0 ... 14	0	num.
CF	CF30	49178	49471	BYTE			Y	RW	Modbus protocol controller address N.B.: 0 (zero) is not included	1 ... 255	1	num.
CF	CF31	49179	49471.2	BYTE			Y	RW	Modbus protocol Baudrate To modify the Modbus protocol baud rate • 0 = 1200 baud • 1 = 2400 baud • 2 = 4800 baud • 3 = 9600 baud • 4 = 19200 baud • 5=38400 baud (maximum speed that can be set using DeviceManager software) • 6 = 57600 baud • 7 = 115200 baud	0 ... 7	3	num.
CF	CF32	49180	49471.4	BYTE			Y	RW	Modbus protocol parity • 1= EVEN • 2 = NONE • 3= ODD	1 ... 3	1	num.
CF	CF43	NA	NA	BYTE			Y	R	Firmware screen	0 ... 999	0	num.
CF	CF44	NA	NA	BYTE			Y	R	Firmware version	0 ... 999	0	num.
CF	CF50	49360	49473.2	BYTE			Y	RW	RTC present 0 = RTC not present; 1 = RTC present	0 ... 1	1	num.
CF	CF60	16430	49473.4	WORD			Y	RW	Client code 1 Parameter for the exclusive use of customers/users. The user can assign these parameters values that e.g. identify the type and/or model of the system, and its configuration etc.	0 ... 999	0	num.
CF	CF61	16432	49473.6	WORD			Y	RW	Client code 2 See CF60	0 ... 999	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CL	CL00	49208	49438.6	BYTE			Y	RW	AiL1 analogue input type 0= Probe not configured 1= DI 2= NTC	0 ... 2	0	num.
CL	CL01	49209	49439	BYTE			Y	RW	AiL2 type analogue input See CL00	0 ... 2	0	num.
CL	CL02	49210	49439.2	BYTE			Y	RW	AiL3 type analogue input 0= Probe not configured 1= DI 2= NTC 3=4..20mA 4=0-10V 5=0-5V 6=0-1V	0 ... 6	0	num.
CL	CL03	49211	49439.4	BYTE			Y	RW	AiL4 analogue input type See CL02	0 ... 6	0	num.
CL	CL04	49212	49439.6	BYTE			Y	RW	AiL5 analogue input type See CL00	0 ... 2	0	num.
CL	CL10	16450	49440	WORD	Y	-1	Y	RW	AiL3 analogue input full scale value	CL11 ... 999	500	°C/Bar
CL	CL11	16462	49440.2	WORD	Y	-1	Y	RW	AiL3 analogue input start of scale value	-500...CL10	0	°C/Bar
CL	CL12	16452	49440.4	WORD	Y	-1	Y	RW	AiL4 analogue input full scale value	CL13 ... 999	500	°C/Bar
CL	CL13	16464	49440.6	WORD	Y	-1	Y	RW	AiL4 analogue input start of scale value	-500 ... CL12	0	°C/Bar
CL	CL20	49238	49441	BYTE	Y	-1	Y	RW	AiL1 analogue input differential	-120 ... 120	0	°C
CL	CL21	49239	49441.2	BYTE	Y	-1	Y	RW	AiL2 analogue input differential	-120 ... 120	0	°C
CL	CL22	49240	49441.4	BYTE	Y	-1	Y	RW	AiL3 analogue input differential	-120 ... 120	0	°C/Bar
CL	CL23	49241	49441.6	BYTE	Y	-1	Y	RW	AiL4 analogue input differential	-120 ... 120	0	°C/Bar
CL	CL24	49242	49442	BYTE	Y	-1	Y	RW	AiL5 analogue input differential	-120 ... 120	0	°C
CL	CL30	49286	49442.2	BYTE			Y	RW	AIL1 analogue input configuration	0 ... 16	0	num.
CL	CL31	49287	49442.4	BYTE			Y	RW	AIL2 analogue input configuration	0 ... 16	0	num.
CL	CL32	49288	49442.6	BYTE			Y	RW	AIL3 analogue input configuration	0 ... 30	0	num.
CL	CL33	49289	49443	BYTE			Y	RW	AIL4 analogue input configuration	0 ... 30	0	num.
CL	CL34	49290	49443.2	BYTE			Y	RW	AIL5 analogue input configuration	0 ... 16	0	num.
CL	CL40	49292	49443.4	BYTE	Y		Y	RW	DIL digital input configuration 1	-58 ... 58	0	num.
CL	CL41	49293	49443.6	BYTE	Y		Y	RW	DIL digital input configuration 2	-58 ... 58	0	num.
CL	CL42	49294	49444	BYTE	Y		Y	RW	DIL digital input configuration 3	-58 ... 58	0	num.
CL	CL43	49295	49444.2	BYTE	Y		Y	RW	DIL digital input configuration 4	-58 ... 58	0	num.
CL	CL44	49296	49444.4	BYTE	Y		Y	RW	DIL digital input configuration 5	-58 ... 58	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CL	CL45	49297	49444.6	BYTE	Y		Y	RW	DIL digital input configuration 6	-58 ... 58	0	num.
CL	CL50	49302	49445.2	BYTE	Y		Y	RW	AIL1 analogue input configuration if configured as a digital input N.B.: Set to 0 if AiL1 is NOT configured as a DI	-58 ... 58	0	num.
CL	CL51	49303	49445.4	BYTE	Y		Y	RW	AIL2 analogue input configuration if configured as a digital input N.B.: Set to 0 if AiL2 is NOT configured as a DI	-58 ... 58	0	num.
CL	CL52	49304	49445.6	BYTE	Y		Y	RW	AIL3 analogue input configuration if configured as a digital input N.B.: Set to 0 if AiL3 is NOT configured as a DI	-58 ... 58	0	num.
CL	CL53	49305	49446	BYTE	Y		Y	RW	AIL4 analogue input configuration if configured as a digital input N.B.: Set to 0 if AiL4 is NOT configured as a DI	-58 ... 58	0	num.
CL	CL54	49306	49446.2	BYTE	Y		Y	RW	AIL5 analogue input configuration if configured as a digital input N.B.: Set to 0 if AiL5 is NOT configured as a DI	-58 ... 58	0	num.
CL	CL60	49248	49446.4	BYTE			Y	RW	AOL analogue output type 5 0 = 0-20mA 1 = 4-20mA	0 ... 1	0	num.
CL	CL61	49310	49446.6	BYTE	Y		Y	RW	AOL3 analogue output configuration	-53 ... 66	66	num.
CL	CL62	49311	49447	BYTE	Y		Y	RW	AOL4 analogue output configuration	-53 ... 66	59	num.
CL	CL63	49312	49447.2	BYTE	Y		Y	RW	AOL5 analogue output configuration	-53 ... 66	0	num.
CL	CL71	49251	49447.6	BYTE			Y	RW	Enable AOL analogue output 1 0 = Output configured as digital – see CL96 1 = Output configured as TRIAC – see CL74 – CL77 – CL80	0 ... 1	1	num.
CL	CL72	49252	49448	BYTE			Y	RW	Enable AOL analogue output 2 0 = Output configured as digital – see CL97 1 = Output configured as TRIAC – see CL75 – CL78 – CL81	0 ... 1	1	num.
CL	CL73	49253	49448.2	BYTE			Y	RW	Phase shift TCL analogue output 1	0 ... 90	1	deg
CL	CL74	49254	49448.4	BYTE			Y	RW	Phase shift AOL analogue output 1	0 ... 90	27	deg
CL	CL75	49255	49448.6	BYTE			Y	RW	Phase shift AOL analogue output 2	0 ... 90	27	deg
CL	CL76	49256	49449	BYTE			Y	RW	TCL analogue output pulse length 1	5 ... 40	27	69 µsec
CL	CL77	49257	49449.2	BYTE			Y	RW	AOL analogue output pulse length 1	5 ... 40	10	69 µsec
CL	CL78	49258	49449.4	BYTE			Y	RW	AOL analogue output pulse length 2	5 ... 40	10	69 µsec
CL	CL79	49314	49449.6	BYTE	Y		Y	RW	TCL1 analogue output configuration	-53 ... 66	10	num.
CL	CL80	49315	49450	BYTE	Y		Y	RW	AOL1 analogue output configuration	-53 ... 66	59	num.
CL	CL81	49316	49450.2	BYTE	Y		Y	RW	AOL2 analogue output configuration	-53 ... 66	56	num.
CL	CL90	49322	49450.4	BYTE	Y		Y	RW	DOL1 digital output configuration	-53 ... 53	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CL	CL91	49323	49450.6	BYTE	Y		Y	RW	DOL2 digital output configuration	-53 ... 53	-5	num.
CL	CL92	49324	49451	BYTE	Y		Y	RW	DOL3 digital output configuration	-53 ... 53	24	num.
CL	CL93	49325	49451.2	BYTE	Y		Y	RW	DOL4 digital output configuration	-53 ... 53	23	num.
CL	CL94	49326	49451.4	BYTE	Y		Y	RW	DOL5 digital output configuration (Open Collector)	-53 ... 53	34	num.
CL	CL95	49327	49451.6	BYTE	Y		Y	RW	Visible only in models 655 DOL6 digital output configuration (655 models)	-53 ... 53	31	num.
CL	CL96	49328	49452	BYTE	Y		Y	RW	AOL1 digital output configuration	-53 ... 53	0	num.
CL	CL97	49329	49452.2	BYTE	Y		Y	RW	AOL2 digital output configuration	-53 ... 53	0	num.
Ui	Ui00	49388	49474	BYTE			Y	RW	LED1 configuration	0 ... 74	50	num.
Ui	Ui01	49389	49474.2	BYTE			Y	RW	LED2 configuration	0 ... 74	51	num.
Ui	Ui02	49390	49474.4	BYTE			Y	RW	LED3 configuration	0 ... 74	14	num.
Ui	Ui03	49391	49474.6	BYTE			Y	RW	LED4 configuration	0 ... 74	16	num.
Ui	Ui04	49392	49475	BYTE			Y	RW	LED5 configuration	0 ... 74	23	num.
Ui	Ui05	49393	49475.2	BYTE			Y	RW	LED6 configuration	0 ... 74	9	num.
Ui	Ui06	49394	49475.4	BYTE			Y	RW	LED7 configuration	0 ... 74	30	num.
Ui	Ui07	49402	49475.6	BYTE			Y	RW	Standby LED configuration Allows you to configure the Economy LED. (if=1 the economy LED on the display will be permanently on) 0 = LED disabled 1 = dynamic setpoint	0 ... 2	1	num.
Ui	Ui10	49366	49476.2	BYTE			Y	RW	Fundamental state display selection	0 ... 38	0	num.
Ui	Ui11	49367	49476.4	BYTE			Y	RW	SKW basic state display 1	0 ... 38	5	num.
Ui	Ui20	49382	49477	BYTE			Y	RW	Enable defrost/Sanitary water function from key [UP] Makes it possible to enable or disable the domestic hot water function in standby from the [UP] button, or manual defrost, depending on the model 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	1	num.
Ui	Ui21	49383	49477.2	BYTE			Y	RW	Enable MODE function from key To enable or disable mode selection ([esc] key) (mode function) from a key 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	1	num.
Ui	Ui22	49384	49477.4	BYTE			Y	RW	Enable DISP function from key To enable or disable access the button [set] (disp function) key [set] (disp function) 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	1	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Ui	Ui23	49385	49477.6	BYTE			Y	RW	Enable ON/OFF function from key To enable or disable the [DOWN] key (ON/OFF function) to turn the instrument on or off 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	1	num.
Ui	Ui24	49386	49478	BYTE			Y	RW	Enable SET function from key To enable or disable access via the "set" key to the machine state menu and relative subfolders 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	1	num.
Ui	Ui25	49387	49478.2	BYTE			Y	RW	Setpoint edit function enable from main screen To enable or disable Setpoint modification on the main display with the UP and DOWN keys 0 = Key not enabled for the function 1 = Key enabled for the function	0 ... 1	0	num.
Ui	Ui27	16640	49478.6	WORD			Y	RW	Installation engineer password When enabled (value other than 0) it constitutes the access key for parameters	0 ... 255	1	num.
Ui	Ui28	16642	49479	WORD			Y	RW	Manufacturer password When enabled (value other than zero), constitutes the password for access to parameters	0 ... 255	2	num.
Ui	Ui30	49395	49479.2	BYTE			Y	RW	SKW utility LED configuration LED11 configuration See LED table (parameters UI00..UI06)	0 ... 74	50	num.
Ui	Ui31	49396	49479.4	BYTE			Y	RW	LED12 configuration	0 ... 74	51	num.
Ui	Ui32	49397	49479.6	BYTE			Y	RW	LED13 configuration	0 ... 74	0	num.
Ui	Ui33	49398	49480	BYTE			Y	RW	LED14 configuration	0 ... 74	0	num.
Ui	Ui34	49399	49480.2	BYTE			Y	RW	LED15 configuration	0 ... 74	23	num.
Ui	Ui35	49400	49480.4	BYTE			Y	RW	LED16 configuration	0 ... 74	0	num.
Ui	Ui36	49401	49480.6	BYTE			Y	RW	LED17 configuration	0 ... 74	14	num.
Cr	CR00	49664	49452.4	BYTE			Y	RW	AIR1 analogue input type 0= Probe not configured 1= not used 2= NTC	0 ... 2	0	num.
Cr	CR01	49665	49452.6	BYTE			Y	RW	AIR2 analogue input type 0= Probe not configured 1= DI 2= NTC 3 = 4..20mA	0 ... 3	0	num.
Cr	CR10	16900	49453	WORD	Y	-1	Y	RW	AIR2 local analogue input fullscale value	Cr11 ... 999	500	C/Bar
Cr	CR11	16904	49453.2	WORD	Y	-1	Y	RW	AIR2 local analogue input start of scale value	-500 ... Cr10	0	C/Bar
Cr	CR20	49674	49453.4	BYTE	Y	-1	Y	RW	AIR1 local analogue input differential	-120 ... 120	0	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Cr	CR21	49675	49453.6	BYTE	Y	-1	Y	RW	AIR2 local analogue input differential	-120 ... 120	0	C/Bar
Cr	CR30	49676	49454	BYTE			Y	RW	AIR1 local analogue input configuration	0 ... 16	0	num.
Cr	CR31	49677	49454.2	BYTE			Y	RW	AIR2 analogue input configuration	0 ... 30	0	num.
Cr	CR50	49683	49454.4	BYTE	Y		Y	RW	AIR2 analogue input configuration when configured as digital input N.B.: Set to 0 if Air2 is NOT configured as a DI	-58 ... 58	0	num.
CE	CE00	49696	49454.6	BYTE			Y	RW	AIE1 analogue input type • 0= Probe not configured • 1= DI • 2= NTC	0 ... 2	0	num.
CE	CE01	49697	49455	BYTE			Y	RW	AIE2 analogue input type See CE00	0 ... 2	0	num.
CE	CE02	49698	49455.2	BYTE			Y	RW	AIE3 analogue input type • 0= Probe not configured • 1= DI • 2= NTC • 3=4..20mA • 4=0-10V • 5=0-5V • 6=0-1V	0 ... 6	0	num.
CE	CE03	49699	49455.4	BYTE			Y	RW	AIE4 analogue input type See CE02	0 ... 6	0	num.
CE	CE04	49700	49455.6	BYTE			Y	RW	AIE5 analogue input type See CE00	0 ... 2	0	num.
CE	CE10	16938	49456	WORD	Y	-1	Y	RW	AIE3 analogue input fullscale value	CE11 ... 999	500	°C/Bar
CE	CE11	16950	49456.2	WORD	Y	-1	Y	RW	AIE3 analogue input start of scale value	-500 ... CE10	0	°C/Bar
CE	CE12	16940	49456.4	WORD	Y	-1	Y	RW	AIE4 analogue input fullscale value	CE13 ... 999	500	°C/Bar
CE	CE13	16952	49456.6	WORD	Y	-1	Y	RW	AIE4 analogue input start of scale value	-500 ... CE12	0	°C/Bar
CE	CE20	49726	49457	BYTE	Y	-1	Y	RW	AIE1 analogue input differential	-120 ... 120	0	°C
CE	CE21	49727	49457.2	BYTE	Y	-1	Y	RW	AIE2 analogue input differential	-120 ... 120	0	°C
CE	CE22	49728	49457.4	BYTE	Y	-1	Y	RW	AIE3 analogue input differential	-120 ... 120	0	°C/Bar
CE	CE23	49729	49457.6	BYTE	Y	-1	Y	RW	AIE4 analogue input differential	-120 ... 120	0	°C/Bar
CE	CE24	49730	49458	BYTE	Y	-1	Y	RW	AIE5 analogue input differential	-120 ... 120	0	°C
CE	CE30	49748	49458.2	BYTE			Y	RW	AIE1 analogue input configuration	0 ... 16	0	num.
CE	CE31	49749	49458.4	BYTE			Y	RW	AIE2 analogue input configuration	0 ... 16	0	num.
CE	CE32	49750	49458.6	BYTE			Y	RW	AIE3 analogue input configuration	0 ... 30	0	num.
CE	CE33	49751	49459	BYTE			Y	RW	AIE4 analogue input configuration	0 ... 30	0	num.
CE	CE34	49752	49459.2	BYTE			Y	RW	AIE5 analogue input configuration	0 ... 16	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CE	CE40	49754	49459.4	BYTE	Y		Y	RW	DIE digital input configuration 1	-58 ... 58	0	num.
CE	CE41	49755	49459.6	BYTE	Y		Y	RW	DIE digital input configuration 2	-58 ... 58	0	num.
CE	CE42	49756	49460	BYTE	Y		Y	RW	DIE digital input configuration 3	-58 ... 58	0	num.
CE	CE43	49757	49460.2	BYTE	Y		Y	RW	DIE digital input configuration 4	-58 ... 58	0	num.
CE	CE44	49758	49460.4	BYTE	Y		Y	RW	DIE digital input configuration 5	-58 ... 58	0	num.
CE	CE45	49759	49460.6	BYTE	Y		Y	RW	DIE digital input configuration 6	-58 ... 58	0	num.
CE	CE50	49762	49461.2	BYTE	Y		Y	RW	AIE analogue input configuration 1 when configured as a digital input N.B.: Set = 0 if AiE1 is NOT configured as DI	-58 ... 58	0	num.
CE	CE51	49763	49461.4	BYTE	Y		Y	RW	AIE analogue input configuration 2 when configured as digital input N.B.: Set = 0 if AiE2 is NOT configured as DI	-58 ... 58	0	num.
CE	CE52	49764	49461.6	BYTE	Y		Y	RW	AIE analogue input configuration 3 when configured as digital input N.B.: Set = 0 if AiE3 is NOT configured as DI	-58 ... 58	0	num.
CE	CE53	49765	49462	BYTE	Y		Y	RW	AIE4 analogue input configuration when configured as a digital input N.B.: Set to 0 if AE4 is NOT configured as a DI	-58 ... 58	0	num.
CE	CE54	49766	49462.2	BYTE	Y		Y	RW	AIE analogue input configuration 5 when configured as digital input N.B.: Set = 0 if AiE5 is NOT configured as DI	-58 ... 58	0	num.
CE	CE60	49736	49462.4	BYTE			Y	RW	AOE analogue output type 5 • 0 = 4-20mA • 1 = 0-20mA	0 ... 1	0	num.
CE	CE61	49768	49462.6	BYTE	Y		Y	RW	AOE analogue output configuration 3	-53 ... 66	0	num.
CE	CE62	49769	49463	BYTE	Y		Y	RW	AOE analogue output configuration 4	-53 ... 66	0	num.
CE	CE63	49770	49463.2	BYTE	Y		Y	RW	AOE analogue output configuration 5	-53 ... 66	0	num.
CE	CE70	49738	49463.4	BYTE			Y	RW	Enable TCE analogue output 1 • 0 = SE65x models – see CE95 • 1 = SE64x models – see CE73 – CE76 – CE79	0 ... 1	1	num.
CE	CE71	49739	49463.6	BYTE			Y	RW	Enable AOE analogue output 1 • 0 = Output configured as digital – see CE96 • 1 = Output configured as triac – see CE74 – CE77 – CE80	0 ... 1	0	num.
CE	CE72	49740	49464	BYTE			Y	RW	Enable AOE analogue output 2 • 0 = Output configured as digital – see CE97 • 1 = Output configured as TRIAC – see CE75 – CE78 – CE81	0 ... 1	0	num.
CE	CE73	49741	49464.2	BYTE			Y	RW	Phase shift TCE analogue output 1	0 ... 90	27	deg
CE	CE74	49742	49464.4	BYTE			Y	RW	Phase shift AOE analogue output 1	0 ... 90	27	deg
CE	CE75	49743	49464.6	BYTE			Y	RW	Phase shift AOE analogue output 2	0 ... 90	27	deg

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CE	CE76	49744	49465	BYTE			Y	RW	TCE analogue output pulse length 1	5 ... 40	10	69 µsec
CE	CE77	49745	49465.2	BYTE			Y	RW	AOE analogue output pulse length 1	5 ... 40	10	69 µsec
CE	CE78	49746	49465.4	BYTE			Y	RW	AOE analogue output pulse length 2	5 ... 40	10	69 µsec
CE	CE79	49772	49465.6	BYTE	Y		Y	RW	TCE1 analogue output configuration	-53 ... 66	0	num.
CE	CE80	49773	49466	BYTE	Y		Y	RW	AOE analogue output configuration 1	-53 ... 66	0	num.
CE	CE81	49774	49466.2	BYTE	Y		Y	RW	AOE analogue output configuration 2	-53 ... 66	0	num.
CE	CE90	49776	49466.4	BYTE	Y		Y	RW	DOE1 digital output configuration	-53 ... 53	0	num.
CE	CE91	49777	49466.6	BYTE	Y		Y	RW	DOE2 digital output configuration	-53 ... 53	0	num.
CE	CE92	49778	49467	BYTE	Y		Y	RW	DOE3 digital output configuration	-53 ... 53	0	num.
CE	CE93	49779	49467.2	BYTE	Y		Y	RW	DOE4 digital output configuration	-53 ... 53	0	num.
CE	CE94	49780	49467.4	BYTE	Y		Y	RW	DOE5 digital output configuration	-53 ... 53	0	num.
CE	CE95	49781	49467.6	BYTE	Y		Y	RW	<u>Visible only in models 655</u> DOE6 digital output configuration (models 655)	-53 ... 53	0	num.
CE	CE96	49782	49468	BYTE	Y		Y	RW	AOE1 digital output configuration	-53 ... 53	0	num.
CE	CE97	49783	49468.2	BYTE	Y		Y	RW	AOE2 digital output configuration	-53 ... 53	0	num.

The parameters relative to the XVD Open drivers are listed at the end of the table
The folders are shown after parameters CE and before parameters St

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
St	ST00	49808	49520	BYTE			Y	RW	Operating mode Select operating mode 0 = cool only Only OFF, STAND-BY and COOL allowed (local and remote). 1 = heat only Only OFF, STAND-BY and COOL allowed (local and remote). 2 = Heat pump heat/cool All modes allowed.	0 ... 2	2	num.
St	ST01	49809	49520.2	BYTE			Y	RW	Enable change mode from analogue input 0 = not enabled 1 = enabled	0 ... 1	0	num.
St	ST02	49810	49520.4	BYTE			Y	RW	Select probe to change automatic mode 0 = external temperature 1 = internal exchanger inlet water temperature 2 = external exchanger water outlet temperature	0 ... 2	0	num.
St	ST03	17044	49520.6	WORD	Y	-1	N	RW	Differential for change automatic mode in Heat	-255 ... 255	-100	°C
St	ST04	17046	49521	WORD	Y	-1	N	RW	Differential for change automatic mode in Cool	-255 ... 255	100	°C
St	ST05	49816	49521.2	BYTE			Y	RW	Reversal valve Reversal valve switching delay	0 ... 255	3	sec
St	ST06	49817	49521.4	BYTE			Y	RW	Reversal valve switching from Defrost to Heat delay	0 ... 255	15	sec
St	ST07	49818	49521.6	BYTE			Y	RW	Reversal valve switching from Heat to Defrost delay	0 ... 255	1	sec
St	ST08	49819	49522	BYTE			Y	RW	Reversal valve activation time for pressure release Each time the compressors are completely switched off, the reversal valve is temporarily inverted. If = 0 the valve will not be temporarily inverted with a complete compressor shut down	0 ... 255	0	sec
tr	TR00	49824	49513	BYTE			Y	RW	Temperature control type 0 = Proportional 1 = Differential 2 = Digital 3 = INVERTER Proportional 4 = INVERTER Differential	0 ... 4	3	num.
tr	TR01	49825	49513.2	BYTE			Y	RW	Enable heating pump 0= Heat pump absent 1= Heat pump present	0 ... 1	1	num.
tr	TR02	49826	49513.4	BYTE			Y	RW	Select temperature control probe in Cool 0=Internal exchanger water/air inlet temperature (CL30...CL34=0) 1=Internal exchanger water/air outlet temperature (CL30...CL34=1) 2= Circuit 1 and 2 internal exchanger water outlet average temperature Average ((CL30...CL34=2), (CL30...CL34=3)) 3= External exchanger water inlet temperature (CL30...CL34=6) 4= External exchanger water outlet temperature (CL30...CL34=7) 5= Circuit 1 and 2 external exchanger average temperature Average ((CL30...CL34=4), (CL30...CL34=5))	0 ... 5	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
tr	TR03	49827	49513.6	BYTE			Y	RW	Select temperature control probe in Heat See tr02	0 ... 5	0	num.
tr	TR04	49828	49514	BYTE			Y	RW	Select probes for temperature control differential in Cool - Probe 1 – see tr02 - Probe 2 External temperature NTC input (CL30...CL34=8)	0 ... 5	0	num.
tr	TR05	49829	49514.2	BYTE			Y	RW	Select probes for temperature control differential in Heat See tr04	0 ... 5	0	num.
tr	TR10	17062	49514.4	WORD	Y	-1	N	RW	Cool mode setpoint, hysteresis, differentials Temperature control setpoint in Cool	tr11 ... tr12	150	°C
tr	TR11	17064	49514.6	WORD	Y	-1	Y	RW	Minimum temperature control setpoint in Cool	-500 ... tr12	110	°C
tr	TR12	17066	49515	WORD	Y	-1	Y	RW	Maximum temperature control setpoint in Cool	tr11... 999	200	°C
tr	TR13	17068	49515.2	WORD		-1	N	RW	Temperature control hysteresis in Cool	1 ... 255	30	°C
tr	TR14	17070	49515.4	WORD		-1	N	RW	Insert steps/compressors differential in Cool	1 ... 255	30	°C
tr	TR15	17072	49515.6	WORD	Y	-1	N	RW	Setpoint differential in Cool from Economy input	-255 ... 255	50	°C
tr	TR20	17074	49516	WORD	Y	-1	N	RW	Heat mode setpoint, hysteresis, differentials Temperature control setpoint in Heat	tr21 ...tr22	310	°C
tr	TR21	17076	49516.2	WORD	Y	-1	Y	RW	Minimum temperature control setpoint in Heat	-500 ... tr22	300	°C
tr	TR22	17078	49516.4	WORD	Y	-1	Y	RW	Maximum temperature control setpoint in Heat	tr21 ... 999	450	°C
tr	TR23	17080	49516.6	WORD		-1	Y	RW	Temperature control hysteresis in Heat	1 ... 255	30	°C
tr	TR24	17082	49517	WORD		-1	Y	RW	Insert steps/compressors differential in Heat	1 ... 255	30	°C
tr	TR25	17084	49517.2	WORD	Y	-1	Y	RW	Setpoint differential in Heat from Economy Input	-255 ... 255	-50	°C
tr	TR30	17712	49517.4	WORD		-1	Y	RW	Temperature controller hysteresis with inverter in Cool To modify temperature control hysteresis with INVERTER in Cool mode	0 ... 255	20	°C
tr	TR31	17714	49517.6	WORD		-1	Y	RW	Temperature controller band with inverter in Cool To modify the proportional band of the temperature controller with INVERTER in Cool mode	0 ... 255	30	°C
tr	TR32	50484	49518	BYTE			Y	RW	Minimum speed with inverter in Cool To modify the maximum speed of the compressor with INVERTER in Cool mode	0 ...tr33	30	num.
tr	TR33	50485	49518.2	BYTE			Y	RW	Maximum speed with inverter in Cool To modify the maximum speed of the compressor with INVERTER in Cool mode	tr32 ... 100	70	num.
tr	TR34	17718	49518.4	WORD		-1	Y	RW	Insert Inverters/compressors differential in Cool Makes it possible to change the compressor / INVERTER starting differential in Cooling mode	0 ... 255	60	°C
tr	TR40	17726	49518.6	WORD		-1	Y	RW	Temperature controller hysteresis with inverter in Heat To modify temperature control hysteresis with INVERTER in Heat mode	0 ... 255	20	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
tr	TR41	17728	49519	WORD		-1	Y	RW	Temperature controller band with inverter in Heat To modify the proportional band of the temperature controller with INVERTER in Heat mode	0 ... 255	30	°C
tr	TR42	50498	49519.2	BYTE			Y	RW	Minimum speed with inverter in Heat To modify the minimum speed of the compressor with INVERTER in Heat mode	0 ... Tr43	30	num.
tr	TR43	50499	49519.4	BYTE			Y	RW	Maximum speed with inverter in Heat To modify the maximum speed of the compressor with INVERTER in Heat mode	tr42 ... 100	70	num.
tr	TR44	17732	49519.6	WORD		-1	Y	RW	Insert Inverters/compressors differential in Heat Makes it possible to change the compressor / INVERTER starting differential in Heating mode	0 ... 255	60	°C
ri	ri00	50864	49522.2	BYTE			Y	RW	Enable discharge temperature limitation control 0= disabled; 1= enabled	0 ... 1	0	num.
ri	ri01	50865	49522.4	BYTE			Y	RW	Select compression ratio control mode 0= Compression ratio control disabled 1=Compression ratio control enabled, minimum and maximum values 2=Compression ratio control enabled, minimum value 3=Compression ratio control enabled, maximum value	0 ... 3	1	num.
ri	ri10	50868	49523.2	BYTE			Y	RW	Compressor safety speed for oil recovery	0 ... 100	40	%
ri	ri11	50869	49523.4	BYTE			Y	RW	Compressor safety speed	0 ... 100	50	%
ri	ri12	50870	49523.6	BYTE			Y	RW	Compressor running time in safety If different from zero, it enables oil recovery function	0 ... 255	3	min
ri	ri13	50871	49524	BYTE			Y	RW	Compressor running time for oil recovery	0 ... 255	30	min
ri	ri14	50872	49524.2	BYTE			Y	RW	Initial transient for compression ratio control	0 ... 255	2	min
ri	ri16	50874	49524.6	BYTE			Y	RW	Compressor speed correction	1 ... 20	5	%
ri	ri20	50875	49525	BYTE			Y	RW	Discharge temperature limit zone 1b	0 ... 255	110	°C
ri	ri21	50876	49525.2	BYTE			Y	RW	Discharge temperature limit zone 1a - 2	0 ... 255	120	°C
ri	ri22	50877	49525.4	BYTE			Y	RW	Discharge temperature limit zone 1c - 3 ri20/ri21/ri22: discharge temperature reference values	0 ... 255	120	°C
ri	ri30	50879	49526	BYTE		-1	Y	RW	Minimum compression ratio	0 ... 255	10	num.
ri	ri31	50880	49526.2	BYTE		-1	Y	RW	Maximum compression ratio	0 ... 255	100	num.
ri	ri32	50881	49526.4	BYTE		-1	Y	RW	Minimum compression ratio range	0 ... 255	10	num.
ri	ri33	50882	49526.6	BYTE		-1	Y	RW	Maximum compression ratio range	0 ... 255	20	num.
ri	ri34	50883	49527	BYTE			Y	RW	Discharge temperature correction period	5 ... 255	60	sec
ri	ri55	50894	49529.6	BYTE			Y	RW	Overheating setpoint correction period	1 ...60	1	min
ri	ri63	50901	49531.4	BYTE		-1	Y	RW	Evaporation pressure zone 1a/1b	0 ... 255	34	bar
ri	ri64	50902	49531.6	BYTE		-1	Y	RW	Evaporation pressure differential 2	0 ... 255	20	bar
ri	ri65	50903	49532	BYTE		-1	Y	RW	Evaporation pressure zone 1b/1c	0 ... 255	60	bar

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dS	dS00	49876	49573.6	BYTE			Y	RW	External temperature controller dynamic differential selection 0 = disabled 1 = proportional 2 = by steps	0 ... 2	0	num.
dS	dS01	17096	49574	WORD	Y	-1	N	RW	Temperature control proportional band dynamic differential in Cool	-500 ... 999	50	°C
dS	dS02	17098	49574.2	WORD	Y	-1	N	RW	Temperature control proportional band dynamic differential in Heat	-500 ... 999	50	°C
dS	dS03	17100	49574.4	WORD	Y	-1	Y	RW	Maximum temperature control dynamic differential in Cool	-500 ... 999	50	°C
dS	dS04	17102	49574.6	WORD	Y	-1	Y	RW	Maximum temperature control dynamic differential in Heat	-500 ... 999	50	°C
dS	dS05	17104	49575	WORD	Y	-1	N	RW	Temperature control dynamic setpoint differential in Cool	-500 ... 999	150	°C
dS	dS06	17106	49575.2	WORD	Y	-1	N	RW	Temperature control dynamic setpoint differential in Heat	-500 ... 999	220	°C
CP	CP00	49694	49532.2	BYTE			Y	RW	Type of System Type of compressor 0 = simple (non-power stage) 1 = alternate power stage 2 = screw power stage	0 ... 2	0	num.
CP	CP01	49887	49532.4	BYTE			Y	RW	Number of circuits 1 = 1 circuit 2 = 2 circuits	1 ... 2	1	num.
CP	CP02	49888	49532.6	BYTE			Y	RW	Number of compressors per circuit 1 = 1 compressor 2 = 2 compressors 3 = 3 compressors 4 = 4 compressors	1 ... 4	1	num.
CP	CP03	49889	49533	BYTE			Y	RW	Number of capacity steps of compressor 1 = 1 power stage 2 = 2 power stages 3 = 3 power stages	0 ... 3	0	num.
CP	CP10	49896	49533.6	BYTE			Y	RW	Plant resource management Enable circuit balancing Establishes circuit management 0 = saturation (circuits) 1 = balancing (circuits)	0 ... 1	0	num.
CP	CP11	49897	49534	BYTE			Y	RW	Enable compressor balancing Establishes circuit management 0 = saturation (compressors) 1 = balancing (compressors) 2 = NOT USED	0 ... 1	0	num.
CP	CP12	49898	49534.2	BYTE			Y	RW	Circuit selection criterion 0 = hours balancing 1 = on sequence 1-->2; off sequence 2-->1	0 ... 1	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
CP	CP13	49899	49534.4	BYTE			Y	RW	Compressor selection criterion Establishes the selection of compressors on each circuit 0 = hours balancing 1 = on sequence 1-->2-->3-->4; off sequence 4-->3-->2-->1 2 = operating time	0 ... 2	0	num.
CP	CP14	17132	49534.6	WORD			Y	RW	Compressor operating time for each on sequence	0 ... 255	3	sec*10
CP	CP20	17136	49535	WORD			Y	RW	Compressor Protection Minimum off/on for same compressor	0 ... 255	3	sec*10
CP	CP21	17138	49535.2	WORD			Y	RW	Minimum on/on time for same compressor	0 ... 255	3	sec*10
CP	CP22	17140	49535.4	WORD			Y	RW	Minimum compressor on time	0 ... 255	3	sec*10
CP	CP23	17142	49535.6	WORD			Y	RW	Minimum on/on time for different compressors	1 ... 255	10	sec
CP	CP24	17144	49536	WORD			Y	RW	Minimum off/off time for different compressors	1 ... 255	10	sec
CP	CP25	17146	49536.2	WORD			Y	RW	Minimum compressor on time per splitting increment	1 ... 255	10	sec
CP	CP26	17148	49536.4	WORD			Y	RW	Minimum compressor on time per splitting decrease	1 ... 255	5	sec
CP	CP27	17150	49536.6	WORD			Y	RW	Defrost compressor/step delay minimum	1 ... 255	3	sec
CP	CP33	17162	49538	BYTE			Y	RW	Pump-down time during shutdown	0...999	0	sec
CP	CP34	17164	49538.2	BYTE	Y	-1	Y	RW	Pump-down interruption set-point	-500 ... 999	20	Bar
Fi	FI00	49956	49546.4	BYTE			Y	RW	Select recirculating fan function 0 = recirculation fan disabled 1 = Always on 2 = On request	0 ... 2	0	num.
Fi	FI01	17190	49546.6	WORD		-1	N	RW	Recirculating fan regulator hysteresis in Cool	1 ... 255	20	°C
Fi	FI02	17192	49547	WORD		-1	N	RW	Recirculating fan regulator hysteresis in Heat	1 ... 255	20	°C
Fi	FI03	17194	49547.2	WORD			Y	RW	Post-ventilation time in Heat	0 ... 255	10	sec
Pi	PI00	49984	49540	BYTE			Y	RW	Select primary circuit water pump function 0=Pump disabled 1=Continuous (always on) 2=on request (pump on when compressor on)	0 ... 2	2	num.
Pi	PI01	49985	49540.2	BYTE			Y	RW	Time primary circuit water pump not active for anti-lock	0 ... 255	1	hours
Pi	PI02	49986	49540.4	BYTE			Y	RW	Internal circuit water pump pick-up time	0 ... 255	2	sec
Pi	PI03	49987	49540.6	BYTE			Y	RW	Minimum internal circuit water pump start time	0 ... 255	10	Sec x 10
Pi	PI05	49989	49541.2	BYTE			Y	RW	Maximum internal circuit water pump changeover start time Pump operation time, after which the active pump is switched off and replaced by the second pump if available. If = 0 the second pump is not called	0 ... 255	0	hours
Pi	PI10	49992	49541.4	BYTE			Y	RW	Enable internal circuit water pump on when anti-freeze heaters on 0 = Pump disabled 1 = Pump enabled	0 ... 1	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Pi	PI11	49993	49541.6	BYTE			Y	RW	Enable internal circuit water pump start when boiler active 0 = Pump disabled 1 = Pump enabled	0 ... 2	1	num.
Pi	PI20	49996	49542	BYTE			Y	RW	Operation in response to request Delay primary circuit water pump on - compressor on	0 ... 255	60	sec
Pi	PI21	49997	49542.2	BYTE			Y	RW	Delay compressor off - primary circuit water pump off	0 ... 255	60	sec
Pi	PI22	49998	49542.4	BYTE			Y	RW	Internal circuit pump periodic activation interval Modifies the maximum pump off time after which the pump is forced on If modulating, it will be switched on a maximum speed	0 ... 255	30	min
Pi	PI30	50002	49542.6	BYTE			Y	RW	Modulating function in Cool mode Minimum primary circuit water pump speed in Cool	1 ... 100	50	%
Pi	PI31	50003	49543	BYTE			Y	RW	Maximum primary circuit water pump speed in Cool	1 ... 100	100	%
Pi	PI32	17236	49543.2	WORD	Y	-1	N	RW	Minimum primary circuit water pump setpoint speed in Cool	-500 ... 999	200	°C
Pi	PI33	17238	49543.4	WORD	Y	-1	N	RW	Proportional band primary circuit water pump in Cool	-255 ... 255	80	°C
Pi	PI34	50008	49543.6	BYTE			N	RW	Fan speed setpoint for primary circuit water pump modulation in cool	0 ... 100	80	%
Pi	PI35	50009	49544	BYTE			N	RW	Fan speed hysteresis for primary circuit water pump modulation in Cool	1 ... 100	10	%
Pi	PI40	50012	49544.2	BYTE			Y	RW	Modulating function in Heat mode Minimum primary circuit water pump speed in Heat	1 ... 100	30	%
Pi	PI41	50013	49544.4	BYTE			Y	RW	Maximum primary circuit water pump speed in Heat	1 ... 100	100	%
Pi	PI42	17246	49544.6	WORD	Y	-1	N	RW	Minimum primary circuit water pump setpoint speed in Heat	-500 ... 999	200	°C
Pi	PI43	17248	49545	WORD	Y	-1	N	RW	Proportional band primary circuit water pump in Heat	-255 ... 255	180	°C
Pi	PI44	50018	49545.2	BYTE			N	RW	Fan speed setpoint for primary circuit water pump modulation in Heat	0 ... 100	80	%
Pi	PI45	50019	49545.4	BYTE			N	RW	Fan speed hysteresis for primary circuit water pump modulation in Heat	1 ... 100	10	%
Pi	PI50	50022	49545.6	BYTE			Y	RW	ANTIFREEZE with PUMP Select probe for internal circuit + water pump antifreeze 0=No probe (pump in antifreeze disabled) 1=Internal exchanger water/air inlet temperature 2=Internal exchanger water/air outlet temperature 3=Circuit 1 internal exchanger water outlet temperature 4=Circuit 2 internal exchanger water outlet temperature 5=Circuit 1 and 2 internal exchanger water outlet minimum temperature 6=External temperature	0 ... 6	0	num.
Pi	PI51	17256	49546	WORD	Y	-1	N	RW	Primary circuit water pump regulator setpoint for anti-freeze	-500 ... 999	80	°C
Pi	PI52	17258	49546.2	WORD		-1	N	RW	Primary circuit water pump regulator hysteresis for anti-freeze	1 ... 255	20	°C
FE	FE00	50038	49548.4	BYTE			Y	RW	External exchanger fan mode selection 0 = fan disabled 1 = Continuous operation (Always ON) 2 = Operation on call (ON when compressor ON)	0 ... 2	1	num.
FE	FE01	50039	49548.6	BYTE			Y	RW	Surge current time open system intercooler fan	0 ... 60	2	sec

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
FE	FE10	50046	49549	BYTE			Y	RW	FAN CONTROL IN DEFROST Enable single condensation Configures 2 circuit machines with a single condenser 0 = separate condensation / independent fans 1 = single condensation / in parallel	0 ... 1	0	num.
FE	FE11	50047	49549.2	BYTE			Y	RW	Enable external exchanger fan special starts 0 = Fan disabled 1 = Fan enabled	0 ... 2	0	num.
FE	FE12	17280	49549.4	WORD	Y	-1	N	RW	Open system intercooler fan switch on setpoint during defrost	-500 ... 999	190	°C/Bar
FE	FE13	17282	49549.6	WORD		-1	N	RW	Open system intercooler fan switch-on hysteresis during defrost	1 ... 255	10	°C/Bar
FE	FE14	50052	49550	BYTE			Y	RW	Select probe to regulate open system intercooler fan during defrost 0= No probe 1 = External exchanger temperature probe (circuit 1 and 2) 2 = High pressure probe (circuit 1 and 2) 3 = External exchanger pressure probe (circuit 1 and 2)	0 ... 3	1	num.
FE	FE20	17290	49550.2	WORD			Y	RW	Cut-off open system intercooler fan bypass time	0 ... 255	2	sec
FE	FE21	17292	49550.4	WORD			Y	RW	External exchanger fan pre-ventilation time	0 ... 255	0	sec
FE	FE30	50062	49550.6	BYTE			Y	RW	FAN CONTROL IN COOLING Open system intercooler fan minimum speed in Cool	0 ... 100	35	%
FE	FE31	50063	49551	BYTE			Y	RW	Open system intercooler fan average speed in Cool	0 ... 100	100	%
FE	FE32	50064	49551.2	BYTE			Y	RW	Open system intercooler fan maximum speed in Cool	0 ... 100	100	%
FE	FE33	50065	49551.4	BYTE			Y	RW	Select probe to regulate open system intercooler fan in Cool 0=No probe 1=External exchanger temperature (circuit 1 and 2) 2=High pressure input (circuit 1 and 2) 3=Low pressure input (circuit 1 and 2) 4=External exchanger pressure (circuit 1 and 2) 5=Internal exchanger pressure (circuit 1 and 2)	0 ... 7	4	num.
FE	FE34	17298	49551.6	WORD	Y	-1	N	RW	Open system intercooler fan minimum setpoint speed in Cool	-500 ... 999	180	°C/Bar
FE	FE35	17300	49552	WORD	Y	-1	N	RW	Open system intercooler fan maximum speed differential in Cool	1 ... 999	55	°C/Bar
FE	FE36	17302	49552.2	WORD		-1	N	RW	Open system intercooler fan proportional band speed in Cool	0 ... 999	25	°C/Bar
FE	FE37	17304	49552.4	WORD		-1	N	RW	Open system intercooler fan maximum speed hysteresis in Cool	1 ... 255	10	°C/Bar
FE	FE38	17306	49552.6	WORD		-1	N	RW	Open system intercooler fan hysteresis cut-off in Cool	1 ... 255	10	°C/Bar
FE	FE39	17308	49553	WORD		-1	N	RW	Open system intercooler fan differential cut-off in Cool	0 ... 255	20	°C/Bar
FE	FE50	50082	49553.2	BYTE			Y	RW	FAN CONTROL IN HEATING Open system intercooler fan minimum speed in Heat	0 ... 100	35	%
FE	FE51	50083	49553.4	BYTE			Y	RW	Open system intercooler fan average speed in Heat	0 ... 100	100	%
FE	FE52	50084	49553.6	BYTE			Y	RW	Open system intercooler fan maximum speed in Heat	0 ... 100	100	%

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
FE	FE53	50085	49554	BYTE			Y	RW	Select probe to regulate open system intercooler fan in Heat 0=No probe 1=External exchanger temperature (circuit 1 and 2) 2=High pressure input (circuit 1 and 2) 3=Low pressure input (circuit 1 and 2) 4=External exchanger pressure (circuit 1 and 2) 5=Internal exchanger pressure (circuit 1 and 2)	0 ... 7	4	num.
FE	FE54	17318	49554.2	WORD	Y	-1	N	RW	Open system intercooler fan minimum setpoint speed in Heat	-500 ... 999	120	°C/Bar
FE	FE55	17320	49554.4	WORD	Y	-1	N	RW	Open system intercooler fan maximum speed differential in Heat	1 ... 999	17	°C/Bar
FE	FE56	17322	49554.6	WORD		-1	N	RW	Open system intercooler fan proportional band speed in Heat	0 ... 999	10	°C/Bar
FE	FE57	17324	49555	WORD		-1	N	RW	Open system intercooler fan maximum speed hysteresis in Heat	1 ... 255	5	°C/Bar
FE	FE58	17326	49555.2	WORD		-1	N	RW	Open system intercooler fan hysteresis cut-off in Heat	1 ... 255	5	°C/Bar
FE	FE59	17328	49555.4	WORD		-1	N	RW	Open system intercooler fan differential cut-off in Heat	0 ... 255	10	°C/Bar
PE	PE00	50110	49555.6	BYTE			Y	RW	External circuit water pump mode selection Defines the operation of the external circuit water pump 0 = Pump disabled 1 = Continuous operation (Always ON) 2 = NOT USED 3 = Operation synchronised with external exchanger fans	0 ... 3	0	num.
PE	PE02	50111	49556	BYTE			Y	RW	External circuit pump switch-on - compressor switch-on delay	0 ... 255	0	sec
PE	PE03	50112	49556.2	BYTE			Y	RW	Compressor switch-off - external circuit pump switch-off delay	0 ... 255	60	sec
PE	PE04	50113	49556.4	BYTE			Y	RW	External circuit water pump antilock function enabling 0= function disabled; 1= function enabled	0 ... 1	0	num.
PE	PE05	50114	49556.6	BYTE			Y	RW	External circuit water pump OFF time for antilock	0 ... 255	50	hours
PE	PE06	50115	49557	BYTE			Y	RW	External circuit water pump ON time for antilock	1 ... 255	10	sec
PE	PE07	50116	49557.2	BYTE			Y	RW	Antifreeze function enabling with external circuit water pump 0= function disabled; 1= function enabled	0 ... 1	0	num.
PE	PE08	17350	49557.4	WORD	Y	-1	Y	RW	External circuit water pump set point control for antifreeze	-500 ... 999	100	°C
PE	PE09	17352	49557.6	WORD		-1	Y	RW	External circuit water pump hysteresis control for antifreeze	0 ... 255	20	°C
Hi	HI00	50126	49558	BYTE			Y	RW	Enable internal exchanger antifreeze heaters in standby 0 = Heaters disabled 1 = Heaters enabled	0 ... 1	0	num.
Hi	HI01	50127	49558.2	BYTE			Y	RW	Enable force heaters on during defrost 0 = Heaters enabled (ON) when requested by temperature controller (antifreeze or integrated use) 1 = Heaters always enabled ON during defrost	0 ... 3	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Hi	HI10	50130	49558.4	BYTE			Y	RW	Select probe for antifreeze internal exchanger + heater 1 0=No probe (antifreeze heater disabled) 1=Internal exchanger water/air inlet temperature 2=Internal exchanger water/air outlet temperature 3=Circuit 1 internal exchanger water outlet temperature 4=Circuit 2 internal exchanger water outlet temperature 5=Circuit 1 and 2 internal exchanger water outlet average temperature	0 ... 5	2	num.
Hi	HI11	50131	49558.6	BYTE			Y	RW	Select probe for antifreeze internal exchanger + heater 2 See HI11	0 ... 5	2	num.
Hi	HI12	17364	49559	WORD	Y	-1	N	RW	Primary intercooler heaters regulator setpoint for anti-freeze	HI14 ... HI13	40	°C
Hi	HI13	17366	49559.2	WORD	Y	-1	Y	RW	Primary intercooler heaters regulator maximum setpoint for anti-freeze	HI14 ... 999	70	°C
Hi	HI14	17368	49559.4	WORD	Y	-1	Y	RW	Primary intercooler heaters regulator minimum setpoint for anti-freeze	-500 ... HI13	-100	°C
Hi	HI15	17370	49559.6	WORD		-1	N	RW	Primary intercooler heaters regulator hysteresis for anti-freeze	1 ... 255	5	°C
Hi	HI20	50146	49560	BYTE			Y	RW	Select heater mode for internal exchanger in integration mode 0=Integration heaters disabled 1=Integration heaters with differential setpoint proportional to external temperature 2=Integration heaters with differential setpoint in steps to external temperature 3=Integration heaters with differential setpoint fixed	0 ... 3	3	num.
Hi	HI21	17380	49560.2	WORD	Y	-1	N	RW	Primary intercooler heaters dynamic differential setpoint in integration	-500 ... 999	100	°C
Hi	HI22	17382	49560.4	WORD		-1	Y	RW	Primary intercooler heaters maximum dynamic differential in integration	0 ... 999	60	°C
Hi	HI23	17384	49560.6	WORD		-1	N	RW	Heater differential in integration mode with heat pump lock	0 ... 999	0	°C
Hi	HI24	17386	49561	WORD		-1	N	RW	Primary intercooler heaters dynamic differential proportional band in integration	0 ... 999	50	°C
Hi	HI25	17388	49561.2	WORD		-1	N	RW	Primary intercooler heaters regulator hysteresis in integration	1 ... 255	10	°C
Hi	HI26	17390	49561.4	WORD		-1	N	RW	Primary intercooler heater 2 switch-on setpoint differential in integration	0 ... 999	200	°C
HE	HE00	50166	49561.6	BYTE			Y	RW	Enable external exchanger antifreeze heaters in standby 0 = Heaters disabled 1 = Heaters enabled	0 ... 1	0	num.
HE	HE10	50168	49562	BYTE			Y	RW	Select probe for antifreeze external exchanger + heater 1 0=No probe (antifreeze heater disabled) 1=Circuit 1 and 2 external exchanger average temperature 2=Recovery (or external) exchanger inlet water temperature 3=Recovery (or external) exchanger outlet water temperature 4=External temperature	0 ... 4	0	num.
HE	HE11	50169	49562.2	BYTE			Y	RW	Select probe for antifreeze external exchanger + heater 2 See HE10	0 ... 4	0	num.
HE	HE12	17402	49562.4	WORD	Y	-1	N	RW	Open-system intercooler heaters switch-on setpoint for anti-freeze	HE14 ... HE13	40	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
HE	HE13	17404	49562.6	WORD	Y	-1	Y	RW	Primary open-system intercooler heaters regulator maximum setpoint for anti-freeze	HE14... 999	70	°C
HE	HE14	17406	49563	WORD	Y	-1	Y	RW	Primary open-system intercooler heaters regulator minimum setpoint for anti-freeze	-500 ... HE13	-100	°C
HE	HE15	17408	49563.2	WORD		-1	N	RW	Open-system intercooler heaters regulator hysteresis for anti-freeze	1 ... 255	10	°C
HA	HA00	50186	49563.4	BYTE			Y	RW	Select probe for auxiliary output regulator 0=No probe (auxiliary output disabled) 1=External temperature 2=External exchanger temperature circuit 1 3=External exchanger temperature circuit 2 4=Recovery (or external) exchanger inlet water temperature 5=Recovery (or external) exchanger outlet water temperature 6=NOT USED	0 ... 6	0	num.
HA	HA01	17420	49563.6	WORD	Y	-1	N	RW	Auxiliary output regulator setpoint	-500 ... 999	20	°C
HA	HA02	17422	49564	WORD	Y	-1	N	RW	Auxiliary output regulator hysteresis	-500 ... 999	10	°C
br	BR00	50200	49564.2	BYTE			Y	RW	Select boiler mode 0=Water heater disabled 1=Water heater with differential setpoint proportional to external temperature 2=Water heater with differential setpoint in steps as a function of external temperature 3=Water heater with differential setpoint fixed	0 ... 3	0	num.
br	BR01	17434	49564.4	WORD	Y	-1	N	RW	Boiler dynamic differential setpoint	-500 ... 999	100	°C
br	BR02	17436	49564.6	WORD		-1	Y	RW	Maximum boiler dynamic differential	0 ... 999	255	°C
br	BR03	17438	49565	WORD		-1	Y	RW	Boiler dynamic differential with heat pump lock In case of <u>heat pump block</u> , the Boiler differential assumes the fixed value of this parameter	0 ... 999	0	°C
br	BR04	17440	49565.2	WORD		-1	N	RW	Boiler proportional band dynamic differential	0 ... 999	50	°C
br	BR05	17442	49565.4	WORD		-1	N	RW	Boiler regulator hysteresis	1 ... 255	20	°C
dF	dF00	50262	49570.2	BYTE			Y	RW	Select defrost mode 0= Defrost disabled 1 = Simultaneous defrost (only for dual-circuit systems) 2 = Independent defrost (for single-circuit systems and dual-circuit systems with separate condensation)	0 ... 2	2	num.
dF	dF01	50263	49570.4	BYTE			Y	RW	Enable maximum power for non-defrost circuit 0= force maximum power NOT enabled 1= force maximum power enabled	0 ... 1	0	num.
dF	dF10	50266	49570.6	BYTE			Y	RW	Select probe to enable interval count between defrost cycles 0 = External exchanger temperature 1 = High pressure input 2 = Low pressure input 3 = Internal exchanger pressure 4 = External exchanger pressure	0 ... 4	4	Num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dF	dF11	17500	49571	WORD	Y	-1	N	RW	Setpoint to enable interval count between defrost cycles	-500 ... 999	27	°C/Bar
dF	dF12	17502	49571.2	WORD	Y	-1	N	RW	Setpoint to clear cumulative time between defrost cycles	-500 ... 999	130	°C/Bar
dF	dF13	17504	49571.4	WORD			Y	RW	Cumulative time between defrost cycles	1 ... 255	20	Min
dF	dF14	17506	49571.6	WORD			Y	RW	Minimum interval between defrost cycles	1 ... 255	60	Min
dF	dF20	50280	49572	BYTE			Y	RW	Select probe to disable defrost 0 = External exchanger temperature 1 = High pressure input 2 = Low pressure input 3 = Internal exchanger pressure 4 = External exchanger pressure	0 ... 4	1	Num.
dF	dF21	17514	49572.2	WORD	Y	-1	N	RW	Disable defrost setpoint	-500 ... 999	130	°C/Bar
dF	dF22	17516	49572.4	WORD			Y	RW	Maximum defrost time	1 ... 255	5	Minutes
dF	dF23	17518	49572.6	WORD			Y	RW	Drip time	0 ... 255	40	sec
dF	dF30	17524	49573	WORD	Y	-1	Y	RW	Maximum dynamic defrost differential	-500 ... 999	0	°C/Bar
dF	dF31	17526	49573.2	WORD	Y	-1	N	RW	Dynamic defrost differential setpoint	-500 ... 999	100	°C
dF	dF32	17528	49573.4	WORD	Y	-1	N	RW	Defrost proportional band dynamic differential	-500 ... 999	-50	°C
Ad	Ad00	50308	49575.4	BYTE			Y	RW	Select no accumulation mode 0 = Accumulation disabled 1 = Setpoint 2 = Hysteresis 3 = Setpoint and hysteresis	0 ... 3	0	Num.
Ad	Ad01	17542	49575.6	WORD		-1	Y	RW	Constant accumulation compensation	0 ... 255	20	Num.
Ad	Ad02	17544	49576	WORD		-1	N	RW	Accumulation compensation differential	0 ... 255	5	°C
Ad	Ad03	17546	49576.2	WORD	Y	-1	N	RW	Accumulation compensation block setpoint in Cool	-500 ... 999	40	°C
Ad	Ad04	17548	49576.4	WORD	Y	-1	N	RW	Accumulation compensation block setpoint in Heat	-500 ... 999	500	°C
Ad	Ad05	17550	49576.6	WORD			Y	RW	Time compressor on for accumulation compensation regression	0 ... 255	24	sec x 10
Ad	Ad06	17552	49577	WORD			Y	RW	Compressor on reference time for accumulation compensation	0 ... 255	18	sec x 10
AF	AF00	50332	49577.2	BYTE			Y	RW	Select antifreeze probe with circuit 1 heat pump	0 ... 5	0	num.
AF	AF01	50333	49577.4	BYTE			Y	RW	Select antifreeze probe with circuit 2 heat pump	0 ... 5	0	num.
AF	AF02	17566	49577.6	WORD	Y	-1	N	RW	Setpoint for antifreeze regulator with heat pump	-500 ... 999	50	°C
AF	AF03	17568	49578	WORD		-1	N	RW	Anti-freeze regulator hysteresis with heat pump	1 ... 125	30	°C
AS	AS00	50344	49578.2	BYTE			Y	RW	Select ACS mode	0 ... 6	0	num.
AS	AS01	17578	49578.4	WORD	Y	-1	Y	RW	ACS setpoint	AS2 ... AS03	500	°C
AS	AS02	17580	49578.6	WORD	Y	-1	Y	RW	ACS minimum setpoint	-500 ... AS03	400	°C
AS	AS03	17582	49579	WORD	Y	-1	Y	RW	ACS maximum setpoint	AS02 ... 999	600	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
AS	AS04	17584	49579.2	WORD		-1	Y	RW	ACS hysteresis	1 ... 255	30	°C
AS	AS05	17586	49579.4	WORD	Y	-1	Y	RW	ACS disengage setpoint differential	-500 ... 999	30	°C
AS	AS06	17588	49579.6	WORD		-1	Y	RW	ACS heater hysteresis	1 ... 255	20	°C
AS	AS07	17590	49580	WORD		-1	Y	RW	ACS heater differential	0 ... 999	0	°C
AS	AS08	17592	49580.2	WORD	Y	-1	Y	RW	ACS antifreeze setpoint	-500 ... AS03	30	°C
AS	AS09	17594	49580.4	WORD			Y	RW	ACS maximum activation time	1 ... 999	60	min
AS	AS10	17596	49580.6	WORD			Y	RW	ACS minimum deactivation/activation time	1 ... 999	60	min
AS	AS11	17598	49581	WORD		-1	Y	RW	Sanitary water set point dynamic constant	0 ... 255	0	°C
AS	AS12	17600	49581.2	WORD	Y	-1	Y	RW	Sanitary water system maximum temperature	-500 ... 999	650	°C
AS	AS20	17602	49581.4	WORD	Y	-1	Y	RW	ACS setpoint for anti-legionnaire's disease	AS21... AS22	650	°C
AS	AS21	17604	49581.6	WORD	Y	-1	Y	RW	Minimum ACS setpoint for anti-legionnaire's disease	-500 ... AS22	600	°C
AS	AS22	17606	49582	WORD	Y	-1	Y	RW	Maximum ACS setpoint for anti-legionnaire's disease	AS21 ... 999	700	°C
AS	AS23	17608	49582.2	WORD			Y	RW	ACS minimum deactivation/activation time for anti-legionnaire's disease	1 ... 999	15	min
AS	AS25	50382	49582.4	BYTE			Y	RW	Anti-legionnaire's disease period, day 1	0 ... 24	0	Hours
AS	AS26	50383	49582.6	BYTE			Y	RW	Event hour, day 1	0 ... 23	0	Hours
AS	AS27	50384	49583	BYTE			Y	RW	Event minutes, day 1	0 ... 59	0	Minutes
AS	AS28	50385	49583.2	BYTE			Y	RW	Anti-legionnaire's disease period, day 2	0 ... 24	0	Hours
AS	AS29	50386	49583.4	BYTE			Y	RW	Event hour, day 2	0 ... 23	0	Hours
AS	AS30	50387	49583.6	BYTE			Y	RW	Event minutes, day 2	0 ... 59	0	Minutes
AS	AS31	50388	49584	BYTE			Y	RW	Anti-legionnaire's disease period, day 3	0 ... 24	0	Hours
AS	AS32	50389	49584.2	BYTE			Y	RW	Event hour, day 3	0 ... 23	0	Hours
AS	AS33	50390	49584.4	BYTE			Y	RW	Event minutes, day 3	0 ... 59	0	Minutes
AS	AS34	50391	49584.6	BYTE			Y	RW	Anti-legionnaire's disease period, day 4	0 ... 24	0	Hours
AS	AS35	50392	49585	BYTE			Y	RW	Event hour, day 4	0 ... 23	0	Hours
AS	AS36	50393	49585.2	BYTE			Y	RW	Event minutes, day 4	0 ... 59	0	Minutes
AS	AS37	50394	49585.4	BYTE			Y	RW	Anti-legionnaire's disease period, day 5	0 ... 24	0	Hours
AS	AS38	50395	49585.6	BYTE			Y	RW	Event hour, day 5	0 ... 23	0	Hours
AS	AS39	50396	49586	BYTE			Y	RW	Event minutes, day 5	0 ... 59	0	Minutes
AS	AS40	50397	49586.2	BYTE			Y	RW	Anti-legionnaire's disease period, day 6	0 ... 24	0	Hours
AS	AS41	50206	49586.4	BYTE			Y	RW	Event hour, day 6	0 ... 23	0	Hours

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
AS	AS42	50399	49586.6	BYTE			Y	RW	Event minutes, day 6	0 ... 59	0	Minute s
AS	AS43	50400	49587	BYTE			Y	RW	Anti-legionnaire's disease period, day 7	0 ... 24	0	Hours
AS	AS44	50401	49587.2	BYTE			Y	RW	Event hour, day 7	0 ... 23	0	Hours
AS	AS45	50402	49587.4	BYTE			Y	RW	Event minutes, day 7	0 ... 59	0	Minute s
HP	HP00	50408	49587.6	BYTE			Y	RW	Select heat pump lock probe 1 0=No probe (pump block disabled) 1=External temperature - Heating 2=Internal exchanger water/air inlet temperature - Cooling 3=Internal exchanger water/air outlet temperature - Cooling 4=Circuit 1 and 2 internal exchanger water outlet average temperature - Cooling 5=Recovery (or external) exchanger inlet water temperature - Cooling 6=Recovery (or external) exchanger inlet water temperature -Cooling 7=Circuit 1 and 2 external exchanger average temperature - Cooling	0 ... 7	0	num.
HP	HP01	17642	49588	WORD	Y	-1	N	RW	Heat pump 1 lock setpoint	-500 ... 999	0	°C
HP	HP02	17644	49588.2	WORD		-1	N	RW	Heat pump 1 lock hysteresis	1 ... 255	20	°C
HP	HP03	17646	49588.4	WORD	Y	-1	Y	RW	Heat pump 1 lock maximum dynamic differential	-500 ... 999	0	°C
HP	HP04	17648	49588.6	WORD	Y	-1	Y	RW	Heat pump 1 lock dynamic differential setpoint	-500 ... 999	0	°C
HP	HP05	17650	49589	WORD	Y	-1	Y	RW	Heat pump 1 lock dynamic differential proportional band	-500 ... 999	0	°C
HP	HP10	50424	49589.2	BYTE			Y	RW	Select heat pump lock probe 2	0 ... 7	0	num.
HP	HP11	17658	49589.4	WORD	Y	-1	N	RW	Heat pump 2 lock setpoint	-500 ... 999	450	°C
HP	HP12	17660	49589.6	WORD		-1	N	RW	Heat pump 2 lock hysteresis	1 ... 255	20	°C
PL	PL00	17676	49590	WORD		-1	Y	RW	Power limitation on external temperature Power limitation proportional band on external temperature	0 ... 255	0	°C
PL	PL01	17678	49590.2	WORD	Y	-1	N	RW	External temperature setpoint for power limitation in Cool	-500 ... 999	500	°C
PL	PL02	17680	49590.4	WORD	Y	-1	N	RW	External temperature setpoint for power limitation in Heat	-500 ... 999	-50	°C
PL	PL10	17686	49590.6	WORD		-1	Y	RW	Power limitation on temperature Power limitation proportional band on water/air temperature	0 ... 255	0	°C
PL	PL11	50456	49591	BYTE			Y	RW	Power limitation probe selection on water/air temperature 0=No probe (Controller disabled) 1=Internal exchanger water/air inlet temperature 2=Internal exchanger water/air outlet temperature 3=Circuit 1 and 2 internal exchanger water outlet average temperature 4=Recovery (or external) exchanger inlet water temperature 5=Recovery (or external) exchanger outlet water temperature 6=Circuit 1 and 2 external exchanger average temperature	0 ... 6	2	Num.
PL	PL12	17690	49591.2	WORD	Y	-1	N	RW	High temperature setpoint for power limitation	-500 ... 999	500	°C
PL	PL13	17692	49591.4	WORD	Y	-1	N	RW	Low temperature setpoint for power limitation	-500 ... 999	50	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
PL	PL20	17694	49591.6	WORD		-1	Y	RW	Power limitation on pressure Power limitation proportional band on pressure	0 ... 255	0	Bar
PL	PL21	17696	49592	WORD	Y	-1	N	RW	High pressure setpoint for power limitation	-500 ... 999	400	Bar
PL	PL22	17698	49592.2	WORD	Y	-1	N	RW	Low pressure setpoint for power limitation	-500 ... 999	30	Bar
tE	tE00	50688	49592.4	BYTE			Y	RW	Enable time band operation 0= time bands disabled 1= time bands enabled	0 ... 1	0	Num.
tE	tE01	50689	49592.6	BYTE			Y	RW	Select profile, day 1 To select the profile of the first day of the week MONDAY 1= Profile 1 2= Profile 2 3= Profile 3	1 ... 3	1	Num.
tE	tE02	50690	49593	BYTE			Y	RW	Select profile, day 2 TUESDAY – See tE01	1 ... 3	1	Num.
tE	tE03	50691	49593.2	BYTE			Y	RW	Select profile, day 3 WEDNESDAY – See tE01	1 ... 3	1	Num.
tE	tE04	50692	49593.4	BYTE			Y	RW	Select profile, day 4 THURSDAY – See tE01	1 ... 3	1	Num.
tE	tE05	50693	49593.6	BYTE			Y	RW	Select profile, day 5 FRIDAY – See tE01	1 ... 3	1	Num.
tE	tE06	50694	49594	BYTE			Y	RW	Select profile, day 6 SATURDAY – See tE01	1 ... 3	2	Num.
tE	tE07	50695	49594.2	BYTE			Y	RW	Select profile, day 7 SUNDAY – See tE01	1 ... 3	3	Num.
tE	tE10	50700	49594.4	BYTE			Y	RW	PROFILE 1 EVENT 1 / PROFILE 1 Event start time hour 1, profile 1	0 ... 23	7	Hours
tE	tE11	50701	49594.6	BYTE			Y	RW	Event start time minutes 1, profile 1	0 ... 59	0	Minutes
tE	tE12	50702	49595	BYTE			Y	RW	Operating mode from event 1, profile 1 Determines the operating mode of Energy Flex during the event 0= ON 1 = Standby	0 ... 1	0	Num.
tE	tE13	17936	49595.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 1, profile 1 Determines the Cool setpoint to use during the event (with Energy Flex in Cool mode)	tr11 ... tr12	120	°C
tE	tE14	17938	49595.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 1, profile 1 Determines the Heat setpoint to use during the event (with Energy Flex in Heat mode)	tr21 ... tr22	400	°C
tE	tE15	17940	49595.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 1, profile 1 Determines the sanitary water setpoint to use during the event	AS02 ... AS03	450	°C
tE	tE17	50712	49596	BYTE			Y	RW	EVENT 2 / PROFILE 1 (see tE10...tE14) Event start time hour 2, profile 1	0 ... 23	12	Hours

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
tE	tE18	50713	49596.2	BYTE			Y	RW	Event start time minutes 2, profile 1	0 ... 59	0	Minute s
tE	tE19	50714	49596.4	BYTE			Y	RW	Operating mode from event 2, profile 1	0 ... 1	0	Num.
tE	tE20	17948	49596.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 2, profile 1	tr11 ... tr12	120	°C
tE	tE21	17950	49597	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 2, profile 1	tr21 ... tr22	400	°C
tE	tE22	17952	49597.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 2, profile 1	AS02 ... AS03	450	°C
tE	tE24	50724	49597.4	BYTE			Y	RW	EVENT 3 / PROFILE 1 (see tE10...tE14) Event start time hour 3, profile 1	0 ... 23	15	Hours
tE	tE25	50725	49597.6	BYTE			Y	RW	Event start time minutes 3, profile 1	0 ... 59	0	Minute s
tE	tE26	50726	49598	BYTE			Y	RW	Operating mode from event 3, profile 1	0 ... 1	0	Num.
tE	tE27	17960	49598.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 3, profile 1	tr11 ... tr12	120	°C
tE	tE28	17962	49598.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 3, profile 1	tr21 ... tr22	400	°C
tE	tE29	17964	49598.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 3, profile 1	AS02 ... AS03	450	°C
tE	tE31	50736	49599	BYTE			Y	RW	EVENT 4 / PROFILE 1 (see tE10...tE14) Event start time hour 4, profile 1	0 ... 23	22	Hours
tE	tE32	50737	49599.2	BYTE			Y	RW	Event start time minutes 4, profile 1	0 ... 59	0	Minute s
tE	tE33	50738	49599.4	BYTE			Y	RW	Operating mode from event 4, profile 1	0 ... 1	0	Num.
tE	tE34	17972	49599.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 4, profile 1	tr11 ... tr12	120	°C
tE	tE35	17974	49600	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 4, profile 1	tr21 ... tr22	400	°C
tE	tE36	17976	49600.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 4, profile 1	AS02 ... AS03	450	°C
tE	tE38	50748	49600.4	BYTE			Y	RW	PROFILE 2 EVENT 1 / PROFILE 2 (see tE10...tE14) Event start time hour 1, profile 2	0 ... 23	7	Hours
tE	tE39	50749	49600.6	BYTE			Y	RW	Event start time minutes 1, profile 2	0 ... 59	0	Minute s
tE	tE40	50750	49601	BYTE			Y	RW	Operating mode from event 1, profile 2	0 ... 1	0	Num.
tE	tE41	17984	49601.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 1, profile 2	tr11 ... tr12	120	°C
tE	tE42	17986	49601.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 1, profile 2	tr21 ... tr22	400	°C
tE	tE43	17988	49601.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 1, profile 2	AS02 ... AS03	450	°C
tE	tE45	50760	49602	BYTE			Y	RW	EVENT 2 / PROFILE 2 (see tE10...tE14) Event start time hour 2, profile 2	0 ... 23	12	Hours
tE	tE46	50761	49602.2	BYTE			Y	RW	Event start time minutes 2, profile 2	0 ... 59	0	Minute s
tE	tE47	50762	49602.4	BYTE			Y	RW	Operating mode from event 2, profile 2	0 ... 1	0	Num.
tE	tE48	17996	49602.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 2, profile 2	tr11 ... tr12	120	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
tE	tE49	17998	49603	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 2, profile 2	tr21 ... tr22	400	°C
tE	tE50	18000	49603.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 2, profile 2	AS02 ... AS03	450	°C
tE	tE52	50772	49603.4	BYTE			Y	RW	EVENT 3 / PROFILE 2 (see tE10...tE14) Event start time hour 3, profile 2	0 ... 23	15	Hours
tE	tE53	50773	49603.6	BYTE			Y	RW	Event start time minutes 3, profile 2	0 ... 59	0	Minutes
tE	tE54	50774	49604	BYTE			Y	RW	Operating mode from event 3, profile 2	0 ... 1	0	Num.
tE	tE55	18008	49604.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 3, profile 2	tr11 ... tr12	120	°C
tE	tE56	18010	49604.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 3, profile 2	tr21 ... tr22	400	°C
tE	tE57	18012	49604.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 3, profile 2	AS02 ... AS03	450	°C
tE	tE59	50784	49605	BYTE			Y	RW	EVENT 4 / PROFILE 2 (see tE10...tE14) Event start time hour 4, profile 2	0 ... 23	22	Hours
tE	tE60	50785	49605.2	BYTE			Y	RW	Event start time minutes 4, profile 2	0 ... 59	0	Minutes
tE	tE61	50786	49605.4	BYTE			Y	RW	Operating mode from event 4, profile 2	0 ... 1	0	Num.
tE	tE62	18020	49605.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 4, profile 2	tr11 ... tr12	120	°C
tE	tE63	18022	49606	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 4, profile 2	tr21 ... tr22	400	°C
tE	tE64	18024	49606.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 4, profile 2	AS02 ... AS03	450	°C
tE	tE66	50796	49606.4	BYTE			Y	RW	PROFILE 3 EVENT 1 / PROFILE 3 (see tE10...tE14) Event start time hour 3, profile 3	0 ... 23	7	Hours
tE	tE67	50797	49606.6	BYTE			Y	RW	Event start time minutes 1, profile 3	0 ... 59	0	Minutes
tE	tE68	50798	49607	BYTE			Y	RW	Operating mode from event 1, profile 3	0 ... 1	0	Num.
tE	tE69	18032	49607.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 1, profile 3	tr11 ... tr12	120	°C
tE	tE70	18034	49607.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 1, profile 3	tr21 ... tr22	400	°C
tE	tE71	18036	49607.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 1, profile 3	AS02 ... AS03	450	°C
tE	tE73	50808	49608	BYTE			Y	RW	EVENT 2 / PROFILE 3 (see tE10...tE14) Event start time hour 2, profile 3	0 ... 23	12	Hours
tE	tE74	50809	49608.2	BYTE			Y	RW	Event start time minutes 2, profile 3	0 ... 59	0	Minutes
tE	tE75	50810	49608.4	BYTE			Y	RW	Operating mode from event 2, profile 3	0 ... 1	0	Num.
tE	tE76	18044	49608.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 2, profile 3	tr11 ... tr12	120	°C
tE	tE77	18046	49609	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 2, profile 3	tr21 ... tr22	400	°C
tE	tE78	18048	49609.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 2, profile 3	AS02 ... AS03	450	°C
tE	tE80	50820	49609.4	BYTE			Y	RW	EVENT 3 / PROFILE 3 (see tE10...tE14) Event start time hour 3, profile 3	0 ... 23	15	Hours

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
tE	tE81	50821	49609.6	BYTE			Y	RW	Event start time minutes 3, profile 3	0 ... 59	0	Minute s
tE	tE82	50822	49610	BYTE			Y	RW	Operating mode from event 3, profile 3	0 ... 1	0	Num.
tE	tE83	18056	49610.2	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 3, profile 3	tr11 ... tr12	120	°C
tE	tE84	18058	49610.4	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 3, profile 3	tr21 ... tr22	400	°C
tE	tE85	18060	49610.6	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 3, profile 3	AS02 ... AS03	450	°C
tE	tE87	50832	49611	BYTE			Y	RW	EVENT 4 / PROFILE 3 (see tE10...tE14) Event start time hour 4, profile 3	0 ... 23	22	Hours
tE	tE88	50833	49611.2	BYTE			Y	RW	Event start time minutes 4, profile 3	0 ... 59	0	Minute s
tE	tE89	50834	49611.4	BYTE			Y	RW	Operating mode from event 4, profile 3	0 ... 1	0	Num.
tE	tE90	18068	49611.6	WORD	Y	-1	Y	RW	Cool mode temperature regulator setpoint, from event 4, profile 3	tr11 ... tr12	120	°C
tE	tE91	18070	49612	WORD	Y	-1	Y	RW	Heat mode temperature regulator setpoint, from event 4, profile 3	tr21 ... tr22	400	°C
tE	tE92	18072	49612.2	WORD	Y	-1	Y	RW	Sanitary water setpoint from event 4, profile 3	AS02 ... AS03	450	°C
AL	AL00	50572	49612.4	BYTE			Y	RW	Time interval for alarm event count To modify the interval in which alarm events are counted Alarms are sampled every AL00/32 = sampling time	1 ... 99	60	Min
AL	AL01	50573	49612.6	BYTE			Y	RW	Maximum number of historical events per alarm message	0 ... 99	0	num.
AL	AL10	50580	49613	BYTE			Y	RW	DIGITAL ALARMS Number of high pressure alarms	1 ... 255	1	num.
AL	AL11	50581	49613.2	BYTE			Y	RW	Low pressure alarm bypass time	0 ... 255	120	sec
AL	AL12	50582	49613.4	BYTE			Y	RW	Number of low pressure alarms	1 ... 255	3	num.
AL	AL13	50583	49613.6	BYTE			Y	RW	Enable low pressure alarm during defrost 0 = Alarm disabled 1 = Alarm enabled	0 ... 1	0	num.
AL	AL14	50584	49614	BYTE			Y	RW	Flow switch bypass time after primary circuit water pump enabled	0 ... 255	40	sec
AL	AL15	50585	49614.2	BYTE			Y	RW	Flow switch activation/deactivation time on internal circuit automatic alarm	0 ... 255	5	sec
AL	AL16	50586	49614.4	BYTE			Y	RW	Enable flow switch time for primary circuit manual alarm	0 ... 255	2	Sec x 10
AL	AL17	50587	49614.6	BYTE			Y	RW	Flow switch bypass time after open-circuit pump activated	0 ... 255	15	sec
AL	AL18	50588	49615	BYTE			Y	RW	Flow switch activation/deactivation time on external circuit automatic alarm	0 ... 255	5	sec
AL	AL19	50589	49615.2	BYTE			Y	RW	Time flow switch on before open-circuit manual alarm	0 ... 255	2	sec x 10
AL	AL20	50590	49615.4	BYTE			Y	RW	Bypass compressor thermal switch alarm time	0 ... 255	1	sec
AL	AL21	50591	49615.6	BYTE			Y	RW	Number of compressor thermal switch alarms	1 ... 255	1	num.
AL	AL22	50592	49616	BYTE			Y	RW	Compressor oil pressure switch alarm bypass time	0 ... 255	1	sec
AL	AL23	50593	49616.2	BYTE			Y	RW	Number of compressor oil pressure switch alarms	1 ... 255	1	num.
AL	AL24	50594	49616.4	BYTE			Y	RW	Number of primary intercooler fan thermal switch alarms	1 ... 255	1	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
AL	AL25	50595	49616.6	BYTE			Y	RW	Number of open-system intercooler fan thermal switch alarms	1 ... 255	1	num.
AL	AL26	50596	49617	BYTE			Y	RW	Number of primary circuit pump thermal switch alarms	1 ... 255	2	num.
AL	AL27	50597	49617.2	BYTE			Y	RW	Number of open-system pump thermal switch alarms	1 ... 255	2	num.
AL	AL40	17840	49617.4	WORD	Y	-1	Y	RW	ANALOGUE ALARMS High pressure alarm regulator setpoint from analogue input	-500 ... 999	420	Bar
AL	AL41	17842	49617.6	WORD		-1	N	RW	High pressure alarm regulator hysteresis from analogue input	1 ... 255	20	Bar
AL	AL42	50612	49618	BYTE			Y	RW	Number of high pressure alarms from analogue input	1 ... 255	1	num.
AL	AL43	50613	49618.2	BYTE			Y	RW	Low pressure alarm bypass time from analogue input	0 ... 255	10	sec
AL	AL44	17846	49618.4	WORD	Y	-1	N	RW	Low pressure alarm regulator setpoint from analogue input	-500 ... 999	20	Bar
AL	AL45	17848	49618.6	WORD		-1	N	RW	Low pressure alarm regulator hysteresis from analogue input	1 ... 255	20	Bar
AL	AL46	50618	49619	BYTE			Y	RW	Number of low pressure alarms from analogue input	1 ... 255	2	num.
AL	AL47	17852	49619.2	WORD	Y	-1	N	RW	High temperature alarm regulator setpoint from analogue input	-500 ... 999	800	°C
AL	AL48	17854	49619.4	WORD		-1	N	RW	High temperature alarm regulator hysteresis from analogue input	1 ... 255	20	°C
AL	AL49	50624	49619.6	BYTE			Y	RW	High temperature time per alarm	0 ... 255	30	sec x 10
AL	AL50	50625	49620	BYTE			Y	RW	Primary circuit anti-freeze alarm bypass time	0 ... 255	1	min
AL	AL51	17858	49620.2	WORD	Y	-1	N	RW	Primary circuit anti-freeze regulator setpoint alarm	-500 ... 999	40	°C
AL	AL52	17860	49620.4	WORD		-1	N	RW	Primary circuit anti-freeze regulator hysteresis alarm	1 ... 255	20	°C
AL	AL53	50630	49620.6	BYTE			Y	RW	Number of primary circuit anti-freeze alarms	1 ... 255	1	num.
AL	AL54	50631	49621	BYTE			Y	RW	Open-system circuit anti-freeze alarm bypass time	0 ... 255	1	min
AL	AL55	17864	49621.2	WORD	Y	-1	N	RW	Open-system circuit anti-freeze regulator setpoint alarm	-500 ... 999	40	°C
AL	AL56	17866	49621.4	WORD		-1	N	RW	Open-system circuit anti-freeze regulator hysteresis alarm	1 ... 255	20	°C
AL	AL57	50636	49621.6	BYTE			Y	RW	NO REFRIGERANT Number of open-system anti-freeze alarms	1 ... 255	1	num.
AL	AL58	50637	49622.2	BYTE			Y	RW	Activation time of vacuum alarm from analog input	0 ... 255	10	sec
AL	AL59	17870	49622.4	BYTE	Y	-1	N	RW	Setpoint of vacuum alarm regulator from analog input	-500 ... 999	20	bar
AL	AL60	17882	49622.6	BYTE		-1	N	RW	Hysteresis of vacuum alarm regulator from analog input	1 ... 255	20	bar
AL	AL70	50640	49622	BYTE			Y	RW	Enable gas low in plant alarm	0 ... 1	0	Num.
AL	AL71	50641	49622.2	BYTE			Y	RW	Gas low in plant alarm bypass time	0 ... 255	5	min
AL	AL72	17874	49622.4	WORD		-1	N	RW	Gas low in plant alarm differential	0 ... 255	20	°C
AL	AL73	50644	49622.6	BYTE			Y	RW	Time gas low in plant before alarm	0 ... 255	30	min
AL	AL80	50652	49623	BYTE			Y	RW	MAINTENANCE Compressor start time on maintenance signal	0 ... 255	0	hoursx1 00
AL	AL81	50653	49623.2	BYTE			Y	RW	Internal pump start time on maintenance signal	0 ... 255	0	hoursx1 00
AL	AL82	50462	49623.4	BYTE			Y	RW	Internal pump start time on maintenance signal	0 ... 255	0	hoursx1 00

N.B. Parameters AL80/AL81/AL82 see Alarms E081/E085/E086

27.2.2 Configuration parameters for XVD driver 1 (1r / 1F / 1L / 1E)

27.2.3 Configuration parameters for XVD driver 2 (2r / 2F / 2L / 2E)

Parameters with prefix 1 are relative to driver XVD1 while those with prefix 2 concern XVD2.
Exclusively parameters with prefix 1 are described below; parameters with prefix 2 are identical.
The table shows both parameters.
The resources of the 2 XVD drivers can be configured for use by the base in the same way as an expansion.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
1R	1R00	50992	49481	BYTE			Y	RW	Driver EEV1 enabling 0 = driver disabled; 1 = driver enabled	0 ... 1	1	flag
1R	1R30	50997	49481.2	BYTE			Y	RW	Analogue input 1Ai1 configuration See Table A Analogue Inputs Configuration N.B. Values 0...30	0 ... 30	0	num.
1R	1R31	50998	49481.4	BYTE			Y	RW	Analogue input 1Ai2 configuration See Table A Analogue Inputs Configuration N.B. Values 0...16	0 ... 16	0	num.
1R	1R32	50999	49481.6	BYTE			Y	RW	Analogue input 1Ai3 configuration See 1R31	0 ... 16	0	num.
1R	1R33	51000	49482	BYTE			Y	RW	Analogue input 1Ai4 configuration See 1R31	0 ... 16	0	num.
1R	1R40	50993	49482.2	BYTE	Y		Y	RW	Digital input 1Ai3 configuration Configures analogue input Ai3 if configured as a digital input See Table B Digital Inputs Configuration	-58 ... 58	0	num.
1R	1R41	50994	49482.4	BYTE	Y		Y	RW	Digital input 1Ai4 configuration Configures analogue input Ai4 if configured as a digital input See 1R40	-58 ... 58	0	num.
1R	1R91	51004	49483	BYTE	Y		Y	RW	Digital output 1dO configuration See Table C Digital Outputs Configuration	-53 ... 53	0	num.
1F	1F02	51025	49483.2	BYTE			Y	RW	Control from digital inputs or serial port 0 = DI (digital input) 1 = LAN 2 = LAN + shared probe 3 = DI (digital input) + shared probe	0 ... 3	1	num.
1F	1F10	51024	49483.4	BYTE			Y	RW	COM Lincus protocol controller address 2= XVD 1 (MASTER XVD) 3= XVD 2 (SLAVE XVD)	2 ... 3	2	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
1L	1L00	51074	49483.6	BYTE			Y	RW	Analogue input 1Ai1 type 0 = Probe not configured 1 = NTC. 2 = Pt1000 3 = 4..20mA 4= Ratiometric transducer 0-5V 5 = 0-10V 6 = extended range NTC	0 ... 6	3	num.
1L	1L01	51075	49484	BYTE			Y	RW	Analogue input 1Ai2 type 0 = Probe not configured 1 = NTC. 2 = Pt1000 3= NOT USED 4= NOT USED 5= NOT USED 6 = extended range NTC	0 ... 6	1	num.
1L	1L02	51076	49484.2	BYTE			Y	RW	Analogue input 1Ai3 type 0 = Probe not configured 1 = NTC. 2= NOT USED 3= NOT USED 4= NOT USED 5= NOT USED 6 = extended range NTC 7 = DI (digital input)	0 ... 7	1	num.
1L	1L03	51077	49484.4	BYTE			Y	RW	Analogue input 1Ai4 type See 1L02	0 ... 7	1	num.
1L	1L10*	18310	49485.2	WORD	Y	-1	Y	RW	Analogue input 1Ai1 fullscale value See N.B.*	1L11 ... 9999	70	bar
1L	1L11	18314	49485.4	WORD	Y	-1	Y	RW	Analogue input 1Ai1 start of scale value	-145 ... 1L10	-5	bar
1L	1L20	51086	49486.2	BYTE	Y	-1	Y	RW	Analogue input 1Ai1 differential the differential is calculated on the pressure or temperature value depending on the selected probe type	-120 ... 120	0	bar/°C
1L	1L21	51087	49486.4	BYTE	Y	-1	Y	RW	Analogue input 1Ai2 differential the differential is calculated on the temperature value depending on the selected probe type	-120 ... 120	0	°C
1L	1L22	51088	49486.6	BYTE	Y	-1	Y	RW	Analogue input 1Ai3 differential See 1L21	-120 ... 120	0	°C
1L	1L23	51089	49487	BYTE	Y	-1	Y	RW	Analogue input 1Ai4 differential See 1L21	-120 ... 120	0	°C

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
1L	1L30	51094	49487.2	BYTE			Y	RW	Analogue input 1Ai1 configuration 0=not used 1 = evaporator out, 2=saturation, 3=backup evaporator out 4=backup saturation (Note: temperature only) 5= valve opening direct control	0 ... 5	2	num.
1L	1L31	51095	49487.4	BYTE			Y	RW	Analogue input 1Ai2 configuration 0 = not used 1 = evaporator out, 2=saturation, 3=backup evaporator out 4=backup saturation (Note: temperature only)	0 ... 4	1	num.
1L	1L32	51096	49487.6	BYTE			Y	RW	Analogue input 1Ai3 configuration See 1L30	0 ... 4	0	num.
1L	1L33	51097	49488	BYTE			Y	RW	Analogue input 1Ai4 configuration See 1L30	0 ... 4	0	num.
1L	1L40	51092	49488.2	BYTE	Y		Y	RW	Digital input 1Ai3 configuration 0= Digital input not configured ±1= ON/OFF driver (regulation) 2 = defrost ±3= alarm ±4= installation operating mode COOL / HEAT (see parameters 1E21...1E22)	-4 ... 4	0	num.
1L	1L41	51093	49488.4	BYTE	Y		Y	RW	Digital input 1Ai4 configuration See 1L40	-7 ... 7	5	num.
1L	1L91	51099	49489	BYTE	Y		Y	RW	Digital output 1dO configuration 0 = not configured ±1= solenoid valve control ±2= alarm	-2 ... 2	0	num.
1E	1E00	51026	49489.2	BYTE			Y	RW	Valve model (see parameters dE01...dE09, dE80, see XVD parameters table in the Appendix) 0= customisable 1...12= NOT USED 13= ALCO EXM/EXL 14= SANHUA QA(Q) 15= NOT USED	0 ... 15	14	num.
1E	1E10	51027	49489.4	BYTE			Y	RW	Maximum valve opening percentage Defines the maximum valve opening value, meaning the actuation limits in percentages. 0 indicates valve completely closed	0 ... 100	100	%
1E	1E11	51028	49489.6	BYTE			Y	RW	Valve actuation percentage after blackout Value calculated automatically but settable using this parameter for first start-up	0 ... 100	0	%

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
1E	1E12	51029	49490	BYTE			Y	RW	Valve actuation percentage after defrost Value calculated automatically by settable via this parameter for first start-up. Se = 0 the percentage is defined by 1E11	0 ... 100	0	%
1E	1E13	51030	49490.2	BYTE			Y	RW	Operating time at max opening for alarm signal If valve opening remains at a value greater than 1E10 for the time defined by 1E13 a maximum opening alarm E107 will be tripped (see Alarms section) If = 0 signal disabled	0 ... 255	60	Min
1E	1E14	51031	49490.4	BYTE			Y	RW	Minimum valve useful opening percentage If the regulator commands an output of less than or equal to 1E14, the actual output = 0.	0 ... 1E15	0	%
1E	1E15	51032	49490.6	BYTE			Y	RW	Maximum valve useful opening percentage If the regulator commands an output greater than or equal to 1E15 the actual output is 1E10 (with 1E15 < 1E10). Disregarded if 1E15 > 1E10	1E14 ... 1E10	100	%
1E	1E16	51033	49491	BYTE			Y	RW	Valve opening percentage during probe error In the case of a probe error this defines opening of the valve, as a percentage value	0 ... 100	0	%
1E	1E20	51034	49491.2	BYTE			Y	RW	Select type of gas To use only if the configuration is set to 7. Otherwise 1E20 will be disregarded. 0=R404A; 1=r22; 2=R410a; 3=R134a; 4=R744 (CO2); 5=R407C; 6=R427A; 7= customisable	0 ... 7	2	num.
1E	1E21	51035	49491.4	BYTE			Y	RW	Type of system operating mode COOL In the case of 1E21=0 the user can set parameters 1E30...1E38,1E50...1E53 See XVD Open parameters set in the Appendix: V12 dE30....V12 dE53, ..., V16 dE30....V16 dE53	0 ... 16	12	num.
1E	1E22	51036	49491.6	BYTE			Y	RW	Type of system operating mode HEAT See 1E21	0 ... 16	13	num.
1E	1E30	51068	49492.4	BYTE			Y	RW	Enable reference overheating recalculation Used to enable the automatic recalculation of the referred Setpoint in order to regulate the overheating 0= recalculation disabled. Setpoint = 1E32; 1= automatic recalculation enabled	0 ... 1	0	flag

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
1E	1E31	18288	49492.6	WORD		-1	Y	RW	Overheating upper threshold Makes it possible to set setpoint SP4 to 1E31 (SP2) for control of superheating after a power loss or on exit from defrost cycle. Active for the time set by dE51 (or when the MOP function is disabled)	0 ... 1000	50	°C
1E	1E32	18286	49493	WORD		-1	Y	RW	Overheating lower threshold Used to set the setpoint SP2 to regulate the overheating (objective overheating) If dE30=1 and calculated setpoint < 1E32, the dynamic setpoint will be set = 1E32.	0 ... 1000	50	°C
1E	1E33	18290	49493.2	WORD			Y	RW	Overheating reference recalculation period Valid for 1E30=1 Defines the recalculation period of the dynamic setpoint (every 1E33 seconds)	0 ... 999	20	sec
1E	1E34	18292	49493.4	WORD		-1	Y	RW	Overheating recalculation step The dynamic setpoint varies by 1E34 degrees in accordance with the superheating value with respect to 1E32.	0 ... 1000	1	°C
1E	1E35	18272	49493.6	WORD			Y	RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	sec
1E	1E36	18294	49494	WORD	Y	-1	Y	RW	Overheating proportional band	-9999 ... -1	-100	K
1E	1E37	18296	49494.2	WORD			Y	RW	Overheating full time	0 ... 1999	40	sec
1E	1E38	18298	49494.4	WORD			Y	RW	Overheating derivative time	0 ... 1999	0	sec
1E	1E47	51072	49494.6	BYTE			Y	RW	Enable valve manual opening 0= automatic valve opening; 1= manual valve opening	0 ... 1	0	flag
1E	1E48	18302	49495	WORD		-1	Y	RW	Valve manual opening N.B.: valid if 1E47=1. N.B.: valve opening switched from automatic to manual (1E47=1) the opening percentage is not 0% as per default parameter but the percentage indicated by this parameter	0 ... 1000	0	%
1E	1E50	51052	49495.2	BYTE			Y	RW	Enable MOP 0= MOP disabled; 1 = MOP enabled.	0 ... 1	0	flag
1E	1E51	18276	49495.4	WORD			Y	RW	MOP disable time MOP activation delay on switching on or after defrost.	0 ... 999	0	sec
1E	1E52	18274	49495.6	WORD	Y	-1	Y	RW	Evaporator temperature upper threshold MOP setpoint	-600 ... 1000	0	°C
1E	1E53	51053	49496	BYTE			Y	RW	Min time that temperature upper threshold is exceeded for alarm activation If threshold 1E52 is exceeded for a time longer than 1E53 the MOP alarm is tripped.	0 ... 255	180	sec
	2xx						Y		For descriptions of parameters 2xx refer to the relative parameters 1xx			
2R	2R00	51008	49497	BYTE			Y	RW	Enable EEV driver2	0 ... 1	0	flag
2R	2R30	51013	49497.2	BYTE			Y	RW	Analogue input 2Ai1 configuration	0 ... 30	0	num.
2R	2R31	51014	49497.4	BYTE			Y	RW	Analogue input 2Ai2 configuration	0 ... 16	0	num.
2R	2R32	51015	49497.6	BYTE			Y	RW	Analogue input 2Ai3 configuration	0 ... 16	0	num.
2R	2R33	51016	49498	BYTE			Y	RW	Analogue input 2Ai4 configuration	0 ... 16	0	num.
2R	2R40	51009	49498.2	BYTE	Y		Y	RW	Digital input 2Ai3 configuration	-58 ... 58	0	num.
2R	2R41	51010	49498.4	BYTE	Y		Y	RW	Digital input 2Ai4 configuration	-58 ... 58	0	num.
2R	2R91	51020	49499	BYTE	Y		Y	RW	Digital output 2dO configuration	-53 ... 53	0	num.

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
2F	2F02	51281	49499.2	BYTE			Y	RW	Control from digital inputs or serial port	0 ... 3	1	num.
2F	2F10	51280	49499.4	BYTE			Y	RW	COM Lincus protocol controller address	2 ... 3	3	num.
2L	2L00	51330	49499.6	BYTE			Y	RW	Analogue input 2Ai1 type	0 ... 6	3	num.
2L	2L01	51331	49500	BYTE			Y	RW	Analogue input 2Ai2 type	0 ... 6	1	num.
2L	2L02	51332	49500.2	BYTE			Y	RW	Analogue input 2Ai3 type	0 ... 7	1	num.
2L	2L03	51333	49500.4	BYTE			Y	RW	Analogue input 2Ai4 type	0 ... 7	1	num.
2L	2L10*	18566	49501.2	WORD	Y	-1	Y	RW	Analogue input 2Ai1 full scale value. See N.B.*	2L11 ... 9999	70	bar
2L	2L11	18570	49501.4	WORD	Y	-1	Y	RW	Analogue input 2Ai1 start of scale value	-145 ... 2L10	-5	bar
2L	2L20	51342	49502.2	BYTE	Y	-1	Y	RW	Analogue input 2Ai1 differential	-120 ... 120	0	bar /°C
2L	2L21	51343	49502.4	BYTE	Y	-1	Y	RW	Analogue input 2Ai2 differential	-120 ... 120	0	°C
2L	2L22	51344	49502.6	BYTE	Y	-1	Y	RW	Analogue input 2Ai3 differential	-120 ... 120	0	°C
2L	2L23	51345	49503	BYTE	Y	-1	Y	RW	Analogue input 2Ai4 differential	-120 ... 120	0	°C
2L	2L30	51350	49503.2	BYTE			Y	RW	Analogue input 2Ai1 configuration	0 ... 5	2	num.
2L	2L31	51351	49503.4	BYTE			Y	RW	Analogue input 2Ai2 configuration	0 ... 5	1	num.
2L	2L32	51352	49503.6	BYTE			Y	RW	Analogue input 2Ai3 configuration	0 ... 4	0	num.
2L	2L33	51353	49504	BYTE			Y	RW	Analogue input 2Ai4 configuration	0 ... 4	0	num.
2L	2L40	51348	49504.2	BYTE	Y		Y	RW	Digital input 2Ai3 configuration	-7 ... 7	0	num.
2L	2L41	51349	49504.4	BYTE	Y		Y	RW	Digital input 2Ai4 configuration	-7 ... 7	0	num.
2L	2L91	51355	49505	BYTE	Y		Y	RW	Digital output 2dO configuration	-2 ... 2	0	num.
2E	2E00	51282	49505.2	BYTE			Y	RW	Valve model	0 ... 15	14	num.
2E	2E10	51283	49505.4	BYTE			Y	RW	Maximum valve opening percentage	0 ... 100	100	%
2E	2E11	51284	49505.6	BYTE			Y	RW	Valve actuation percentage after blackout	0 ... 100	0	%
2E	2E12	51285	49506	BYTE			Y	RW	Valve actuation percentage after defrost	0 ... 100	0	%
2E	2E13	51286	49506.2	BYTE			Y	RW	Operating time at max opening for alarm signal	0 ... 255	60	Min
2E	2E14	51287	49506.4	BYTE			Y	RW	Minimum valve useful opening percentage	0 ... 2E15	0	%
2E	2E15	51288	49506.6	BYTE			Y	RW	Maximum valve useful opening percentage	2E14 ... 2E10	100	%
2E	2E16	51289	49507	BYTE			Y	RW	Valve opening percentage during probe error	0 ... 100	2	%
2E	2E20	51290	49507.2	BYTE			Y	RW	Select type of gas	0 ... 7	2	num.
2E	2E21	51291	49507.4	BYTE			Y	RW	Type of system operating mode COOL	0 ... 16	1	num.
2E	2E22	51292	49507.6	BYTE			Y	RW	Type of system operating mode HEAT	0 ... 16	2	num.
2E	2E30	51324	49508.4	BYTE			Y	RW	Enable reference overheating recalculation	0 ... 1	0	flag
2E	2E31	18544	49508.6	WORD		-1	Y	RW	Overheating upper threshold	0 ... 1000	50	°C
2E	2E32	18542	49509	WORD		-1	Y	RW	Overheating lower threshold	0 ... 1000	50	°C
2E	2E33	18546	49509.2	WORD			Y	RW	Overheating reference recalculation period	0 ... 999	20	sec
2E	2E34	18548	49509.4	WORD		-1	Y	RW	Overheating recalculation step	0 ... 1000	1	°C
2E	2E35	18528	49509.6	WORD			Y	RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	sec

FOLDER	LABEL	ADDR	VIS ADDR	DATA SIZE	C P L	E X P	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
2E	2E36	18550	49510	WORD	Y	-1	Y	RW	Overheating proportional band	-9999 ... -1	-100	K
2E	2E37	18552	49510.2	WORD			Y	RW	Overheating full time	0 ... 1999	40	sec
2E	2E38	18554	49510.4	WORD			Y	RW	Overheating derivative time	0 ... 1999	0	sec
2E	2E47	51328	49510.6	BYTE			Y	RW	Enable valve manual opening	0 ... 1	0	flag
2E	2E48	18558	49511	WORD		-1	Y	RW	Valve manual opening	0 ... 1000	0	%
2E	2E50	51308	49511.2	BYTE			Y	RW	Enable MOP	0 ... 1	0	flag
2E	2E51	18532	49511.4	WORD			Y	RW	MOP disable time at start-up	0 ... 999	0	sec
2E	2E52	18530	49511.6	WORD	Y	-1	Y	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
2E	2E53	51309	49512	BYTE			Y	RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	sec

*N.B.: to set parameters 1L10/2L10 use Device Manager or the keypad SKP10 32x74 to view the values correctly over the entire permitted range

27.2.4 Folder visibility table

LABEL	ADDRESS	R/W	DESCRIPTION	DATA SIZE	RANGE	DEFAULT	U.M.
_VisSt0	49424	RW	Folder Ai visibility	2 bits	0 ... 3	3	num.
_VisSt1	49424.2	RW	Folder di visibility	2 bits	0 ... 3	3	num.
_VisSt2	49424.4	RW	Folder AO visibility	2 bits	0 ... 3	3	num.
_VisSt3	49424.6	RW	Folder dO visibility	2 bits	0 ... 3	3	num.
_VisSt4	49425	RW	Folder SP visibility	2 bits	0 ... 3	3	num.
_VisSt5	49425.2	RW	Folder Sr visibility	2 bits	0 ... 3	3	num.
_VisSt6	49425.4	RW	Folder Hr visibility	2 bits	0 ... 3	3	num.
_VisPa0	49425.6	RW	Folder Par visibility	2 bits	0 ... 3	3	num.
_VisPa1	49426	RW	Folder FnC visibility	2 bits	0 ... 3	3	num.
_VisPa2	49426.2	RW	Folder PASS visibility	2 bits	0 ... 3	3	num.
_VisPa3	49426.4	RW	Folder EU visibility	2 bits	0 ... 3	3	num.
_VisSSp0	49426.6	RW	Folder SP\COOL visibility	2 bits	0 ... 3	3	num.
_VisSSp1	49427	RW	Folder SP\HEAT visibility	2 bits	0 ... 3	3	num.
_VisSSp2	49427.2	RW	Folder SP\AS visibility	2 bits	0 ... 3	3	num.
_VisSSp3	49427.4	RW	Folder SP\AL visibility	2 bits	0 ... 3	3	num.
_VisSSr0	49427.6	RW	Folder Sr\COOL visibility	2 bits	0 ... 3	3	num.
_VisSSr1	49428	RW	Folder Sr\HEAT visibility	2 bits	0 ... 3	3	num.
_VisSSr2	49428.2	RW	Folder Sr\AS visibility	2 bits	0 ... 3	3	num.
_VisPP0	49428.4	RW	Folder Par\CL visibility	2 bits	0 ... 3	3	num.
_VisPP1	49428.6	RW	Folder Par\Cr visibility	2 bits	0 ... 3	3	num.
_VisPP2	49429	RW	Folder Par\CE visibility	2 bits	0 ... 3	3	num.
_VisPP3	49429.2	RW	Folder Par\CF visibility	2 bits	0 ... 3	3	num.
_VisPP4	49429.4	RW	Folder Par\Ui visibility	2 bits	0 ... 3	3	num.
_VisPP5	49429.6	RW	Folder Par\1R visibility	2 bits	0 ... 3	3	num.
_VisPP6	49430	RW	Folder Par\1F visibility	2 bits	0 ... 3	3	num.
_VisPP7	49430.2	RW	Folder Par\1L visibility	2 bits	0 ... 3	3	num.
_VisPP8	49430.4	RW	Folder Par\1E visibility	2 bits	0 ... 3	3	num.
_VisPP9	49430.6	RW	Folder Par\2R visibility	2 bits	0 ... 3	0	num.
_VisPP10	49431	RW	Folder Par\2F visibility	2 bits	0 ... 3	0	num.
_VisPP11	49431.2	RW	Folder Par\2L visibility	2 bits	0 ... 3	0	num.
_VisPP12	49431.4	RW	Folder Par\2E visibility	2 bits	0 ... 3	0	num.
_VisPP13	49431.6	RW	Folder Par\tr visibility	2 bits	0 ... 3	3	num.
_VisPP14	49432	RW	Folder Par\St visibility	2 bits	0 ... 3	3	num.
_VisPP15	49432.2	RW	Folder Par\RI visibility	2 bits	0 ... 3	3	num.

LABEL	ADDRESS	R/W	DESCRIPTION	DATA SIZE	RANGE	DEFAULT	U.M.
_VisPP16	49432.4	RW	Folder Par\CP visibility	2 bits	0 ... 3	3	num.
_VisPP17	49432.6	RW	Folder Par\PI visibility	2 bits	0 ... 3	3	num.
_VisPP18	49433	RW	Folder Par\Fi visibility	2 bits	0 ... 3	3	num.
_VisPP19	49433.2	RW	Folder Par\FE visibility	2 bits	0 ... 3	3	num.
_VisPP20	49433.4	RW	Folder Par\PE visibility	2 bits	0 ... 3	3	num.
_VisPP21	49433.6	RW	Folder Par\Hi visibility	2 bits	0 ... 3	3	num.
_VisPP22	49434	RW	Folder Par\HE visibility	2 bits	0 ... 3	3	num.
_VisPP23	49434.2	RW	Folder Par\HA visibility	2 bits	0 ... 3	3	num.
_VisPP24	49434.4	RW	Folder Par\br visibility	2 bits	0 ... 3	3	num.
_VisPP26	49435	RW	Folder Par\dF visibility	2 bits	0 ... 3	3	num.
_VisPP27	49435.2	RW	Folder Par\dS visibility	2 bits	0 ... 3	3	num.
_VisPP28	49435.4	RW	Folder Par\Ad visibility	2 bits	0 ... 3	3	num.
_VisPP29	49435.6	RW	Folder Par\AF visibility	2 bits	0 ... 3	3	num.
_VisPP30	49436	RW	Folder Par\AS visibility	2 bits	0 ... 3	3	num.
_VisPP31	49436.2	RW	Folder Par\HP visibility	2 bits	0 ... 3	3	num.
_VisPP32	49436.4	RW	Folder Par\PL visibility	2 bits	0 ... 3	3	num.
_VisPP33	49436.6	RW	Folder Par\TE visibility	2 bits	0 ... 3	3	num.
_VisPP34	49437	RW	Folder Par\AL visibility	2 bits	0 ... 3	3	num.
_VisPF0	49437.4	RW	Folder Fnc\deF visibility	2 bits	0 ... 3	3	num.
_VisPF1	49437.6	RW	Folder Fnc\TA visibility	2 bits	0 ... 3	3	num.
_VisPF2	49438	RW	Folder Fnc\St visibility	2 bits	0 ... 3	3	num.
_VisPF3	49438.2	RW	Folder Fnc\CC visibility	2 bits	0 ... 3	3	num.
_VisPF4	49438.4	RW	Folder Fnc\Eur visibility	2 bits	0 ... 3	3	num.
_VisPFCC0	49623.6	RW	Folder Fnc\CC\UL visibility	2 bits	0 ... 3	3	num.
_VisPFCC1	49624	RW	Folder Fnc\CC\dL visibility	2 bits	0 ... 3	3	num.
_VisPFCC2	49624.2	RW	Folder Fnc\CC\Fr visibility	2 bits	0 ... 3	3	num.

27.2.5 Client Table

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
AI	LocalAInp[0]	708	WORD	Y	-1	R	Analogue input AIL1	-500 ... 999	0	°C
AI	LocalAInp[1]	710	WORD	Y	-1	R	Analogue input AIL2	-500 ... 999	0	°C
AI	LocalAInp[2]	712	WORD	Y	-1	R	Analogue input AIL3	-500 ... 999	0	°C/Bar
AI	LocalAInp[3]	714	WORD	Y	-1	R	Analogue input AIL4	-500 ... 999	0	°C/Bar
AI	LocalAInp[4]	716	WORD	Y	-1	R	Analogue input AIL5	-500 ... 999	0	°C
DI	LocalDigInput DIL1	33454	1 bits			R	Digital input DIL1	0 ... 1	0	num.
DI	LocalDigInput DIL2	33454,1	1 bits			R	Digital input DIL2	0 ... 1	0	num.
DI	LocalDigInput DIL3	33454,2	1 bits			R	Digital input DIL3	0 ... 1	0	num.
DI	LocalDigInput DIL4	33454,3	1 bits			R	Digital input DIL4	0 ... 1	0	num.
DI	LocalDigInput DIL5	33454,4	1 bits			R	Digital input DIL5	0 ... 1	0	num.
DI	LocalDigInput DIL6	33454,5	1 bits			R	Digital input DIL6	0 ... 1	0	num.
DO	LocalDigOutput DOL1	33455,2	1 bits			R	Digital output DOL1	0 ... 1	0	num.
DO	LocalDigOutput DOL2	33455,3	1 bits			R	Digital output DOL2	0 ... 1	0	num.
DO	LocalDigOutput DOL3	33455,4	1 bits			R	Digital output DOL3	0 ... 1	0	num.
DO	LocalDigOutput DOL4	33455	1 bits			R	Digital output DOL4	0 ... 1	0	num.
DO	LocalDigOutput DOL5	33455,1	1 bits			R	Digital output DOL5	0 ... 1	0	num.
DO	LocalDigOutput DOL6	33455,5	1 bits			R	Digital output DOL6	0 ... 1	0	num.
AO	LocalDigOutput AOL1	33455,6	1 bits			R	Digital output AOL1	0 ... 1	0	num.
AO	LocalDigOutput AOL2	33455,7	1 bits			R	Digital output AOL2	0 ... 1	0	num.
AO	PowerTk[0]	33520	BYTE	Y		R	Analogue output TCL1	0 ... 100	0	num.
AO	PowerTk[1]	33521	BYTE	Y		R	Analogue output AOL1	0 ... 100	0	num.
AO	PowerTk[2]	33522	BYTE	Y		R	Analogue output AOL2	0 ... 100	0	num.
AO	OutPWM[0]	762	WORD	Y	-1	R	Analogue output AOL3	0 ... 999	0	num.
AO	OutPWM[1]	764	WORD	Y	-1	R	Analogue output AOL4	0 ... 999	0	num.
AO	OutPWM[2]	766	WORD	Y	-1	R	Analogue output AOL5	0 ... 999	0	num.
AI	ExtAInp[0]	1160	WORD	Y	-1	R	Analogue input AIE1	-500 ... 999	0	°C
AI	ExtAInp[1]	1162	WORD	Y	-1	R	Analogue input AIE2	-500 ... 999	0	°C

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
AI	ExtAIInput[2]	1164	WORD	Y	-1	R	Analogue input AIE3	-500 ... 999	0	°C/Bar
AI	ExtAIInput[3]	1166	WORD	Y	-1	R	Analogue input AIE4	-500 ... 999	0	°C/Bar
AI	ExtAIInput[4]	1168	WORD	Y	-1	R	Analogue input AIE5	-500 ... 999	0	°C
DI	ExtDigInput DIE1	34052	1 bits			R	Digital input DIE1	0 ... 1	0	num.
DI	ExtDigInput DIE2	34052,1	1 bits			R	Digital input DIE2	0 ... 1	0	num.
DI	ExtDigInput DIE3	34052,2	1 bits			R	Digital input DIE3	0 ... 1	0	num.
DI	ExtDigInput DIE4	34052,3	1 bits			R	Digital input DIE4	0 ... 1	0	num.
DI	ExtDigInput DIE5	34052,4	1 bits			R	Digital input DIE5	0 ... 1	0	num.
DI	ExtDigInput DIE6	34052,5	1 bits			R	Digital input DIE6	0 ... 1	0	num.
DO	ExtDigOutput DOE1	34053	1 bits			R	Digital output DOE1	0 ... 1	0	num.
DO	ExtDigOutput DOE2	34053,1	1 bits			R	Digital output DOE2	0 ... 1	0	num.
DO	ExtDigOutput DOE3	34053,2	1 bits			R	Digital output DOE3	0 ... 1	0	num.
DO	ExtDigOutput DOE4	34053,3	1 bits			R	Digital output DOE4	0 ... 1	0	num.
DO	ExtDigOutput DOE5	34053,4	1 bits			R	Digital output DOE5	0 ... 1	0	num.
DO	ExtDigOutput DOE6	34053,5	1 bits			R	Digital output DOE6	0 ... 1	0	num.
AO	ExtDigOutput AOE1	34053,6	1 bits			R	Digital output AOE1	0 ... 1	0	num.
AO	ExtDigOutput AOE2	34053,7	1 bits			R	Digital output AOE2	0 ... 1	0	num.
AO	ExtTKOut[0]	34020	BYTE	Y		R	Analogue output TCE1	0 ... 100	0	num.
AO	ExtTKOut[1]	34022	BYTE	Y		R	Analogue output AOE1	0 ... 100	0	num.
AO	ExtTKOut[2]	34024	BYTE	Y		R	Analogue output AOE2	0 ... 100	0	num.
AO	ExtPWMOut[0]	1246	WORD	Y	-1	R	Analogue output AOE3	0 ... 999	0	num.
AO	ExtPWMOut[1]	1248	WORD	Y	-1	R	Analogue output AOE4	0 ... 999	0	num.
AO	ExtPWMOut[2]	1250	WORD	Y	-1	R	Analogue output AOE5	0 ... 999	0	num.
AI	RemAIInput[0]	1156	WORD	Y	-1	R	Analogue input AIr1	-500 ... 999	0	°C
AI	RemAIInput[1]	1158	WORD	Y	-1	R	Analogue input AIr2	-500 ... 999	0	°C/Bar
AI	EEV1AIInput[0]	1170	WORD	Y	-1	R	Analogue input 1AI1	-500 ... 9999		°C/bar
AI	EEV1AIInput[1]	1172	WORD	Y	-1	R	Analogue input 1AI2	-500 ... 9999		°C
AI	EEV1AIInput[2]	1174	WORD	Y	-1	R	Analogue input 1AI3	-500 ... 9999		°C
AI	EEV1AIInput[3]	1176	WORD	Y	-1	R	Analogue input 1AI4	-500 ... 9999		°C

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
DI	EEV1DigInput[0]	34054	1 bits			R	Digital input 1AI3	0 ... 1		flag
DI	EEV1DigInput[1]	34054,1	1 bits			R	Digital input 1AI4	0 ... 1		flag
DO	EEV1DigOutput[1]	34057,1	1 bits			R	Control output 1DO	0 ... 1		flag
AI	EEV2AInput[0]	1178	WORD	Y	-1	R	Analogue input 2AI1	-500 ... 9999		°C/bar
AI	EEV2AInput[1]	1180	WORD	Y	-1	R	Analogue input 2AI2	-500 ... 9999		°C
AI	EEV2AInput[2]	1182	WORD	Y	-1	R	Analogue input 2AI3	-500 ... 9999		°C
AI	EEV2AInput[3]	1184	WORD	Y	-1	R	Analogue input 2AI4	-500 ... 9999		°C
DI	EEV2DigInput[0]	34058	1 bits			R	Digital input 2AI3	0 ... 1		flag
DI	EEV2DigInput[1]	34058,1	1 bits			R	Digital input 2AI4	0 ... 1		flag
DO	EEV2DigOutput[1]	34061,1	1 bits			R	Control output 2DO	0 ... 1		flag
SetPoint		1333	WORD	Y	-1	R	Cooling mode set point	-500 ... 999	0	°C
SetPoint		1335	WORD	Y	-1	R	Heating mode set point	-500 ... 999	0	°C
SetPoint	SBSetsACSReale	1411	WORD	Y	-1	R	ACS or anti-legionnaire's disease setpoint	-500 ... 999	0	°C
hysteresis	SBIstCoolReale	1337	WORD	Y	-1	R	Cooling mode hysteresis	-500 ... 999	0	°C
hysteresis	SBIstHeatReale	1339	WORD	Y	-1	R	Heating mode hysteresis	-500 ... 999	0	°C
AI	EEV1ResInput[0]	1186	WORD	Y	-1	R	Valve EEV1 overheating temperature	-500 ... 9999		°C
AI	EEV1ResInput[1]	1188	WORD	Y	-1	R	Valve EEV1 saturation temperature	-500 ... 9999		°C
AI	EEV1ResInput[2]	1190	WORD	Y	-1	R	Valve EEV1 overheating temperature (backup)	-500 ... 9999		°C
AI	EEV1ResInput[3]	1192	WORD	Y	-1	R	Valve EEV1 saturation temperature (backup)	-500 ... 9999		°C
AI	EEV1ResInput[4]	1194	WORD	Y	-1	R	Valve EEV1 overheating	-500 ... 9999		K/°R
AI	EEV1ResInput[5]	1196	WORD	Y	-1	R	Valve EEV1 evaporator pressure	-500 ... 9999		bar
AI	EEV1ResInput[6]	1198	WORD		-1	R	Valve EEV1 opening percentage	-500 ... 9999		%
AI	EEV1ResInput[7]	1200	WORD	Y	-1	R	Valve EEV1 overheating setpoint	-500 ... 9999		K/°R
AI	EEV2ResInput[0]	1202	WORD	Y	-1	R	Valve EEV2 overheating temperature	-500 ... 9999		°C
AI	EEV2ResInput[1]	1204	WORD	Y	-1	R	Valve EEV2 saturation temperature	-500 ... 9999		°C
AI	EEV2ResInput[2]	1206	WORD	Y	-1	R	Valve EEV2 overheating temperature (backup)	-500 ... 9999		°C
AI	EEV2ResInput[3]	1208	WORD	Y	-1	R	Valve EEV2 saturation temperature (backup)	-500 ... 9999		°C
AI	EEV2ResInput[4]	1210	WORD	Y	-1	R	Valve EEV2 overheating	-500 ... 9999		K/°R
AI	EEV2ResInput[5]	1212	WORD	Y	-1	R	Valve EEV2 evaporator pressure	-500 ... 9999		bar

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
AI	EEV2ResInput[6]	1214	WORD		-1	R	Valve EEV2 opening percentage	-500 ... 9999		%
AI	EEV2ResInput[7]	1216	WORD	Y	-1	R	Valve EEV2 overheating setpoint	-500 ... 9999		K/°R
time	_TimMinOnOnCps	838	WORD			R	Compressors minimum on/on time timer	0 ... 32768	0	s
time	_TimMinOfOfCps	840	WORD			R	Compressors minimum off/off time timer	0 ... 32768	0	s
time	_TimMinOnOnPrz	842	WORD			R	Capacity steps minimum on/on time timer	0 ... 32768	0	s
time	_TimMinOfOfPrz	844	WORD			R	Capacity steps minimum off/off time timer	0 ... 32768	0	s
time	_TimMinOfOnCp0	846	WORD			R	Compressor 1 minimum on/off timer	0 ... 32768	0	s
time	_TimMinOfOnCp1	848	WORD			R	Compressor 2 minimum on/off timer	0 ... 32768	0	s
time	_TimMinOfOnCp2	850	WORD			R	Compressor 3 minimum on/off timer	0 ... 32768	0	s
time	_TimMinOfOnCp3	852	WORD			R	Compressor 4 minimum on/off timer	0 ... 32768	0	s
time	_TimMinOnOnCp0	854	WORD			R	Compressor 1 minimum on/on timer	0 ... 32768	0	s
time	_TimMinOnOnCp1	856	WORD			R	Compressor 2 minimum on/on timer	0 ... 32768	0	s
time	_TimMinOnOnCp2	858	WORD			R	Compressor 3 minimum on/on timer	0 ... 32768	0	s
time	_TimMinOnOnCp3	860	WORD			R	Compressor 4 minimum on/on timer	0 ... 32768	0	s
time	_TimMinOnCp0	862	WORD			R	Compressor 1 minimum on time timer	0 ... 32768	0	s
time	_TimMinOnCp1	864	WORD			R	Compressor 2 minimum on time timer	0 ... 32768	0	s
time	_TimMinOnCp2	866	WORD			R	Compressor 3 minimum on time timer	0 ... 32768	0	s
time	_TimMinOnCp3	868	WORD			R	Compressor 4 minimum on time timer	0 ... 32768	0	s
time	_TimEntraSbriC1	878	WORD			R	Circuit 1 defrost interval/duration time timer	0 ... 32768	0	s
time	_TimEntraSbriC2	880	WORD			R	Circuit 2 defrost interval/duration time timer	0 ... 32768	0	s
time	_TimSgoccioC1	882	WORD			R	Circuit 1 dripping time timer	0 ... 32768	0	s
time	_TimSgoccioC2	884	WORD			R	Circuit 2 dripping time timer	0 ... 32768	0	s
time	_TimRitOnCpPomPri	888	WORD			R	Switch-on delay timer for compressors after primary pump	0 ... 32768	0	s
time	_TimRitOfPomPriCp	890	WORD			R	Switch-off delay timer for primary pump after compressors	0 ... 32768	0	s
time	_TimEnvelopeTimTS	1014	WORD			R	Discharge temperature correction timer	0 ... 32768	0	s
time	_TimEnvelopeTimTST	1016	WORD			R	Scan time/overheating setpoint correction timer	0 ... 32768	0	min
time	_TimEnvelopeTimTtransient	1018	WORD			R	Initial transient timer for compression ratio control	0 ... 32768	0	min
time	_TimEnvelopeTimSafety	1020	WORD			R	Compressor running time in safety and for oil recovery	0 ... 32768	0	min
time	_TimInverterOff	1022	WORD			R	Inverter shutdown timer	0 ... 32768	0	s

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
state	_SbrinOnC1	34191,2	1 bits			R	Defrost 1	0 ... 1	0	num.
state	_SbrinOnC2	34191,3	1 bits			R	Defrost 2	0 ... 1	0	num.
state	_ASPCal	34194,6	1 bits			R	Status of sanitary water in heat pump mode	0 ... 1	0	num.
state	_ALPCal	34194,7	1 bits			R	Status of anti-legionnaire function in heat pump mode	0 ... 1	0	num.
mode	_MemoOff	33296	1 bits			R	Device in OFF	0 ... 1	0	num.
mode	_MemoRemotOff	33296,1	1 bits			R	Device in OFF	0 ... 1	0	num.
mode	_MemoLocalStBy	33296,2	1 bits			R	Device in STAND BY	0 ... 1	0	num.
mode	_MemoRemotStBy	33296,3	1 bits			R	Device in STAND BY	0 ... 1	0	num.
mode	_MemoLocalCool	33296,4	1 bits			R	Device in COOL	0 ... 1	0	num.
mode	_MemoRemotCool	33296,5	1 bits			R	Device in COOL	0 ... 1	0	num.
mode	_MemoLocalHeat	33296,6	1 bits			R	Device in HEAT	0 ... 1	0	num.
mode	_MemoRemotHeat	33296,7	1 bits			R	Device in HEAT	0 ... 1	0	num.
mode	_MemoLocalAS	33298	1 bits			R	Device in sanitary water	0 ... 1	0	num.
mode	_MemoRemotAS	33298,1	1 bits			R	Device in sanitary water	0 ... 1	0	num.
counter	STCPOreFunz[0]	1297	WORD			R	Operation hours compressor 1	0 ... 65535	0	hours
counter	STCPOreFunz[1]	1299	WORD			R	Operation hours compressor 2	0 ... 65535	0	hours
counter	STCPOreFunz[2]	1301	WORD			R	Operation hours compressor 3	0 ... 65535	0	hours
counter	STCPOreFunz[3]	1303	WORD			R	Operation hours compressor 4	0 ... 65535	0	hours
counter	STPMOreFunz[0]	1305	WORD			R	Operation hours pump 1	0 ... 65535	0	hours
counter	STPMOreFunz[1]	1307	WORD			R	Operation hours pump 2	0 ... 65535	0	hours
counter	STPMOreFunz[2]	1309	WORD			R	Operation hours pump 3	0 ... 65535	0	hours
differential	SBDiffSetPoint	1353	WORD	Y	-1	R	Temperature control set point dynamic differential	-500 ... 999	0	°C
offset	SBDiffAdaptive	1355	WORD	Y	-1	R	Adaptive function offset	-500 ... 999	0	°C
differential	STDiffResPri	1357	WORD	Y	-1	R	Integrated electric heater set point dynamic differential	-500 ... 999	0	°C
differential	STDiffBoiler	1359	WORD	Y	-1	R	Boiler set point dynamic differential	-500 ... 999	0	°C
setpoint	SBSetStartSbri	1367	WORD	Y	-1	R	Defrost start set point	-500 ... 999	0	°C
state	SBCircuiti[0].OutActive	34157	BYTE			R	Temperature control steps supplied circuit 1	0 ... 4	0	num.
state	SBCircuiti[0].OutActive	34163	BYTE			R	Temperature control steps supplied circuit 2	0 ... 4	0	num.
state	EEV1Status	34055	BYTE			R	Regulation status EEV1	0 ... 255	0	num.

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
state	EEV2Status	34059	BYTE			R	Regulation status EEV2	0 ... 255	0	num.
alarm	E000	33372	1 bits			R	General alarm	0 ... 1	0	flag
alarm	E001	33372,1	1 bits			R	Circuit 1 digital high pressure alarm	0 ... 1	0	flag
alarm	E002	33372,2	1 bits			R	Circuit 2 digital high pressure alarm	0 ... 1	0	flag
alarm	E003	33372,3	1 bits			R	Circuit 1 analogue high pressure alarm	0 ... 1	0	flag
alarm	E004	33372,4	1 bits			R	Circuit 2 analogue high pressure alarm	0 ... 1	0	flag
alarm	E005	33372,5	1 bits			R	Circuit 1 digital low pressure alarm	0 ... 1	0	flag
alarm	E006	33372,6	1 bits			R	Circuit 2 digital low pressure alarm	0 ... 1	0	flag
alarm	E007	33372,7	1 bits			R	Circuit 1 analogue low pressure alarm	0 ... 1	0	flag
alarm	E008	33373	1 bits			R	Circuit 2 analogue low pressure alarm	0 ... 1	0	flag
alarm	E009	33373,1	1 bits			R	Machine low charge alarm	0 ... 1	0	flag
alarm	E010	33373,2	1 bits			R	Compressor 1 thermal switch alarm	0 ... 1	0	flag
alarm	E011	33373,3	1 bits			R	Compressor 2 thermal switch alarm	0 ... 1	0	flag
alarm	E012	33373,4	1 bits			R	Compressor 3 thermal switch alarm	0 ... 1	0	flag
alarm	E013	33373,5	1 bits			R	Compressor 4 thermal switch alarm	0 ... 1	0	flag
alarm	E015	33373,7	1 bits			R	Compressor 1 oil pressure switch alarm	0 ... 1	0	flag
alarm	E016	33374	1 bits			R	Compressor 2 oil pressure switch alarm	0 ... 1	0	flag
alarm	E017	33374,1	1 bits			R	Compressor 3 oil pressure switch alarm	0 ... 1	0	flag
alarm	E018	33374,2	1 bits			R	Compressor 4 oil pressure switch alarm	0 ... 1	0	flag
alarm	E020	33374,4	1 bits			R	Primary circuit flow switch alarm	0 ... 1	0	flag
alarm	E021	33374,5	1 bits			R	Primary circuit pump 1 thermal switch alarm	0 ... 1	0	flag
alarm	E022	33374,6	1 bits			R	Primary circuit pump 2 thermal switch alarm	0 ... 1	0	flag
alarm	E025	33375,1	1 bits			R	Primary circuit pump thermal switch alarm	0 ... 1	0	flag
alarm	E026	33375,2	1 bits			R	Disposable circuit pump thermal switch alarm	0 ... 1	0	flag
alarm	E030	33375,6	1 bits			R	Primary circuit antifreeze alarm	0 ... 1	0	flag
alarm	E031	33375,7	1 bits			R	Disposable circuit antifreeze alarm	0 ... 1	0	flag
alarm	E032	33376	1 bits			R	Vacuum circuit 1 alarm	0 ... 1	0	flag
alarm	E033	33376,1	1 bits			R	Vacuum circuit 2 alarm	0 ... 1	0	flag
alarm	E035	33376,3	1 bits			R	High temperature alarm	0 ... 1	0	flag

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
alarm	E040	33377	1 bits			R	Primary exchanger fan thermal switch alarm	0 ... 1	0	flag
alarm	E041	33377,1	1 bits			R	Circuit 1 external heat exchanger fan thermal switch alarm	0 ... 1	0	flag
alarm	E042	33377,2	1 bits			R	Circuit 2 external heat exchanger fan thermal switch alarm	0 ... 1	0	flag
alarm	E045	33377,5	1 bits			R	Faulty clock alarm	0 ... 1	0	flag
alarm	E046	33377,6	1 bits			R	Time lost alarm	0 ... 1	0	flag
alarm	E047	33377,7	1 bits			R	LAN communication absent alarm	0 ... 1	0	flag
alarm	E048	33378	1 bits			R	Anti-Legionnaire's Alarm	0 ... 1	0	flag
alarm	E050	33378,2	1 bits			R	Primary exchanger electric heater 1 thermal switch alarm	0 ... 1	0	flag
alarm	E051	33378,3	1 bits			R	Primary exchanger electric heater 2 thermal switch alarm	0 ... 1	0	flag
alarm	E056	33379	1 bits			R	Auxiliary output alarm	0 ... 1	0	flag
alarm	E060	33379,4	1 bits			R	Primary exchanger water or air input temperature probe faulty alarm	0 ... 1	0	flag
alarm	E061	33379,5	1 bits			R	Primary exchanger water or air output temperature probe faulty alarm	0 ... 1	0	flag
alarm	E062	33379,6	1 bits			R	Faulty disposable exchanger temperature probe alarm	0 ... 1	0	flag
alarm	E063	33379,7	1 bits			R	Faulty disposable exchanger water or air input temperature probe alarm	0 ... 1	0	flag
alarm	E064	33380	1 bits			R	Faulty disposable exchanger water or air output temperature probe alarm	0 ... 1	0	flag
alarm	E066	33380,2	1 bits			R	Sanitary water temperature probe faulty	0 ... 1	0	flag
alarm	E067	33380,3	1 bits			R	Faulty display probe alarm	0 ... 1	0	flag
alarm	E068	33380,4	1 bits			R	Faulty external temperature probe alarm	0 ... 1	0	flag
alarm	E069	33380,5	1 bits			R	Faulty circuit 1 or 2 high pressure transducer alarm	0 ... 1	0	flag
alarm	E070	33380,6	1 bits			R	Faulty circuit 1 or 2 low pressure transducer alarm	0 ... 1	0	flag
alarm	E073	33381,1	1 bits			R	Faulty dynamic set point input alarm	0 ... 1	0	flag
alarm	E074	33381,2	1 bits			R	Faulty primary heat exchanger transducer alarm	0 ... 1	0	flag
alarm	E075	33381,3	1 bits			R	Faulty disposable exchanger transducer 1 o 2 alarm	0 ... 1	0	flag
alarm	E080	33382	1 bits			R	Configuration error alarm	0 ... 1	0	flag
alarm	E081	33382,1	1 bits			R	Compressor operating hours exceeded warning	0 ... 1	0	flag
alarm	E085	33382,5	1 bits			R	Primary circuit pump operating hours exceeded signal	0 ... 1	0	flag
alarm	E086	33382,6	1 bits			R	External circuit pump operating hours	0 ... 1	0	flag

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
							exceeded signal			
alarm	E090	33383,2	1 bits			R	Alarm log full warning	0 ... 1	0	flag
alarm	E101	33384,5	1 bits			R	Input error dAi1 EEV1	0 ... 1		flag
alarm	E102	33384,6	1 bits			R	Input error dAi2 EEV1	0 ... 1		flag
alarm	E103	33384,7	1 bits			R	Input error dAi3 EEV1	0 ... 1		flag
alarm	E104	33385	1 bits			R	Input error dAi4 EEV1	0 ... 1		flag
alarm	E105	33385,1	1 bits			R	Valve EEV1 overheating probe alarm	0 ... 1		flag
alarm	E106	33385,2	1 bits			R	Valve EEV1 saturation probe alarm	0 ... 1		flag
alarm	E107	33385,3	1 bits			R	Valve EEV1 MOP alarm	0 ... 1		flag
alarm	E108	33385,4	1 bits			R	Valve EEV1 output max alarm	0 ... 1		flag
alarm	E109	33385,5	1 bits			R	Valve EEV1 external alarm	0 ... 1		flag
alarm	E110	33385,6	1 bits			R	Valve EEV1 no-link alarm	0 ... 1		flag
alarm	E111	33385,7	1 bits			R	Valve motor alarm EEV1: current consumption too high	0 ... 1		flag
alarm	E112	33386	1 bits			R	Valve motor alarm EEV1: winding 1 not connected	0 ... 1		flag
alarm	E113	33386,1	1 bits			R	Valve motor alarm EEV1: winding 1 short-circuited	0 ... 1		flag
alarm	E114	33386,2	1 bits			R	Valve motor alarm EEV1: winding 2 not connected	0 ... 1		flag
alarm	E115	33386,3	1 bits			R	Valve motor alarm EEV1: winding 2 short-circuited	0 ... 1		flag
alarm	E201	33387,1	1 bits			R	Input error dAi1 EEV2	0 ... 1		flag
alarm	E202	33387,2	1 bits			R	Input error dAi2 EEV2	0 ... 1		flag
alarm	E203	33387,3	1 bits			R	Input error dAi3 EEV2	0 ... 1		flag
alarm	E204	33387,4	1 bits			R	Input error dAi4 EEV2	0 ... 1		flag
alarm	E205	33387,5	1 bits			R	Valve EEV2 overheating probe alarm	0 ... 1		flag
alarm	E206	33387,6	1 bits			R	Valve EEV2 saturation probe alarm	0 ... 1		flag
alarm	E207	33397,7	1 bits			R	Valve EEV2 MOP alarm	0 ... 1		flag
alarm	E208	33398	1 bits			R	Valve EEV2 output max alarm	0 ... 1		flag
alarm	E209	33398,1	1 bits			R	Valve EEV2 external alarm	0 ... 1		flag
alarm	E210	33398,2	1 bits			R	Valve EEV2 no-link alarm	0 ... 1		flag
alarm	E211	33398,3	1 bits			R	Valve motor alarm EEV2: current consumption too high	0 ... 1		flag
alarm	E212	33398,4	1 bits			R	Valve motor alarm EEV2: winding 1 not connected	0 ... 1		flag

RESOURCE	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEF	U.M.
alarm	E213	33398,5	1 bits			R	Valve motor alarm EEV2: winding 1 short-circuited	0 ... 1		flag
alarm	E214	33398,6	1 bits			R	Valve motor alarm EEV2: winding 2 not connected	0 ... 1		flag
alarm	E215	33398,7	1 bits			R	Valve motor alarm EEV2: winding 2 short-circuited	0 ... 1		flag
net command	Remote_Tacita	33834,2	1 bits			W	Alarm manual reset	0 ... 1	0	num.
net command	Remote_Cool	33834,3	1 bits			W	Select mode COOL	0 ... 1	0	num.
net command	Remote_Heat	33834,4	1 bits			W	Select mode HEAT	0 ... 1	0	num.
net command	Remote_StBy	33834,5	1 bits			W	Select mode STAND BY	0 ... 1	0	num.
net command	Remote_Sbri	33834,6	1 bits			W	Manual defrost activation	0 ... 1	0	num.
net command	Remote_OnOff	33834,7	1 bits			W	Select mode ON/OFF	0 ... 1	0	num.
net command	RemoteFormatStorAll	33835	1 bits			W	Reset alarm history	0 ... 1	0	num.
net command	Remote_AS	33835,1	1 bits			W	Select mode AS	0 ... 1	0	num.
net command	Remote_TogFascieOra	33835,2	1 bits			W	Enable/Disable band operation	0 ... 1	0	num.
net command	CMD_LOCK_DISP_ON	33282,2	1 bits			W	Keyboard Locked	0 ... 1	0	num.
net command	CMD_LOCK_DISP_OFF	33282,2	1 bits			W	Keyboard Unlocked	0 ... 1	0	num.
net command	CMD_RESET	33280	1 bits			W	Device reset	0% 1	0	num.

28 FUNCTIONS (FOLDER Fnc)

The Functions menu is used to perform a number of manual functions such as switching the device on/off, acknowledging alarms, deleting the alarm history, running a manual defrost and using the Multi Function key (MFK). Several of these operations can be performed from the keyboard and main display using the keys - see User Interface chapter.

Functions associated to keys can be disabled and password-only access allowed to these functions at a "Service" level only via parameters - see the parameters section

For more details, see the table below:

	Label	Operation	Function activated by [key] if configured
FnC	dEF	Manual defrost	YES [UP]
	tA	Reset alarms	YES [UP+DOWN]
	St	Switch terminal on/off	YES [DOWN]
	CC	Using the Multi Function Key	NO
	Eur	Reset alarm log	NO

To open the Functions menu (folder Fnc) execute steps 1-4 as indicated below:

1

2

3

4

Pressing both keys will open the Programming menu:

The first folder displayed is PAR.

To view folder FnC from the main display, press the Esc and Set keys at the same time. [esc+set]

Scroll with the "Up" and "Down" keys until you find the FnC folder.

Press the set key to open the Functions menu.

The first label displayed is dEF.

Use the "up" and "down" keys to scroll the list until you find the other labels/folders.

28.1 Manual defrost activation (folder dEF)

See 1-4

Press the 'set' key to activate defrost manually from the keyboard

From the main screen press [esc + set]. The label 'PAR' will appear. Scroll with 'UP' and 'DOWN' to display the 'FnC' label. Press 'set'. The label 'dEF' will appear. Scroll with 'UP' and 'DOWN' to display the 'dEF' label.

The DEFROST LED will start to blink.

28.2 Manual Reset (tA folder)

See 1-4



Press the “set” key to activate defrost manually from the keyboard

From the main screen press [esc + set].
The label 'PAr' will appear. Scroll with 'UP' and 'DOWN' to display the 'FnC' label.
Press 'set'. The label 'dEF' will appear. Scroll with 'UP' and 'DOWN' to display the 'tA' label

Press the 'set' key for manual reset

N.B.: resetting an active alarm will save the alarm in the alarm log.

The DEFROST LED will start to blink.

28.3 Change On/OFF state (folder St)

See 1-4



From the main screen press [esc + set].
The label 'PAr' will appear. Scroll with 'UP' and 'DOWN' to display the 'FnC' label.
Press 'set'. The label 'dEF' will appear. Scroll with 'UP' and 'DOWN' to display the 'St' label

The label “On” will appear in the “St” folder if the device is ON, or “OFF”, if the device is switched OFF locally or by remote




Press the set key to change state from OFF to On

or from On to OFF

28.4 Multi Function key

When connected to the TTL serial port, the Multi Function Key (MFK) allows you to rapidly program device parameters (up/download parameter map to or from one or more devices of the same type) and also program the device's firmware.

Connecting the
Multi Function Key

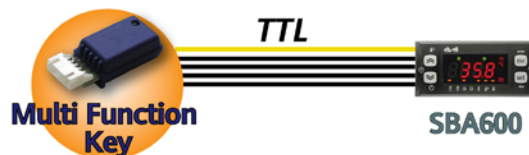

N.B.: Use the **YELLOW** Cable to make the connection between MFK and SBA600.

For rapid programming of the parameters, the upload (label UL), download (label dL) and multi function key formatting (label Fr) operations are performed as explained below:



UPLOAD (copy from CONTROLLER to MULTI FUNCTION KEY)

By doing this, the programming parameters and alarms log will be downloaded from Energy SBA600 to the Multi Function Key.

DOWNLOAD (copy from MULTI FUNCTION KEY to CONTROLLER)

By doing this, the programming parameters will be uploaded from the Multi Function Key to the device.

FORMAT*

Formatting the Multi Function Key consists of deleting the contents of the Multi Function Key.

*This should be done prior to Uploading when used for the first time.

Upload / Download / Formatting

The download procedure is illustrated in the figure.

From the main screen press [esc + set].

The label 'PAr' will appear. Scroll with 'UP' and 'DOWN' to display the 'FnC' label.

Press 'set'. The label 'dEF' will appear. Scroll with 'UP' and 'DOWN' to display the 'CC' label.

See 1-4



The commands you need to use the Multi Function Key are in the CC folder. Press "set" to access the functions.

Use the 'UP' and 'DOWN' keys to display the desired function:

UL for upload / dL for download /Fr for format

Press the "set" key and the upload (or download) will be performed (in this example, dL- download)

Wait for a few seconds



Wait for a few seconds

If this operation is completed successfully, 'yes' is displayed; otherwise 'Err' is displayed ("). On completion, remove the MFK

28.4.1 Download from reset

Connect the Copy Card with the device switched off.

Firmware download

At start up, if a compatible firmware is loaded into the MFK (the MFK can be prepared using the Device Manager software), the new firmware is downloaded into the device.

This happens as follows:

- firmware verification/update (MFK LED flashes)
- termination with successful programming (MFK LED on fixed)
- switch off the device

If a compatible firmware is not loaded into the MFK, no download takes place.

If, on termination, the MFK LED does not stay on fixed, the operation must be repeated as this means it failed.

Download parameters

On start up, if there is a compatible parameter map in the MFK, the programming parameters are loaded into the device.



lamp test completed...



Case B

...dLn appears on the display....
If the procedure was not completed successfully (°).

Case A

...the display shows dLY...
If the procedure was completed successfully.



In both cases, the instrument will be switched OFF locally (OFF appears on the display).
When you press "DOWN" (°), the controller will operate:

- With the new map **Case A**
- With the previous map **Case B**

Remove the Multi Function Key when the operation is completed

(°) see user interface chapter, (folder Par/UI) local ON/OFF section
Change On/OFF state (folder St) section

NOTES:

- If the MFK is loaded with both a compatible firmware and a compatible parameter map, the firmware is downloaded first and then (after the device has been switched off and back on again manually) the parameter map
- The formatting function is **ONLY REQUIRED FOR UPLOADING ****:
 - o to use the Multi Function Key the first time (Multi Function Key that has never been used);
 - o to use the Multi Function Key with models that are not compatible.
 - o (**) a pre-programmed card supplied by Eliwell to DOWNLOAD parameters does not need to be formatted. **N.B.: Formatting CANNOT be undone.**
- After the download operation, the instrument will work with the newly loaded parameters map/firmware.
- Remove the key on completion of the operation.

(°) If the string Err / dLn (download from reset) appears:

- Check that the key is connected to the device;
- Check the Multi Function Key – Energy SBA600 connection (check the TTL cable)
- Check that the key is compatible with the device
- Contact Eliwell Technical Support

28.5 Reset alarm log (folder EUR)

See 1-4



Press the "set" key for 3 seconds [set]

From the main screen press [esc + set].
The label 'PAR' will appear. Scroll with 'UP' and 'DOWN' to display the 'FnC' label.
Press 'set'. The label 'dEF' will appear. Scroll with 'UP' and 'DOWN' to display the 'EUR' label.



The 'YES' label is displayed to indicate that the alarm log has been deleted

29 DEVICEMANAGER

The Device Manager software uses the TTL serial connection of the SB600 to simplify and aid in installing and managing the SB600.

Main features

- Device parameters management.
- Real-time monitoring and recording of system variables.
- Device alarms records management.
- Firmware updating.

All basic components required for the use of DeviceManager are described below

29.1.1 Device Manager software component

The software has a graphic user interface, which is described in the DeviceManager manual.

The Device Manager software supports both Eliwell/Modbus protocols.

The functionalities available to the customer depend on which Device Manager hardware interface he/she has purchased.

29.1.2 Device Manager interface component

The USB/TTL hardware interface, used in association with the software package, enables:

- the use of the software itself
- connection to device/s for controlling it/them
- connection to Multi Function Key component.

There can be three different types of interface, corresponding to three user levels

- DMI 100-1 END USER.
- DMI 100-2 SERVICE.
- DMI 100-3 MANUFACTURER.

Depending on the type purchased, the client has access to the functions described above

29.1.3 Multi Function Key Component.

This is a memory support, which allows:

- the updating of the device's parameter values
- the updating of the device's firmware
- the downloading of the parameter values from the device
- the downloading of the alarms records from the device

For more details

--> See manual 8MAx0219 Device Manager

X = 0 IT; 1 EN; 2 FR; 3 ES; 5 DE; A RU

30 MONITORING

The serial TTL - which we will call COM1 – can be used to configure the device, parameters, states, and variables with Modbus via the Modbus protocol.

30.1 Configuration with Modbus RTU

Modbus is a client/server protocol for communication between devices connected in a network.

Modbus devices communicate using a master-slave technique in which only one device (master) can send messages.

The other devices in the network (slave) respond, returning the data requested by the master or executing the action contained in the message sent. A slave is a device connected to a network that processes information and sends the results to the master using the Modbus protocol.

The master device can send messages to individual slaves or to the entire network (broadcast) whilst slaves can only respond individually to the master.

The Modbus standard used by Eliwell employs the RTU code for data transmission.

30.1.1 Data format (RTU)

The coding model used defines the structure of messages transmitted on the network and the way in which this information is deciphered. The type of coding is usually selected on the basis of specific parameters (baud rate, parity, etc.)***; furthermore, some devices support only specific coding models, although it must be the same one for all devices connected in a Modbus network.

The protocol uses the RTU binary method with bytes configured as follows:

8 bits for data, even parity bit, 1 stop bit (non-configurable).

***can be set via parameters

CF30- Modbus protocol controller address

CF31- Modbus protocol Baudrate

N.B.: the transmission speed must be set at 9600 baud.


Parameter setting allows full configuration of the device

They can be modified through:


- Device keypad
- Multi Function Key
- sending data via Modbus protocol directly to an individual controller or broadcasting it using the address 0.

The connection diagram when using Modbus is shown below

ModBus - Connection diagram of single controller via TTL

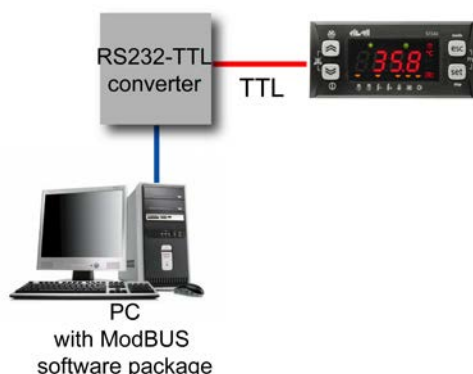

ModBus connection to multiple devices Via RS485

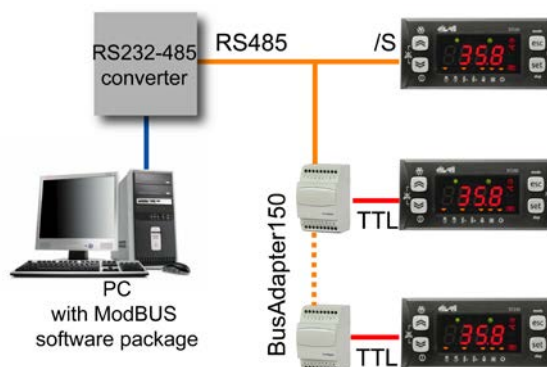

PC connection / Interface	RS232 cable
Device / Bus Adapter connection	5-wire TTL cable (30cm) (other measurements/lengths available)
Bus Adapter	BA150
Bus Adapter / Interface connection	RS485 cable screened and twisted (e.g.: Belden cable model 8762)

30.1.2 Modbus commands available and data areas

The following commands are implemented:

Modbus command	Description of command
3	Read multiple registers on Client side
16	Write multiple registers on Client side
43	Read device ID DESCRIPTION Manufacturer ID Model ID Version ID

Length restrictions

Maximum length in bytes of messages sent to device	30 BYTES
Maximum length in bytes of messages received by the device	30 BYTES

Multiple reading of the 2 real setpoints

Measurement	Decimal	Hex	Size
Device address (slave):	1	0x01	bytes
Read command code:	3	0x03	bytes
Start address:	975	0x03CF	Word
Number of words to read:	3	0x0003	Word

Configuration of COOL operating mode

Value 8 written in the word for remote commands at address h2FC.

Measurement	Decimal	Hex	Size
Device address (slave):	1	0x01	byte
Write command code:	10	0x0A	bytes
Write address:	764	0x02FC	Word
Number of words to write:	1	0x0001	Word
Number of byte (No. word x 2):	2	0x02	Word
Value (word) to write:	8	0x0008	Word

On completion of the operation, the device will switch to COOL mode (if enabled).

Configuration of ON/OFF operating mode

Value 128 written in the word for remote commands at address h2FC.

On completion of the operation, the device will toggle the On/Off state (if enabled).

The RAM variables can be monitored and the possible commands are listed below.

List of possible commands:

- Manual alarm reset
- Change operating mode (Heat, Cool and St-By)
- Switch device on/off
- Enable defrost

Following this procedure, additional operations are also possible, including:

- Read alarm log
- Change/set time
- Reset operating time of compressor and pump outputs

Reading the alarm log

The alarm log is saved in EEPROM in a circular buffer composed of logical 7-byte records in the following formats:

Byte	Bits	Index	Data	Values
0	0	Bit 0	Free alarm record flag	Must always be 0
	1	Bit 1	Alarm state	0 = alarm reset; 1 = alarm in progress
	2	Bit 2	Automatic reset alarm	0 = automatic reset; 1 = manual reset
	3	-	Not used	
	4	-		
	5	-		
	6	-		
	7	-		
1	0	Bit 0	Alarm start minutes	0-59 = minutes >59 = indeterminate value
	1	Bit 1		
	2	Bit 2		
	3	Bit 3		
	4	Bit 4		
2	5	Bit 5	Alarm end minutes	0-59 = minutes >59 = indeterminate value
	6	Bit 0		
	7	Bit 1		
	0	Bit 2		
	1	Bit 3		
3	2	Bit 4	Alarm start hours	0-23 = hours >23 = indeterminate value
	3	Bit 5		
	4	Bit 0		
	5	Bit 1		
	6	Bit 2		
4	7	Bit 3	Alarm end hours	0-23 = hours >23 = indeterminate value
	0	Bit 4		
	1	Bit 0		
	2	Bit 1		
	3	Bit 2		
5	4	Bit 3	Alarm start date	1-31 = day 0 >31 = indeterminate value
	5	Bit 4		
	6	Bit 0		
	7	Bit 1		
	0	Bit 2		
6	1	Bit 3	Alarm end date	1-31 = day 0 >31 = indeterminate value
	2	Bit 4		
	3	Bit 0		
	4	Bit 1		
	5	Bit 2		
7	6	Bit 3	Alarm start month	0-23 = hours >23 = indeterminate value
	7	Bit 4		
	0	Bit 0		
	1	Bit 1		
	2	Bit 2		
8	3	Bit 3	Alarm end month	0-23 = hours >23 = indeterminate value
	4	Bit 0		
	5	Bit 1		
	6	Bit 2		
	7	Bit 3		
9	0	Bit 0	Alarm Code	0-99 = alarm code >99 Not permitted
	1	Bit 1		
	2	Bit 2		
	3	Bit 3		
	4	Bit 4		
	5	Bit 5		
	6	Bit 6		
	7	Bit 7		

To find the index of the first record present, read variable **PntStorAll** at the address h83A8.

To find the number of records present, read variable **NumStorAll** at the address h83A9.

Address 0x83A8 => data: 0x0027 = Index of first record (the most recent);
 Address 0x83A9 => data: 0x0027 = number of records present (39);

Calculation of the address of the most recent record:
 Address EU00 = 51712 + (N-1)x7 = 51712 + 17x7 = 51832 (0xCA77)

Read EU00

TX: 01, 03, CA, 77, 00, 07, 8B, CA.

RX: 01, 03, 0E, 00, 82, 00, DD, 00, CF, 00, FE, 00, 04, 00, 06, 00, 3C, 9B, 13.

Address 0xCA77 =>	data: 0x0082	= Byte 0 of the alarm log record
Address 0xCA78 =>	data: 0x00DD	= Byte 1 of the alarm log record
Address 0xCA79 =>	data: 0x00CF	= Byte 2 of the alarm log record
Address 0xCA7A =>	data: 0x00FE	= Byte 3 of the alarm log record
Address 0xCA7B =>	data: 0x0004	= Byte 4 of the alarm log record
Address 0xCA7C =>	data: 0x0006	= Byte 5 of the alarm log record
Address 0xCA7D =>	data: 0x003C	= Byte 6 of the alarm log record

Free alarm record flag	= b 0	= 0
Free alarm record flag	= b 1	= 1
Automatic reset alarm	= b 0	= 0
Not Used	= b 10000	= free
Alarm start minutes	= b 011101	= 29
Alarm end minutes	= b 111111	= 63 (indeterminate)
Alarm start time	= b 01100	= 12
Alarm end time	= b 11111	= 31 (indeterminate)
Alarm start day	= b 10011	= 19
Alarm end day	= b 00000	= 0 (indeterminate)
Alarm start month	= b 0110	= 6
Alarm end month	= b 0000	= 0 (indeterminate)
Alarm code	= b 00111100	= 60

The result shows that on EU00 there is an **Er60** started on **19/06** at **12.19** still active.

To read EU01, the address is determined as follows:

Address EU01 = Address EU00 - 7 = 51832 - 7 = 51825

To read EU02 continue subtracting 7 from the address EU01 and so on...

N.B.: The minimum limit is the address 51712 (hCA00) after which, if there are still alarms to be read, it starts again from address 52404 (hCCB5) (the buffer is circular and after the 99th record, the older ones are overwritten).

Reading time changes/settings

To write the time, address the structure **DataVisu** to address h82F4.

Measurement	Address	Size
0: seconds	H8408	bytes
1: minutes	H8409	bytes
2: hours	H840A	bytes
3: day of week	H840B	bytes
4: day of month	H840C	bytes
5: month	H840D	bytes
6: year	H840E	bytes

Reading time changes/settings

To write the time, address the structure **DataWrite** to address h82F4.

The seconds bytes must be written last!

Example: time setting **h11:33** on **28/03/2007**

Measurement	Address	Decimal	Hex	Size
0: seconds	H8416	0	0x0000	bytes
1: minutes	H8417	33	0x0021	bytes
2: hours	H8418	11	0x000B	bytes
3: day of week	H8419	-	-	bytes
4: day of month	H841A	28	0x001C	bytes
5: month	H841B	3	0x0003	bytes
6: year	H841C	7	0x0007	bytes

N.B.: The seconds bytes must be written last!

Write sequence:

The following 6-word sequence is written at address H82F5: 46, 12, 0, 19, 6, 8.

A word equal to 00 is written at address H82F4.

Resetting running hours

To read and/or clear operating time, address the counters in the device's EEPROM and RAM.

<i>STCPOreFunz[0]</i>	at address h3AB Running hours CP1 (in Ram)
<i>STCPOreFunz[1]</i>	at address h3AD Running hours CP2 (in Ram)
<i>STPMOreFunz[0]</i>	at address h3B3 Running hours P1 (in Ram)
<i>STPMOreFunz[1]</i>	at address h3B5 Running hours P2 (in Ram)
<i>EE_OreFunzCP0</i>	at address h4F20 Running hours CP1 (in EEPROM)
<i>EE_OreFunzCP1</i>	at address h4F22 Running hours CP2 (in EEPROM)
<i>EE_OreFunzP0</i>	at address h4F38 Running hours P1 (in EEPROM)
<i>EE_OreFunzP1</i>	at address h4F38 Running hours P2 (in EEPROM)

Multiple reading of running hours CP at address h3AB in RAM.
The full command to be sent to the device will be:

Address 0x03AB =>	date: 0x0065 = 101 running hours CP1;
Address 0x03AC =>	date: 0x0000 = not used
Address 0x03AD =>	date: 0x0001 = 1 operating hour CP2;

Clear time CP1 (in RAM and EEPROM)
Write 0 running hours CP at address h3AB in RAM.

Write 0 running hours CP at address h4F20 in EEPROM.

Variable list:

See Parameters (PAr) Chapter, Client Table

30.2 Configuration of device address

The address of a device (Device Number) in a ModBus message is defined by parameter
CF30 - Modbus protocol controller address

The address 0 is used for broadcast messages that all slaves recognize. Slaves don't respond to broadcast messages.

30.2.1 Configuration of parameter addresses

The list of addresses is given in the Parameters chapter under the section headed "Parameters Table / ADDRESS column visibility" (parameters addresses) and VIS PAR ADDRESS (addresses visibility parameters).

30.2.2 Configuration of variable addresses / states

The address list is provided in the Parameters chapter, Client Table section, ADDRESS column

31 APPENDIX- XVD DRIVER


31.1 General Description XVD

XVD is the solution with

XVD Open: open board

XVD 4DIn: DIN rail mounting solution

of the Eliwell platform of drivers managing unipolar step-by-step electronic expansion motor valves suited for a range of needs in the HVAC/R market and beyond.

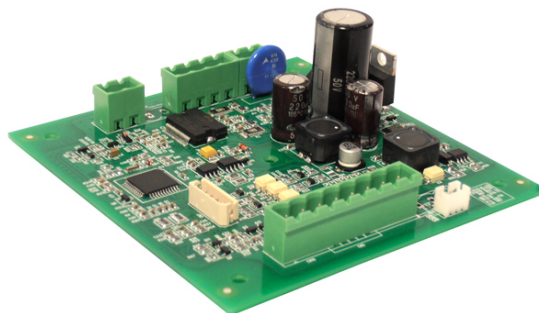

The possibility to select refrigerant types and compatibility with most commercially available valves make the XVD particularly versatile.

XVD also makes it possible to configure a refrigerant that is not included in the preset factory list.

The valve controlled by piloted motor under current and the independent operation for hot and cold by means of double regulator mapping improves performance.

XVD in fact ensures a very precise, stable and reliable control of the refrigerant flow, consequently increasing efficiency and energy savings by adjusting the overheating and valve opening according to the performance demanded by the system and in different working conditions.

Reliability is guaranteed by the isolated serial connections and backup sensors.

XVD is used in association with the Energy Flex SBA series of compact controllers for management of chillers and heat pumps with up to 2 circuits and 4 compressors per circuit.

XVD also has the same Modbus RTU serial communication standard interface and the option of downloading parameter maps and applications via the Multi Function Key.

Ratiometric pressure sensors can also be connected with no need for any further serial interfaces.

All digital inputs and digital outputs are independent and configurable, meaning they can be adapted to fit any system. Power supply 24V~/24V=.

31.1.1 Main functions:

- Refrigerant selection
- Backup probes control saturation and evaporator output (overheating)
- Parameter settings from SBA or PC
- Multi Function Key (MFK) to download or upload parameter maps and applications
- DeviceManager software for rapid parametric programming
- Configurable inputs NTC, Pt1000, 4...20mA, 0...10V, 0...5V ratiometric

31.2 Models and Features

-->See Models chapter

31.3 XVD Open Assembly


The boards are set up for installation on the rear of the panel.

To install, use plastic spacers to be inserted in the 4 holes in the board.

Fit the board in environments in which the temperature does not exceed 55°C and where there is sufficient air circulation.

The device has an open board, and must be adequately protected from dust and water.

The admissible ambient temperature range for correct operation is between –5 and 55°C, 90% R.H. (non condensing).

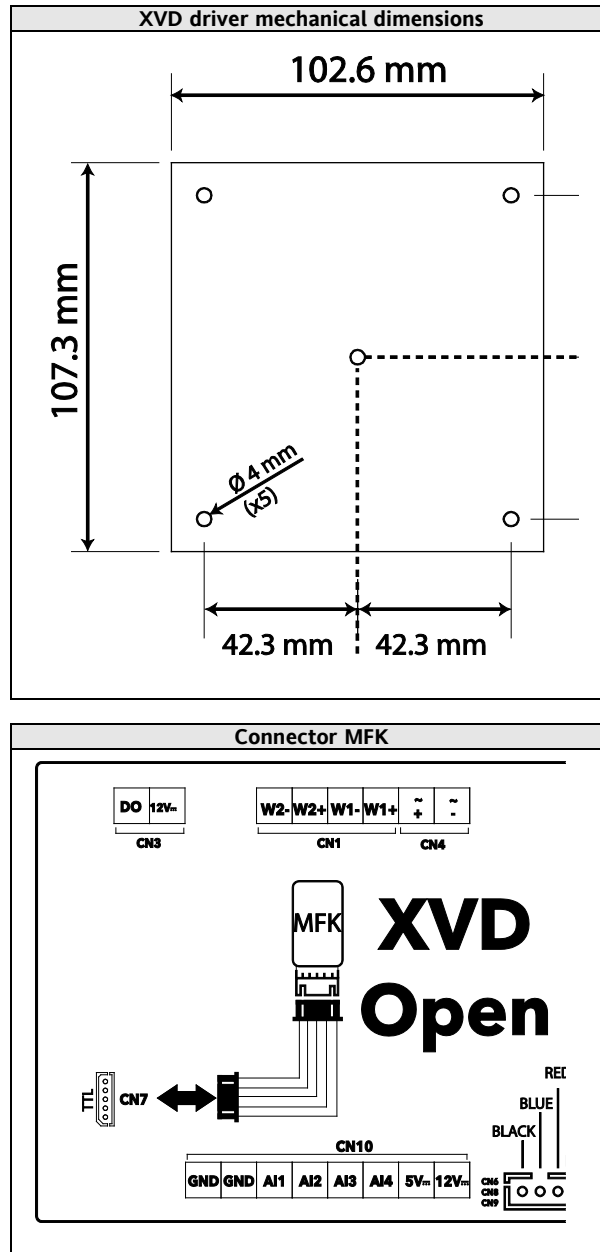


31.4 XVD 4 DIN mounting

The device is designed to be DIN rail-mounted.

The admissible ambient temperature range for correct operation is between -5 and 55°C .

Do not mount the device in extremely damp and/or dirt-laden areas; is it designed for use in places with ordinary or normal levels of pollution. Keep the area around the device cooling slots adequately ventilated.

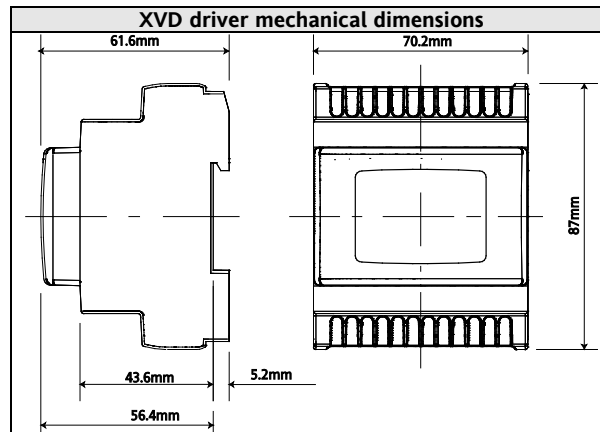

31.5 Electrical connections

31.5.1 General warnings

Before proceeding make sure the controller is connected to a suitable external transformer. The following rules must be followed when connecting cards to each other and to the application:

- Check the plate data of the valve given in the manufacturer's manual
- Loads that exceed the maximum limits set forth in this manual/product label must not be applied to outputs.
- When connecting loads, follow connection diagrams carefully.
- To avoid electric pairings, wire all low voltage SELV utilities separately from high voltage utilities.

Before connecting the valve, carefully configure the XVD driver by selecting the valve type from the list of compatible valves.

IMPORTANT!

Make sure the appliance is switched off before working on the electrical connections. All operations must be carried out by qualified personnel.

The connection is made by means of removable screw connectors (use wires with maximum section $\leq 2.5\text{mm}^2$) mounted on the boards.

To ensure proper connections, comply with the following:

- Power supplies other than those specified can seriously damage the system.
- Use cables of suitable section for the terminals.
- Separate the cables of probes from inductive loads and high voltage connections to prevent any electromagnetic interference. Do not place the probe cables near other electrical equipment (switches, meters, etc.)
- Make connections as short as possible and do not wind them around electrically connected parts.
- To avoid causing static discharges, do not touch the electronic components on the boards.
- The device must be connected to a suitable transformer that complies with the specifications provided in the Specifications chapter.
- Take special care if the power supply module and/or transformer is connected to earth or is used for other devices. This may create unexpected electrical circuits with risks of malfunction and damage to the controller and to the devices themselves.

Important!

Make certain that the power supply voltage matches the rated voltage of the device.

31.5.2 Power supply

Non-insulated power supply

If the same power supply module/transformer is also used for other devices and/or connected to earth, there are significant risks of malfunctions or damage to the controller/actuator.

31.5.2.1 Analogue Inputs-Probes

Probes have no connection polarity and can be extended using a normal bipolar cable (note that the extension of the probes influences the instrument's EMC electromagnetic compatibility: take great care with the wiring).

Important!

Pressure probes have a specific insertion polarity which must be observed.

Signal cables (temperature/pressure probes, digital inputs, TTL serial) must be wired separately from high voltage cables. Eliwell-supplied probes are recommended. Contact Eliwell Sales Office for item availability.

31.5.2.2 Serial connections

TTL

Use a 5-wire TTL cable up to 30cm in length.

An Eliwell-supplied TTL cable is recommended. Contact Eliwell Sales Office for item availability.

MFK

TTL for connection to MFK

LAN

3-wire powered LAN serial output available on terminal board (removable quick connector) for connection to the LAN (see Applications section)

Max. distance 100m



This connection is to be used to connect the modules of the Flex series (including the SKP 10 terminal)

N.B.: If the driver is connected in a LAN with instruments from the Energy Flex series, XVD will behave as an expansion: the SKP 10 terminal will act on modules of the Flex series (in which the XVD parameters are replicated) and not on XVD

To modify the parameters directly or display the resources of XVD, use the serial port in association with Device Manager




Temperature probes



Pressure probes

31.6 Wiring diagrams


31.6.1 XVD Open wiring diagram

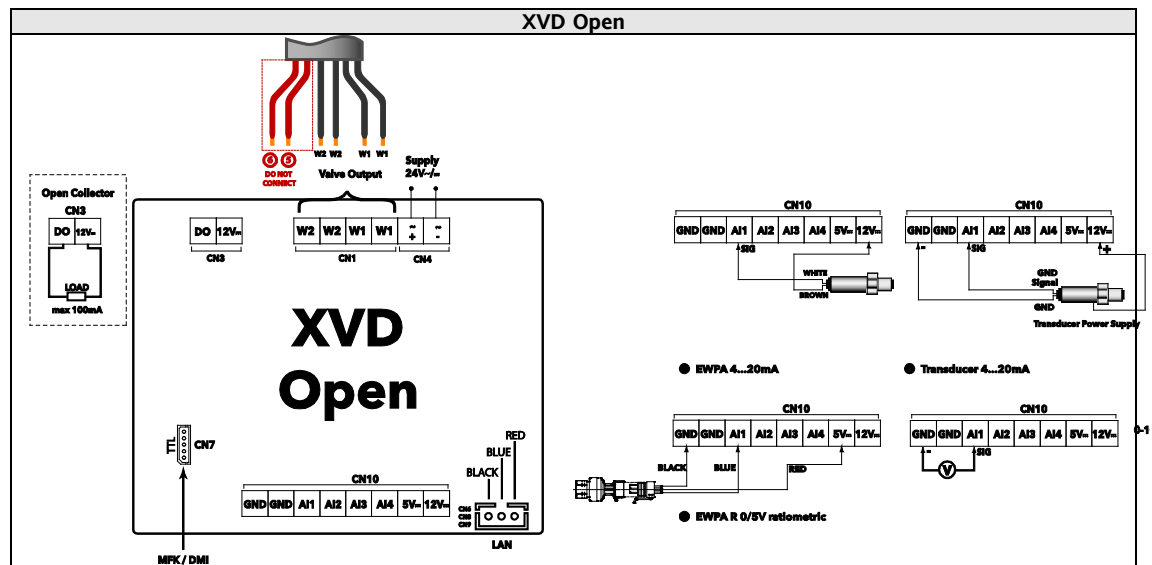

Terminal	Label	Description	Notes	Parameters SBA Folder 1L/2L
CN3	Open Collector	Load power Open Collector	Max LOAD 100mA (CN3/12V _{cc} + CN10/12V _{cc})	1L91 2L91
CN1	Valve Output	Valve output	DO NOT connect / DO NOT short the 5th and 6th wire of the valve, if present	
CN4	Supply	Power supply N.B. NON-insulated power supply	In the case of a DC supply, check polarity	
		Ground	We advise connecting the ground wire if possible	
CN6 CN8 CN9	LAN	Voltage serial connection LAN is insulated from inputs	BLACK= GND; BLUE= SIGNAL; RED=12V _{cc} (INPUT)	
CN10	GND	Ground		
	5 V _{cc}	Probe power supply	For ratiometric probe	
	12V _{cc}	Probe power supply	Power supply for probes with 4..20 mA current input Max LOAD 100mA (CN3/12V _{cc} + CN10/12V _{cc})	
	AI1	Analogue input 1		1L11 / 1L20 2L11 / 2L20
	AI2	Analogue input 2		1L12 / 1L13 / 1L21 2L12 / 2L13 / 2L21
	AI3	Analogue input 3		1L22 2L22
	AI4	Analogue input 4		1L23 2L23
MFK		Connection to MultiFunctionKey		
CN7	TTL	Televi/MODBUS connection	Via BusAdapter	


Colours of probes and transducers	
Black	Nero
Blue	Blu
Brown	Marrone
Red	Rosso
White	Bianco
Yellow	Giallo
Signal	Segnale
Transducer	Trasduttore
Transducer Power Supply	Alimentazione per trasduttore

31.6.2 XVD 4 DIN wiring diagram

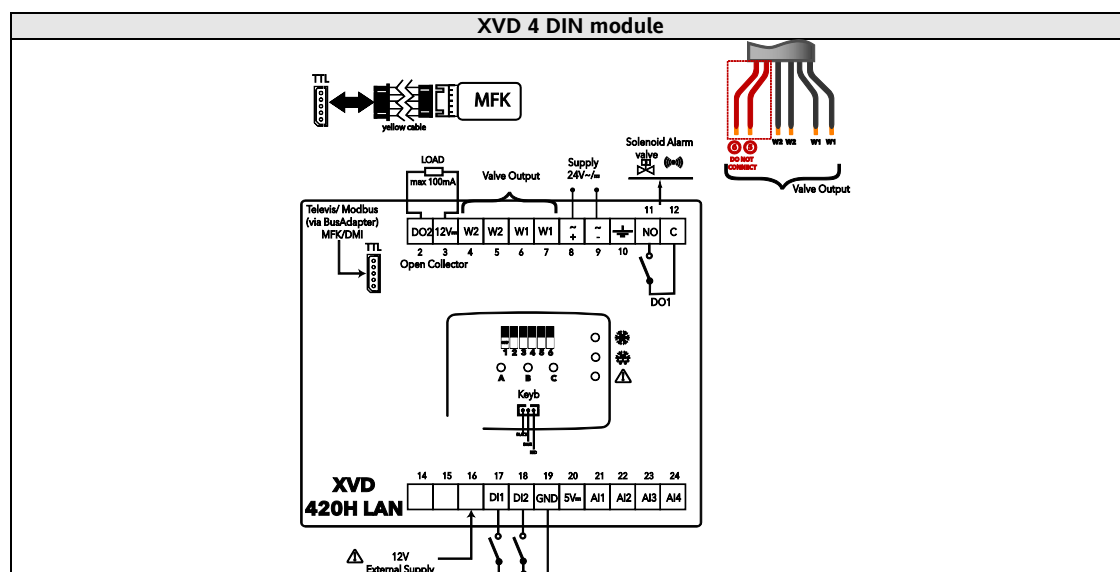

Terminal	Label	Description	Notes	Parameters SBA Folder 1L/2L
2....3	Open Collector	Load power Open Collector	Max LOAD 100mA Terminal 3: 12V~ N.B. Power supply for probes with current inputs 4..20mA and O.C.	1L91 2L91
4 -5 -6 -7	Valve Output	Valve output	DO NOT connect / DO NOT short the 5th and 6th wire of the valve, if present	
8-9	Supply	Power supply N.B. NON-insulated power supply	In the case of a DC supply, check polarity	
		Ground	We advise connecting the ground wire if possible	
14-15-16	LAN	Voltage serial connection LAN is insulated from inputs	BLACK= GND; BLUE=SIGNAL; RED=12V~ (INPUT) 12V external supply /12V	
17	DI1	Digital Input 1	Connecting the digital inputs to a power supply output is strictly forbidden	
18	DI2	Digital Input 2		
19	GND	Ground		
20	5 V~	Probe power supply	For ratiometric probe	
21	AI1	Analogue input 1		1L11 / 1L20 2L11 / 2L20
22	AI2	Analogue input 2		1L12 / 1L13 / 1L21 2L12 / 2L13 / 2L21
23	AI3	Analogue input 3		1L22 2L22
24	AI4	Analogue input 4		1L23 2L23


31.6.3 Compatible valve connection

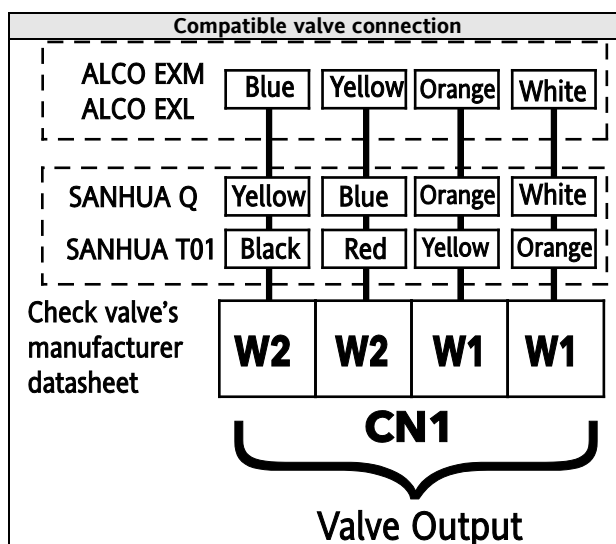

Colour	Colour
Black	Nero
Blue	Blu
Brown	Marrone
Red	Rosso
White	Bianco
Yellow	Giallo
Note	
Check valve manufacturer's datasheet	
Check the rating data of the valve as shown in the manufacturer's manual	

3-wire LAN powered serial output available on the terminal board for connection to SBA.
Max. distance 100m

31.6.4 Example of XVD / Energy Flex connection

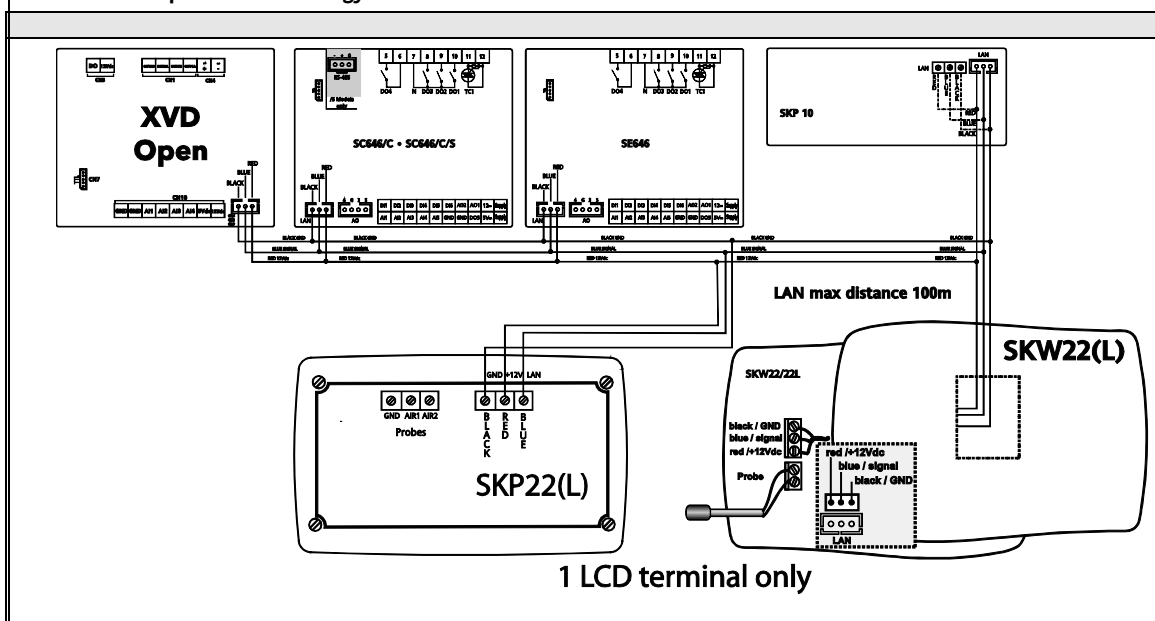

Wire colours	
Black GND	Nero GND
Blue Signal	Blu Segnale
Red +12Vdc	Rosso +12Vdc
Probe	Probe

31.7 Technical Data

31.7.1 General technical specifications

	Standard	Min.	Max.
Supply voltage	24 V~/~		
Power supply frequency	50Hz/60Hz	---	---
Power consumption	30VA / 25W	---	---
Insulation class	2	---	---
Working temperature	25°C	-5°C	55°C
Operating environment humidity (non-condensing)	30%	10%	90%
Storage temperature	25°C	-20°C	85°C
Ambient storage humidity (non-condensing)	30%	10%	90%

Classification	
The product complies with the following harmonized standards:	EN 60730-2-6 / EN 60730-2-9 / EN 60730-1
Use	operating (not safety) device for incorporation
Mounting	Panel or on DIN Omega bar support.
Type of action	1.B
Pollution class	2 (normal)
Over voltage category	II
Nominal pulse voltage	2500V
Digital outputs	refer to the label on the device
Fire resistance category	D
Software class and structure	A
PTI of materials used for insulation	PTI 250V
Period of electrical stress on the insulating parts	Long period

31.8 I/O features

Analogue input	NTC probe 103AT 10kΩ	NTC extended range	Pt1000	4-20 mA	Ratiometric 0-5V	0-10 V~	Digital input
AI1	•	•	•	•	•	•	-
AI2	•	•	•	-	-	-	-
AI3	•	•	-	-	-	-	•
AI4	•	•	-	-	-	-	•
Measurement range	-50°C ÷ +99.9°C	-40°C ÷ +150.0°C	-0.5 ÷ +99.9;	-14.5 ÷ +999.9;	-14.5 ÷ +999.9;	0.0 ÷ +100.0;	-
Accuracy	Accuracy 1% f.s.	1% f.s.	1% f.s.	1% f.s.	1% f.s.	1% f.s.	-
Resolution	0.1°C	0.1°C	0.1°C	0.1 bar	0.1 bar	0.1 bar	-
Impedance	/	/	/	100Ohm	110KOhm	21KOhm	-

Digital output Open Collector safety extra low voltage SELV DO	1 Open Collector output Max current 100mA @12V~
---	--

31.9 Serial

Label	Description
TTL	1 TTL serial for connection with a PC via a suitable interface module
MFK	1 TTL serial for connection to MFK to upload/download parameters and/or applications
LAN	Removable quick connect terminals for integration of Energy Flex network

31.10 Transformer

The instrument must be connected to a suitable current transformer with the following features:

- Primary voltage: Depending on requirements of the individual device and/or country of installation.
- Secondary voltage: 24 V~/~
- Power supply frequency: 50/60Hz
- Power: 30VA / 25W

N.B.: cable must be no longer than 10m

31.10.1 Mechanical dimensions

	Length (L) mm	Depth (d) mm	Height (H) mm	Notes
XVD measurements Open	102.6	1.6	107.3	Open board
XVD 4DIN	70.2	61.6	87	4DIN

31.11 MFK

31.11.1 Download from reset

The **Multi Function Key (MFK)** is an accessory that when connected to the TTL serial port, allows rapid programming of the controller parameters (up/download parameter map to or from one or more controllers of the same type) rapidly and/or the controller's application software.

For rapid programming of the parameters, the upload (label UL), download (label dL) and multi function key formatting (label Fr) operations are performed as explained below:

UPLOAD (copy from CONTROLLER to MFK)

With this operation the programming parameters will be uploaded from EVD to **MFK**

DOWNLOAD (copy from MFK to CONTROLLER)

This operation downloads the programming parameters from **MFK** to the instrument.

FORMAT*

Formatting **MFK** consists of deleting its contents

*This should be done prior to Uploading when used for the first time.

Connect the Copy Card with the device switched off.

Firmware download

At start up, if compatible firmware is installed on the **MFK** (**MFK** can be prepared with firmware using the Device Manager software), the new firmware is downloaded to the controller.

This happens as follows:

- firmware verification/update (**MFK** led flashes)
- termination with successful programming (**MFK LED steadily lit**)
- switch off the device

If a compatible firmware is not loaded into the **MFK**, no download takes place.

If, on termination, the **MFK** led does not stay on fixed, the operation must be repeated as this means it failed.

Download parameters

On start up, if there is a compatible parameter map in the **MFK**, the programming parameters are loaded into the device.

NOTES

- If the **MFK** is loaded with both a compatible firmware and a compatible parameter map, the firmware is downloaded first and then (after the device has been switched off and back on again manually) the parameter map.
- The formatting function is **ONLY REQUIRED FOR UPLOADING (**)**:
 - o to use the Multi Function Key the first time (Multi Function Key that has never been used);
 - o to use the Multi Function Key with models that are not compatible.
 - o (**) a pre-programmed card supplied by Eliwell to DOWNLOAD parameters does not need to be formatted. **N.B.: Formatting CANNOT be undone.**
- After the download operation, the instrument will work with the newly loaded parameters map/firmware.
- Remove the key on completion of the operation.

31.12 Operation

XVD is a stepper type electronic expansion valve that regulates the minimum overheating value at the evaporator output.

The control value is the percentage of valve opening which is translated into a percentage of valve output enabling according to the following parameters:


- **1E10 / 2E10 - Maximum valve opening percentage** (maximum opening of the valve);
- **1E14 / 2E14 - Minimum valve useful opening percentage** (minimum effective opening of the valve);
- **1E15 / 2E15 - Maximum valve opening percentage** (maximum effective opening of the valve).

If the regulator commands an output greater than or equal to **1E15 / 2E15**, the actual output will be equal to **1E10 / 2E10**.
N.B.: If **1E15 > 1E10 (2E15 > 2E10)** the function is disregarded.

If the regulator controls an output of less than or equal to **1E14 / 2E14**, the actual output is equal to 0.

If the regulator commands an output greater than or equal to **1E10 / 2E10** for a time greater than **1E13 / 2E13** a maximum opening alarm **E108 / E208** is generated to signal a critical condition of the system, such as low charge, undersized design, etc.

N.B.: to disable this signal set **1E13 / 2E13 = 0**.

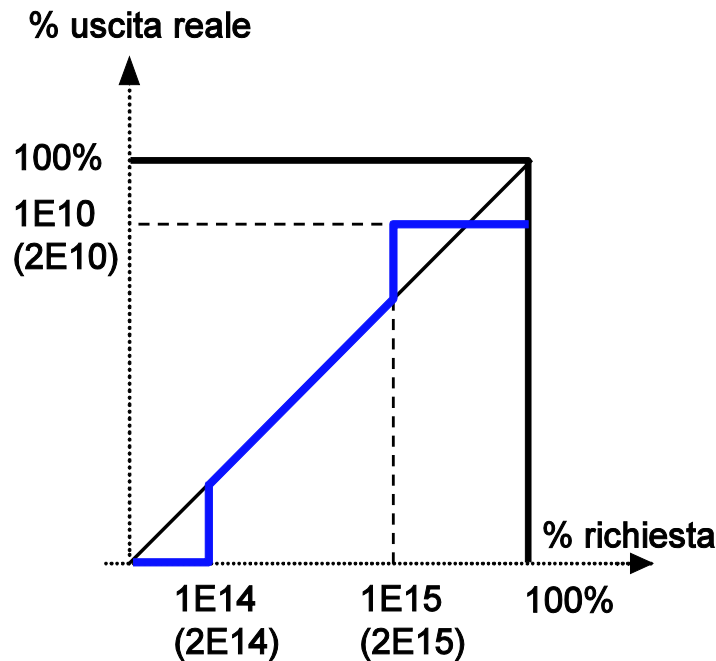

Saturation set

XVD calculates the actual overheating value using the two analogue inputs, overheating dAI3 and saturation dAI1.

By means of a PID controller the regulator modulates opening of the valve in such a way that overheating reaches setpoint **1E32 / 2E32**. The algorithm is dynamic: the effective overheating value may not reach the set Setpoint or may temporarily fall below this value.

If this results in the egress of liquid from the evaporator the **1E32 / 2E32** setpoint value must be increased.

N.B.: valid for **1E30=1 (2E30=1)**

System type 1E21 (2E21).

The PID configuration parameters will be uploaded automatically by the controlled by selecting the type of system defined by parameter **1E21 / 2E21**.

MOP (Maximum Operating Pressure)

MOP regulation envisages a threshold defined by the pressure setpoint **1E52 / 2E52**.

Once this threshold has been exceeded for a time greater than **1E53 / 2E53**, a MOP alarm will be generated (see **E107 / E207**).

- MOP regulation can be enabled by means of parameter **1E501 / 2E50**.
- MOP regulation can be disabled when the controller is powered on / on return from a defrost condition for a time equal to **1E51 / 2E51**.

31.13 XVD applications

31.13.1.1 Digital Inputs regulation

AI3 and AI4 can be configured as digital inputs.

Setup of digital inputs is performed by means of parameters 1L40 and 1L41 / 2L40 and 2L41


If they are different from zero the digital inputs assume priority over the corresponding serial commands (if they are configured in the same manner AI3 assumes priority).

The command is transmitted on a digital input or serial interface on the basis of parameters dF02 / dF02

Value 1L40/1L41 2L40/2L41			
±1	ON	Enabling regulation	Forcing valve opening to value: 1E11/2E11 - Valve actuation percentage after blackout For a time: 1E35/2E35 - Valve opening freezing timer after OFF->ON
	OFF	Regulation deactivation	Valve closing (saving of current percentage to 1E11/2E11)
±2	ON	Defrost	Valve closing N.B.: the digital input configured ±1 is disregarded until defrost end At the end of defrost the valve opening is forced to the value set by: 1E12/2E12 - Valve actuation percentage after defrost (if ≠ 0) Otherwise refer to 1E11/2E11
	OFF	No defrost	See regulation ON
±3	ON	Alarm	Valve closing
	OFF	No alarm	/
±4	ON	Preset factory regulation	Control enabled with profile defined by 1E22/2E22 – Type of system operating mode HEAT
	OFF		Control enabled with profile defined by 1E21/2E21 – Type of system operating mode COOL

31.13.2 Example of 1 circuit heat pump application

- Driver XVD controls the electronic expansion valve (EEV)
 - Driver XVD receives commands for defrosting and control of EEV from Energy Flex via the Eliwell LAN.
- In the absence of communication XVD closes valve EEV and signals an alarm condition.

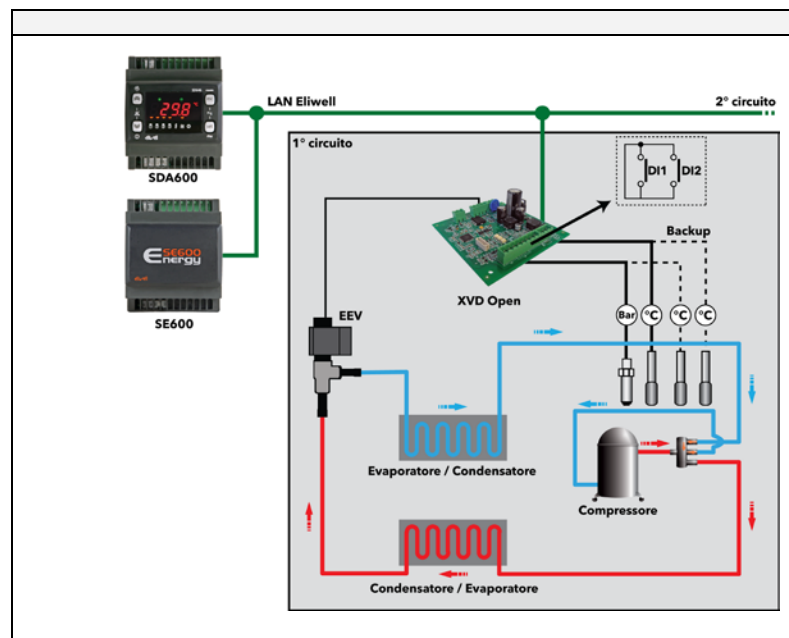

31.13.3 Example of 2 circuit heat pump

Application 2 XVD drivers - 1 Energy Flex series controller

The network can manage a maximum of 2 XVD drivers + 1 Energy Flex

- Driver 1 controls electronic expansion valve 1 (first circuit EEV)
- Driver 2 controls electronic expansion valve 2 (second circuit EEV)
- Drivers 1&2 receive commands for defrosting and control of the respective expansion valves EEV (1 per circuit) from Energy Flex via the Eliwell LAN.

Set the network address using the dipswitches for XVD;

- 0= first circuit;
- 1= second circuit

In the absence of communication XVD closes valve EEV and signals an alarm condition.

31.14 Alarms

The XVD controller can run full diagnostics on the system, signalling any operating faults with specific alarms, and record and signal, directly on the SBA display, specific user-defined events to achieve greater control over the system as a whole.

Alarm conditions

The alarm condition is always reported by the LED near the alarm icon and the enabling of the output on the relay, if appropriately configured.

Probe errors are displayed directly on the SBA display.

Alarms Table

See SBA600 Alarms section.

31.15 Configuration with Modbus RTU

The serial TTL - which we will call COM0 – can be used to configure the device, parameters, states, and variables with Modbus via the Modbus protocol.

Modbus is a client/server protocol for communication between devices connected in a network.

Modbus devices communicate using a master-slave technique in which only one device (master) can send messages.

The other devices in the network (slave) respond, returning the data requested by the master or executing the action contained in the message sent. A slave is a device connected to a network that processes information and sends the results to the master using the Modbus protocol.

The master device can send messages to individual slaves or to the entire network (broadcast) whilst slaves can only respond individually to the master.

The Modbus standard used by Eliwell employs the RTU code for data transmission.

31.15.1 Data format (RTU)

The coding model used defines the structure of messages transmitted on the network and the way in which this information is deciphered. The type of coding is usually selected on the basis of specific parameters (baud rate, parity, etc.)***; furthermore, some devices support only specific coding models, although it must be the same one for all devices connected in a Modbus network.

The protocol uses the RTU binary method with bytes configured as follows:


8 bits for data, even parity bit, 1 stop bit (non-configurable).

***can be set via parameters

- **dF30 - Modbus protocol controller address**
- **dF31 - Modbus protocol baud rate**
- **dF32 - Modbus protocol parity**

Parameter setting allows the full configuration of the device. The parameters can be modified by sending data via the Modbus protocol directly to an individual controller.

The connection diagram when using Modbus is shown below

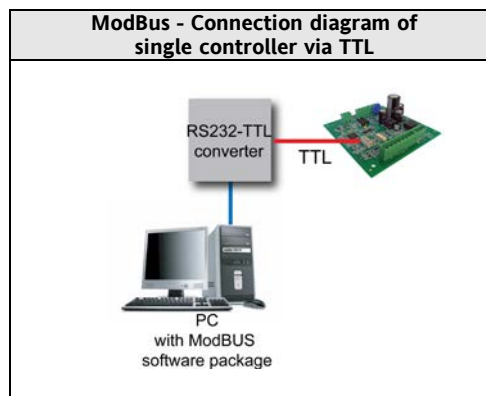

31.15.2 Modbus commands available and data areas

The following commands are implemented:

Modbus command	Description of command
3	Read multiple registers on Client side
16	Write multiple registers on Client side
43	Read device ID
	DESCRIPTION Manufacturer ID Model ID Version ID

Length restrictions

Maximum length in bytes of messages sent to device	60 BYTES
Maximum length in bytes of messages received by the device	60 BYTES

31.16 Configuration of device address

The address of a device (Device Number) in a ModBus message is defined in parameter **df30**.
The address 0 is used for broadcast messages that all slaves recognize. Slaves don't respond to broadcast messages.

31.16.1 Configuration of parameter addresses

The list of addresses is given in the Parameters chapter under the section headed "Parameters Table / ADDRESS column visibility" (parameters addresses) and VIS PAR ADDRESS (addresses visibility parameters).

31.16.2 Configuration of variable addresses / states

List of addresses

31.17 Table of XVD parameters

Folder label	Meaning of acronym (label)	Parameters
dF	driver protocol conFiguration	Protocol Configuration
dE	Driver valve configuration	Valve configuration

Unless otherwise indicated, the parameter is always visible and modifiable, unless customized settings have been configured via serial.

FOLDER	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	VAL PAR ADDRESS	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dF	dF10	49166	BYTE					RW	COM Lincus protocol controller address • 2= XVD 1 (MASTER XVD) • 3= XVD 2 (SLAVE XVD) Other values NOT USED	0 ... 15	2	num.
dF	dF30	49175	BYTE			49437.6	Y	RW	Modbus protocol controller address N.B.: 0 (zero) is not included	1 ... 255	1	num.
dF	dF31	49176	BYTE			49438	Y	RW	Modbus protocol Baudrate • 0 = 1200 baud • 1 = 2400 baud • 2 = 4800 baud • 3 = 9600 baud • 4 = 19200 baud • 5=38400 baud (maximum speed that can be set using DeviceManager software) • 6 = 57600 baud • 7 = 115200 baud	0 ... 7	3	num.
dF	dF32	49177	BYTE			49438.2	Y	RW	Modbus protocol parity • 0= NONE • 1= EVEN (parity) • 2= ODD (disparity)	0 ... 2	1	num.
dF	dF60	16426	BYTE					RW	Client code 1	0 ... 999	0	num.
dF	dF61	16428	BYTE					RW	Client code 2	0 ... 999	0	num.
Parameters dE01...dE09/dE80 are visible and settable only if the SBA600 parameter 1E00 / 2E00 - Valve model =0. The Modbus addresses in the case of 1E00 / 2E00 =0 are shown below Note that visibility of parameters dE01...dE09/dE80 cannot be set via serial line Check the data given in the valve manufacturer's manual for the correct configuration												

FOLDER	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	VAL PAR ADDRESS	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dE	dE01	16720	WORD			/	Y	RW	Stepper motor maximum speed Defines the maximum valve motor speed to guarantee step precision and integrity	-1999 ... 9999	See Table A	Step/s
dE	dE02	16752	WORD			/		RW	Stepper motor complete opening Defines the maximum number of valve steps. The total travel refers to the FULL STEP mode (dE07=0) The valve opening is complete when this value is reached	0 ... 9999	See Table A	Steps
dE	dE03	49552	BYTE			/		RW	Stepper motor extra movement in total closure Defines the number of extra valve steps beyond the limit switch to guarantee correct total closure. A total closure command implies the valve positioned to zero and a further number of steps dE03	0. .. 255	See Table A	Steps
dE	dE04	16800	WORD			/		RW	Stepper motor winding maximum current Defines the maximum current per phase utilised by the valve (maximum torque)	0 ... 9999	See Table A	mA
dE	dE05	49600	BYTE			/		RW	Stepper motor winding resistance Defines the electrical resistance of the single phase winding (check fault on connections)	0 ... 255	See Table A	Ohm
dE	dE06	16848	WORD			/		RW	Stepper motor winding rated current Defines the phase circulating current in the valve stop condition (minimum torque)	0 ... 9999	See Table A	mA
dE	dE07	16848	BYTE			/		RW	Type of stepper motor control Defines the piloting modes. 0= FULL STEP 1= FULL STEP 2= MICRO STEP Note that the current piloting is a maximum value for the FULL STEP mode while the other two modes, modulating the value of the winding currents, offers greater resolution and fluidity of movement but with less torque. Refer to the literature concerning step-by-step motors for more detail	0 ... 2	See Table A	num.
dE	dE08	50960	BYTE			/		RW	Stepper motor enabling/disabling duty cycle If the case of valve overheating, reduce the enabling duty cycle to allow it to cool down	0 ... 100	See Table A	%

FOLDER	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	VAL PAR ADDRESS	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dE	dE09	50976	BYTE			/		RW	Stepper motor acceleration/deceleration Defines the acceleration/deceleration in motor start/stop. The time between one step and the next is reduced by dE09 ms at each step until dE01 is reached If =0 acceleration is not applied	0 ... 255	See Table A	10*ms/step
dE	dE80	49648	BYTE			/		RW	Stepper motor minimum speed for acceleration / deceleration Defines the minimum speed at which the motor starts and stops	0 ... 255	See Table A	Step/s
dE	dE19	49648	BYTE			/		RW	Tolerance on stepper motor winding resistance (the value is expressed as a percentage of dE05) Defines the extent to which the load resistance is considered to be variable with respect to the parameter defined by dE05 (wiring faults check)	0 ... 255	255	%
dE	dE93	49231	BYTE			49444.2	Y	RW	Period of motor enabling/disabling Sets the enabling/disabling cycle (Duty cycle) of the stepper motor. See dE08	0 ... 255	10	Sec*10
Parameters dE30...dE38/dE50...dE53 can be displayed and set on the basis of parameters dE21...dE23 The Modbus addresses in the case of dE21=0 are shown below Note that visibility of these parameters cannot be set via serial line												
dE	dE30	49308	BYTE			49445.6		RW	Enable reference overheating recalculation Used to enable the automatic recalculation of the referred Setpoint in order to regulate the overheating 0= recalculation disabled. Setpoint = dE32; 1= automatic recalculation enabled	0...1	0	num.
dE	dE31	16512	WORD		-1	49446		RW	Overheating upper threshold Used to set the setpoint SP4 to dE31 (SP2) to regulate the overheating following a black-out or at the end of defrost Active for the time set by dE51 (or when the MOP function is disabled)	0...1000	60	°C/°F
dE	dE32	16510	WORD		-1	49446.2		RW	Overheating lower threshold Used to set the setpoint SP2 to regulate the overheating (objective overheating) If dE30=1 and the calculated setpoint < dE32, then the dynamic setpoint will be = dE32.	0...1000	60	°C/°F

FOLDER	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	VAL PAR ADDRESS	RESET (Y/N)	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
dE	dE33	16514	WORD			49446.4		RW	Overheating reference recalculation period Valid for dE30=1 Defines the recalculation period of the dynamic setpoint (every dE33 seconds)	0...999	20	sec
dE	dE34	16516	WORD		-1	49446.6		RW	Overheating recalculation step Dynamic setpoint varies by dE34 degrees according to the overheating value compared to dE32.	0...1000	1	°C/°F
dE	dE35	16470	WORD			49447		RW	Valve opening freezing timer after OFF->ON	0...1999	0	sec
dE	dE36	16518	WORD	Y	-1	49447.2		RW	Overheating proportional band	-9999...-1	-100	K
dE	dE37	16520	WORD			49447.4		RW	Overheating full time	0...1999	40	sec
dE	dE38	16522	WORD			49447.6		RW	Overheating derivative time	0...1999	0	sec
dE	dE50	49270	BYTE			49450.4		RW	Enable MOP 0= MOP disabled; 1 = MOP enabled.	0 ... 1	0	num.
dE	dE51	16478	WORD			49450.6		RW	MOP disable time MOP activation delay on switching on or after defrost.	0 ...999	0	sec
dE	dE52	16472	WORD	Y	-1	49451		RW	Evaporator temperature upper threshold MOP setpoint	-60 ... 100	0	°C/°F
dE	dE53	49271	BYTE			49451.2		RW	Min time that temperature upper threshold is exceeded for alarm activation If the dE52 threshold is exceeded for longer than dE53 the MOP alarm is given.	0% 255	180	sec

The default values for compatible valves (selectable via **1E00 / 2E00 – Valve Model #0**) are factory settings and cannot be edited
Refer to the summary table with the default values

1E00 - 2E00	VALVE Type	dE01	dE02	dE03	dE04	dE05	dE06	dE07	dE08	dE09	dE80
		Step/s	steps	steps	mA	Ohm	mA	Num.	%	10*ms/step	Step/s
0	customisable	-45	250	50	105	92	35	1	100	50	10
1...12, 15	NOT USED	/	/	/	/	/	/	/	/	/	/
13	ALCO EXM / EXL	45	250	50	200	133	70	1	100	50	10
14	SANHUA QA(Q)	-45	250	50	105	92	35	1	100	50	10

The default values of the factory preset configurations can be altered via serial line. Refer also to the following table

31.17.1 Table A

Valve configuration parameters dE01..dE09, dE80 with 1E00 / 2E00 – Valve model #0

1E00 - 2E00	VALVE	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
0	customisable	See parameters / visibility table									
13	ALCO EXM / EXL	dE01	16746	WORD			RW	Stepper motor maximum speed	0 ... 9999	45	steps/s
13	ALCO EXM / EXL	dE02	16778	WORD			RW	Stepper motor complete opening	0 ... 9999	250	steps
13	ALCO EXM / EXL	dE03	49565	BYTE			RW	Stepper motor extra movement in total closure	0 ... 255	50	steps
13	ALCO EXM / EXL	dE04	16826	WORD			RW	Stepper motor winding maximum current	0 ... 9999	200	mA
13	ALCO EXM / EXL	dE05	49613	BYTE			RW	Stepper motor winding resistance	0 ... 255	133	ohm
13	ALCO EXM / EXL	dE06	16874	WORD			RW	Stepper motor winding rated current	0 ... 9999	70	mA
13	ALCO EXM / EXL	dE07	49661	BYTE			RW	Type of stepper motor control	0 ... 2	1	num.
13	ALCO EXM / EXL	dE08	50973	BYTE			RW	Stepper motor enabling/disabling duty cycle	0 ... 100	100	%
13	ALCO EXM / EXL	dE09	50989	BYTE			RW	Stepper motor acceleration/deceleration	0 ... 255	50	ms*10/step
13	ALCO EXM / EXL	dE80	51005	BYTE			RW	Minimum stepper motor speed in acceleration/deceleration	0 ... 255	10	steps/s
14	SANHUA QA(Q)	dE01	16748	WORD			RW	Stepper motor maximum speed	0 ... 9999	-45	steps/s
14	SANHUA QA(Q)	dE02	16780	WORD			RW	Stepper motor complete opening	0 ... 9999	250	steps
14	SANHUA QA(Q)	dE03	49566	BYTE			RW	Stepper motor extra movement in total closure	0 ... 255	50	steps
14	SANHUA QA(Q)	dE04	16828	WORD			RW	Stepper motor winding maximum current	0 ... 9999	105	mA
14	SANHUA QA(Q)	dE05	49614	BYTE			RW	Stepper motor winding resistance	0 ... 255	92	ohm
14	SANHUA QA(Q)	dE06	16876	WORD			RW	Stepper motor winding rated current	0 ... 9999	35	mA

1E00 - 2E00	VALVE	LABEL	VAL PAR ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
14	SANHUA QA(Q)	dE07	49662	BYTE			RW	Type of stepper motor control	0 ... 2	1	num.
14	SANHUA QA(Q)	dE08	50974	BYTE			RW	Stepper motor enabling/disabling duty cycle	0 ... 100	100	%
14	SANHUA QA(Q)	dE09	50990	BYTE			RW	Stepper motor acceleration/deceleration	0 ... 255	50	ms*10/step
14	SANHUA QA(Q)	dE80	51006	BYTE			RW	Minimum stepper motor speed in acceleration/deceleration	0 ... 255	10	steps/s

31.17.2 Table B

Working modes

The default values for operating modes (selectable via **SBA600 parameters 1E21/2E21 1E22/2E22 ≠0**) are preset in the factory and cannot be edited
Refer to the summary table with the default values

		Flag	K	K	Sec	K	Sec	K	sec	sec		Flag	Sec	°C	sec
1E21/1E22 2E21/2E22	parameters	1E30 2E30	1E31 2E31	1E32 2E32	1E33 2E33	1E34 2E34	1E35 2E35	1E36 2E36	1E37 2E37	1E38 2E38	...	1E50 2E50	1E51 2E51	1E52 2E52	1E53 2E53
0	Customisable See parameters 1E30...1E38, 1E50...1E53 SBA600	0	50	50	20	1	0	-100	40	0		10	10	10	10
1E21/1E22 2E21/2E22	Operating mode	dE30	dE31	dE32	dE33	dE34	dE35	dE36	dE37	dE38	...	dE50	dE51	dE52	dE53
12	COOL	0	60	60	20	1	0	-100	40	0		0	0	0	180
13	HEAT	0	60	60	20	1	0	-60	60	0		0	0	0	180
14		0	60	60	20	1	0	-30	100	0		0	0	0	180
15		0	60	60	20	1	0	-20	150	0		0	0	0	180
16		0	60	60	20	1	0	-15	100	0		0	0	0	180

The default values of the factory preset configurations can be altered via serial line. Refer also to the following table

FOLDER	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Vx	V12_dE30	50397	BYTE			RW	Enable reference overheating recalculation	0 ... 1	0	flag
Vx	V12_dE31	17632	WORD		-1	RW	Overheating upper threshold	0 ... 1000	60	K
Vx	V12_dE32	17630	WORD		-1	RW	Overheating lower threshold	0 ... 1000	60	K
Vx	V12_dE33	17634	WORD			RW	Overheating reference recalculation period	0 ... 999	20	seconds
Vx	V12_dE34	17636	WORD		-1	RW	Overheating recalculation step	0 ... 1000	1	K
Vx	V12_dE35	17658	WORD			RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	seconds
Vx	V12_dE36	17638	WORD	Y	-1	RW	Overheating proportional band	-9999 ... -1	-100	K
Vx	V12_dE37	17640	WORD			RW	Overheating full time	0 ... 1999	40	seconds
Vx	V12_dE38	17642	WORD			RW	Overheating derivative time	0 ... 1999	0	seconds
Vx	V12_dE50	50396	BYTE			RW	Enable MOP	0 ... 1	0	flag
Vx	V12_dE51	17600	WORD			RW	MOP disable duration at start-up	0 ... 999	0	seconds
Vx	V12_dE52	17602	WORD	Y	-1	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
Vx	V12_dE53	50395	BYTE			RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	seconds

FOLDER	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Vx	V13_dE30	50461	BYTE			RW	Enable reference overheating recalculation	0 ... 1	0	flag
Vx	V13_dE31	17696	WORD		-1	RW	Overheating upper threshold	0 ... 1000	60	K
Vx	V13_dE32	17694	WORD		-1	RW	Overheating lower threshold	0 ... 1000	60	K
Vx	V13_dE33	17698	WORD			RW	Overheating reference recalculation period	0 ... 999	20	seconds
Vx	V13_dE34	17700	WORD		-1	RW	Overheating recalculation step	0 ... 1000	1	K
Vx	V13_dE35	17722	WORD			RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	seconds
Vx	V13_dE36	17702	WORD	Y	-1	RW	Overheating proportional band	-9999 ... -1	-60	K
Vx	V13_dE37	17704	WORD			RW	Overheating full time	0 ... 1999	60	seconds
Vx	V13_dE38	17706	WORD			RW	Overheating derivative time	0 ... 1999	0	seconds
Vx	V13_dE50	50460	BYTE			RW	Enable MOP	0 ... 1	0	flag
Vx	V13_dE51	17664	WORD			RW	MOP disable duration at start-up	0 ... 999	0	seconds
Vx	V13_dE52	17666	WORD	Y	-1	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
Vx	V13_dE53	50459	BYTE			RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	seconds
Vx	V14_dE30	50525	BYTE			RW	Enable reference overheating recalculation	0 ... 1	0	flag
Vx	V14_dE31	17760	WORD		-1	RW	Overheating upper threshold	0 ... 1000	60	K
Vx	V14_dE32	17758	WORD		-1	RW	Overheating lower threshold	0 ... 1000	60	K
Vx	V14_dE33	17762	WORD			RW	Overheating reference recalculation period	0 ... 999	20	seconds
Vx	V14_dE34	17764	WORD		-1	RW	Overheating recalculation step	0 ... 1000	1	K
Vx	V14_dE35	17786	WORD			RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	seconds
Vx	V14_dE36	17766	WORD	Y	-1	RW	Overheating proportional band	-9999 ... -1	-30	K
Vx	V14_dE37	17768	WORD			RW	Overheating full time	0 ... 1999	100	seconds
Vx	V14_dE38	17770	WORD			RW	Overheating derivative time	0 ... 1999	0	seconds
Vx	V14_dE50	50524	BYTE			RW	Enable MOP	0 ... 1	0	flag
Vx	V14_dE51	17728	WORD			RW	MOP disable duration at start-up	0 ... 999	0	seconds
Vx	V14_dE52	17730	WORD	Y	-1	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
Vx	V14_dE53	50523	BYTE			RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	seconds
Vx	V15_dE30	50589	BYTE			RW	Enable reference overheating recalculation	0 ... 1	0	flag
Vx	V15_dE31	17824	WORD		-1	RW	Overheating upper threshold	0 ... 1000	60	K
Vx	V15_dE32	17822	WORD		-1	RW	Overheating lower threshold	0 ... 1000	60	K
Vx	V15_dE33	17826	WORD			RW	Overheating reference recalculation period	0 ... 999	20	seconds
Vx	V15_dE34	17828	WORD		-1	RW	Overheating recalculation step	0 ... 1000	1	K
Vx	V15_dE35	17850	WORD			RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	seconds

FOLDER	LABEL	ADDRESS	DATA SIZE	CPL	EXP	R/W	DESCRIPTION	RANGE	DEFAULT	U.M.
Vx	V15_dE36	17830	WORD	Y	-1	RW	Overheating proportional band	-9999 ... -1	-20	K
Vx	V15_dE37	17832	WORD			RW	Overheating full time	0 ... 1999	150	seconds
Vx	V15_dE38	17834	WORD			RW	Overheating derivative time	0 ... 1999	0	seconds
Vx	V15_dE50	50588	BYTE			RW	Enable MOP	0 ... 1	0	flag
Vx	V15_dE51	17792	WORD			RW	MOP disable duration at start-up	0 ... 999	0	seconds
Vx	V15_dE52	17794	WORD	Y	-1	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
Vx	V15_dE53	50587	BYTE			RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	seconds
Vx	V16_dE30	50653	BYTE			RW	Enable reference overheating recalculation	0 ... 1	0	flag
Vx	V16_dE31	17888	WORD		-1	RW	Overheating upper threshold	0 ... 1000	60	K
Vx	V16_dE32	17886	WORD		-1	RW	Overheating lower threshold	0 ... 1000	60	K
Vx	V16_dE33	17890	WORD			RW	Overheating reference recalculation period	0 ... 999	20	seconds
Vx	V16_dE34	17892	WORD		-1	RW	Overheating recalculation step	0 ... 1000	1	K
Vx	V16_dE35	17914	WORD			RW	Valve opening freezing timer after OFF->ON	0 ... 1999	0	seconds
Vx	V16_dE36	17894	WORD	Y	-1	RW	Overheating proportional band	-9999 ... -1	-15	K
Vx	V16_dE37	17896	WORD			RW	Overheating full time	0 ... 1999	100	seconds
Vx	V16_dE38	17898	WORD			RW	Overheating derivative time	0 ... 1999	0	seconds
Vx	V16_dE50	50652	BYTE			RW	Enable MOP	0 ... 1	0	flag
Vx	V16_dE51	17856	WORD			RW	MOP disable duration at start-up	0 ... 999	0	seconds
Vx	V16_dE52	17858	WORD	Y	-1	RW	Evaporator temperature upper threshold	-600 ... 1000	0	°C
Vx	V16_dE53	50651	BYTE			RW	Min time that temp upper threshold is exceeded for alarm activation	0 ... 255	180	seconds

32 MODELS AND ACCESSORIES

32.1 Model

32.1.1 Models SB • SD • SC

model	Analogue Inputs (§)	Digital outputs (*)	Analogue Output (*)	Analogue Outputs PWM (**)	Digital Outputs (**)	Analogue Inputs (**)	Analogue Output O.C.
	(DI1...DI6)	(DO1...DO4) (+ DO6)	(TC1)	(AO1-AO2)	(AO3-AO5)	(AI)	(DO5)
646	6	4	1	2	3	5	1
655	6	5	//	2	3	5	1
model	(DI1...DI6)	(DO1 DO2 DO3)	(TC1, TC2)	(AO1)	(AO3-AO5)	(AI)	(DO4, DO5)
636	6	3	2	1	3	5	2

32.1.2 Expansion modules

model	Analogue Inputs (§)	Digital outputs (*)	Analogue Output (*)	Analogue Outputs PWM (**)	Digital Outputs (**)	Analogue Inputs (**)	Analogue Output O.C.
	(DI1...DI6)	(DO1...DO4) (+ DO6)	(TC1)	(AO1-AO2)	(AO3-AO5)	(AI)	(DO5)
SE632	6	3	//	2	//	3	1
SE646	6	4	1	2	3	5	1
SE655	6	5	//	2	3	5	1

TTL supplied as standard

(*) high voltage

(**) low voltage SELV: SAFETY EXTRA LOW VOLTAGE

(§) voltage free

(§§) instead of OC: PPM

O.C. Open Collector

PWM Pulse Width Modulation

PPM Pulse Position Modulation

/S integrated RS485 serial

/C indicates the presence of an RTC (Real Time Clock)

N.B.: TC2 corresponds to AO2 (TC2=AO2) - see Plant configuration chapter (folder PAr/CL-Cr-CF)

32.1.3 Models XVD

model	Analogue Inputs Low voltage (SELV)	Analogue Output Open Collector	LAN	Power supply
XVD Open	4	1	YES	24 V~/=/ Imax 0.8A/ph
XVD 4 DIN	4	1	YES	24 V~/=/ Imax 0,8A/ph

32.1.4 List of compatible valves

Driver XVD is compatible with the valves listed below.

If using with other valves, contact Eliwell Technical Support.

Eliwell is not liable for the data provided by the valve manufacturer, including any technical modifications or updates.

Always consult the technical manual of the valve manufacturer, particularly to check the plate data and correct operations.

Model	power supply	Notes
SANHUA QA(Q)		single pole
ALCO EXM246		single pole
ALCO EXL246		single pole



32.1.5 Terminals

model		Mounting	Dimensions	Display	Analogue Inputs Low voltage (SELV)
SKP10		Panel	74x32x30 mm	LED / 4 digit	-
SKW22		Wall	137x96.5x31.3 mm	LCD	1 integrated NTC 1 configurable V/I input
SKW22L		Wall	137x96.5x31.3 mm	LCD backlit	1 integrated NTC 1 configurable V/I input
SKP22		Panel (*)	160x96x10mm	LCD	1 NTC input 1 configurable NTC/DI/4...20mA input
SKP22L		Panel (*)	160x96x10mm	LCD backlit	

Power supply from base

(*) Contact the Eliwell Sales Office for wall-mounting accessories.

32.2 Accessories

N.B.: The photos are intended to show the accessories and are by way of example only. The dimensions shown in the figures are not to scale.

Name		Part Number	Description		Documentation / Notes
Transformer		TF411205	230V~/12V 6VA transformer (protected)		
		TF411210	230V~/12V 11VA transformer (protected)		
Multi Function Key		MFK100T000000	Programming key for uploading/downloading parameters Alarms and applications log		
Expansion module EXP11		MW320100	230V 10A expansion module with base fitted to DIN guide		
Wiring		COLV0000E0100	Wiring (connector + 1m cables) to connect safe voltage low voltage inputs and outputs (SELV)		
		COLV000035100	WIRING for serial port RS-485		
		COLV000042100	WIRING Smart – AO3-4-5 (connector + 1m cables)		
EMC filter		FT111201	LC filter, network filter, recommended for applications with fan speed modulation.		
Temperature probes		SN691150	NTC probe 103AT, 1.5m (plastic cap, 2-wire cable)		Double insulated cable
		SN8DED11502C0	NTC103AT 1.5m IP 68 5x20 -50+110°C		
		SN8DED13002C0	NTC103AT 3.0m IP 68 5x20 -50+110°C		
		SN8DAE11502C0	NTC103AT 1.5m IP 68 6x20 -50+110°C		
		SN8DAE13002C0	NTC103AT 3.0m IP 68 6x20 -50+110°C		
Ratiometric transducers		TD420010	Ratiometric transducer EWPA 010 R 0/5V 0/10BAR Female connector		Includes packard IP67 2m cables
		TD420030	Ratiometric transducer EWPA 030 R 0/5V 0/30BAR Female connector		
		TD420050	Ratiometric transducer EWPA 050 R 0/5V 0/50BAR Female connector		
Pressure transducers ⁽¹⁾		(¹)	Male TD220050° TD240050* TD220007° TD240007*	Female TD320050° TD340050* TD320007° TD340007*	EWPA050 4...20mA/0...50bar IP54° / IP67* EWPA007 4...20mA/-0.5...7bar IP54° / IP67* Instruction sheet 9IS64173 EWPA EN-IT-ES-DE-FR-RU

Name		Part Number	Description	Documentation / Notes
Pressure switches		(1)	HR range (automatic reset) - minimum 100,000 ON/OFF cycles	
		(1)	HL series (manual reset) - minimum 6,000 ON/OFF cycles	
		(1)	HC series (automatic reset) - minimum 250,000 ON/OFF cycles	
Fan modules		For codes See instruction sheet (1)	CFS FAN MODULES Single-phase speed regulators for currents from 2A to 9A	Instruction sheet 8FI40014 CFS - Fan Speed Modules GB-I-E-D-F
		MW991300	CF-REL FAN MODULE 6A 230V relay	Instruction sheet 8FI40014 CFS - Fan Speed Modules GB-I-E-D-F
		MW991012	FAN MODULE CFS05 TANDEM TRIAC 5+5A 230V	Instruction sheet 8FI40016 CFS05 - Fan Speed Module GB-I-E-D-F
		Contact Eliwell Sales Department	THREE-PHASE FAN REGULATOR	Contact Eliwell Sales Department
Interface modules		DM1003002000	DM100-3 Manufacturer	

Name		Part Number	Description	Documentation / Notes
Connectivity		BA11250N3700	Bus Adapter 130 TTL RS485 communication interface TTL/RS-485 12V aux. output for power supply to device. TTL cable L = 1m ⁽²⁾	Instruction Sheet 9IS43084 BusAdapter 130-150-350 GB-I-E-D-F
		BA10000R3700	Bus Adapter 150 TTL RS485 communication interface TTL/RS-485 TTL cable L = 1m ⁽²⁾	
		BARF0TS00NH00 (¹)	RadioAdapter TTL/WIRELESS 802.15.4	Instruction Sheet 8FI40023 RadioAdapter GB-I-E-D-F manual 9MAX0010 RadioAdapter GB-I-E-D-F
		WA0ET00X700	WebAdapter	Instruction sheet 9IS44065 WebAdapter GB-I-E-D-F-RUS manual 8MA00202 WebAdapter X = 0 IT; 1 EN; 2 FR; 3 ES; 5 DE; A RU
		WA0WF00X700	WebAdapter Wi-Fi	
Software Tools		Contact Eliwell Sales Department	Device Manager	Contact Eliwell Sales Department
Demo Case		VAL00031K	Demo case	

(¹) various part numbers available. Contact the Sales Department

(²) Various lengths can be requested

GENERAL NOTES:

- COHV and COLV wiring are not necessary if they are made by the manufacturer.
- Connection of remote keyboard via 3-way cables with no optional modules.
- Eliwell also has multiple NTC probes for each different cable type (PVC or silicone) and length.



Eliwell Controls s.r.l.

Via dell' Industria, 15 Zona Industriale Paludi
32010 Pieve d'Alpago (BL) ITALY
T +39 0437 986 111

Sales

T +39 0437 986 100 (Italy)
T +39 0437 986 200 (other countries)
E saleseliwell@schneider-electric.com

Technical helpline

T +39 0437 986 300
E techsuppeliwell@schneider-electric.com

www.eliwell.com

