

Data sheet

Seated valve (PN 16 & PN 25) VFM 2 – Two way valve, flange

Description



Valve for heating, district heating and district cooling systems.

VFM 2 valve can be used together with following Danfoss actuators:

- AMV(E) 655
- AMV(E) 658 SU/SD
- AME 659 SD
- AMV(E) 85/86 (for VFM 2 DN 150-250)

Features:


- Low seat leakage rate ($< 0,03\%$ of k_{vs})
- Rangeability $R =$
 $>100:1$ by PN 16
 $>100:1$ by PN 25 up till DN 125 otherwise $>80:1$
- Pressure relieved design

Main data:

- DN 65-250
- k_{vs} 63-900 m^3/h
- PN 16 & PN 25
- Linear characteristic by 0-30% valve stroke and Logarithmic characteristic by 30-100% valve stroke.
- Stem down to close
- Medium:
Circulation water / glycolic water up to 50%
- Temperature:
2 (-10^*) ... 150 °C
** At temperatures from -10 °C up to $+2$ °C use stem heater*
- Flange PN 16 & 25 connections
- Push-pull connection between valve and actuator
- Compliance with Pressure Equipment Directive 2014/68/EU

Ordering

Valve VFM 2

Picture	DN	k _{vs} (m³/h)	PN 16 Δp _s ²⁾ (bar)	PN 25 Δp _s ²⁾ (bar)	Δp _{max.} (bar) ¹⁾ for AMV(E)65x	Δp _{max.} (bar) ¹⁾ for AMV(E)85/86	PN 16 Code No.	PN 25 Code No.		
	65	63	16	20	8	-	065B3500	065B3081		
	80	100		16			10	3	065B3501	065B3082
	100	160							065B3502	065B3083
	125	250							065B3503	065B3084
	150	400	10	10	3	10	065B3504	065B3085		
	200*	630				7	065B3505	065B3086		
	250*	900				5	065B3506	065B3087		

¹⁾ $\Delta p_{max.}$ is maximum permissible differential pressure across the valve referred for the whole actuating range of motorised valve (a function of actuator's performance)

²⁾ Δp_s is maximum permissible closing differential pressure applied in fully closed position of the valve, at which valve will seal tightly (close off pressure)

* For DN 200 in combination with AMV(E)85/86: k_{vs} is reduced by 15%
For DN 250 in combination with AMV(E)85/86: k_{vs} is reduced by 20%

Accessories

Type	DN	Code No.
Stem heater for AMV(E) 85/86	150-250	065Z7021
Stem heater for AMV(E) 65X	65-250	065Z7022

Service kits


Type		Code No.
Top cover sealing set VFM 2		065B3528
Stuffing box	DN 65-125	065B3529
	DN 150-250	065B3530

Technical data


Nominal diameter	DN	65	80	100	125	150	200	250
k _{vs} value	m³/h	63	100	160	250	400	630	900
Stroke	mm	30	34	40			50	
Rangeability PN 16		>100:1						
Rangeability PN 25		>100:1				>80:1		
Control characteristic		Lin by 0-30% and Log characteristic by 30-100% valve stroke						
Cavitation factor z PN16 & PN 25		0.45	0.40	0.35			0.25	0.21
Leakage acc. to standard IEC 534		< 0.03 % of kVS						
Nominal pressure	PN	16 & 25						
Medium		Circulation water / glycolic water up to 50 % (standard VDI 2035)						
Medium pH		Min. 7, Max. 10						
Medium temperature	°C	2 (-10 1) ... 150						
Connections		Flange PN 16 & 25 acc. to EN 1092-2						
Materials								
Valve body and cover		Grey cast iron EN-GJL-250 (GG-25) for PN 16 Ductile iron EN-GJS-400-18 for PN 25						
Valve seat, cone and spindle		Stainless steel						
Stuffing box sealing		EPDM						

¹⁾ At temperatures from -10 °C up to +2 °C use stem heater

Pressure temperature diagram

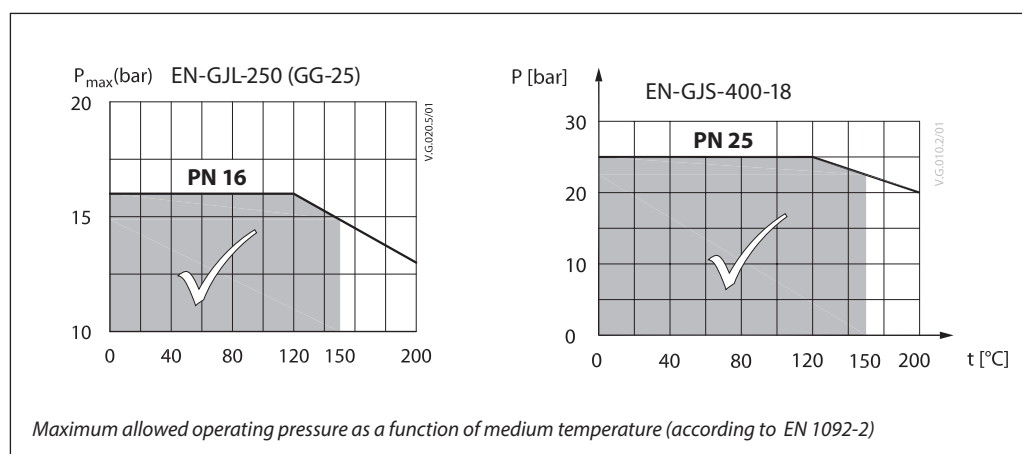

Valve characteristics

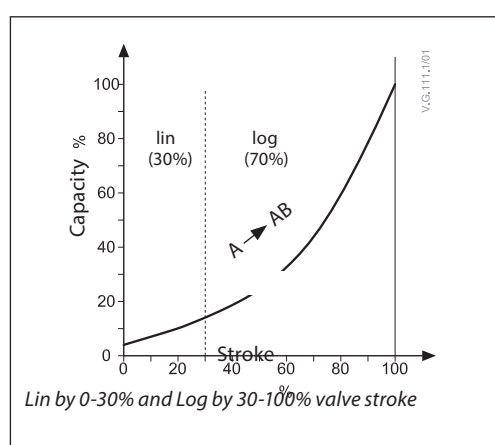

Installation

Hydraulic connections

Mount according to flow direction as indicated on valve body.

Valve mounting



Before mounting the valve be sure that the pipes are clean and free from swarf. It is essential that the pipes are lined up squarely with the valve at each connection and that they are free from vibrations.

Install the motorized control valves with the actuator in allowed position as described below.

Leave sufficient clearance to facilitate the dismantling of the actuator from the valve body for maintenance purposes.


Note that the actuator may be rotated up to 360° with respect to the valve body by loosening the retaining fixture. After this operation re-tighten.

Note:
Install a strainer upstream of the valve
(e.g. Danfoss FVR/FVF)

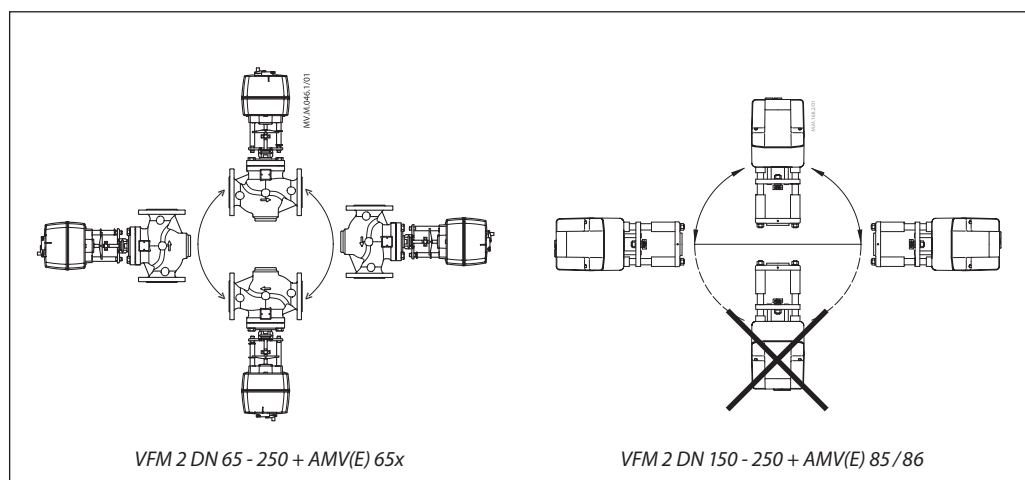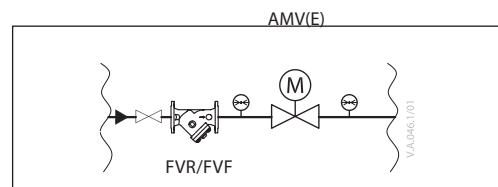


Design

1. Valve body
2. Valve cover
3. Stuffing box
4. Valve stem
5. Valve cone (pressure relieved)
6. Valve seat

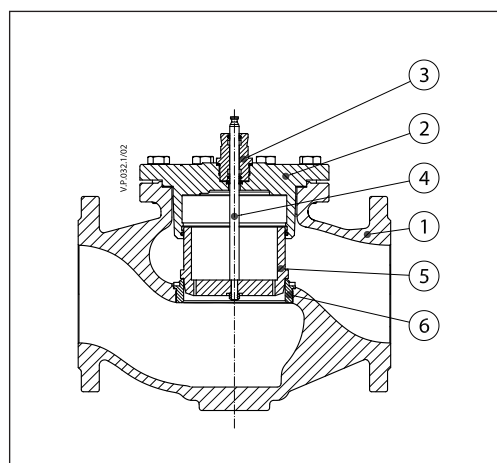

Sizing

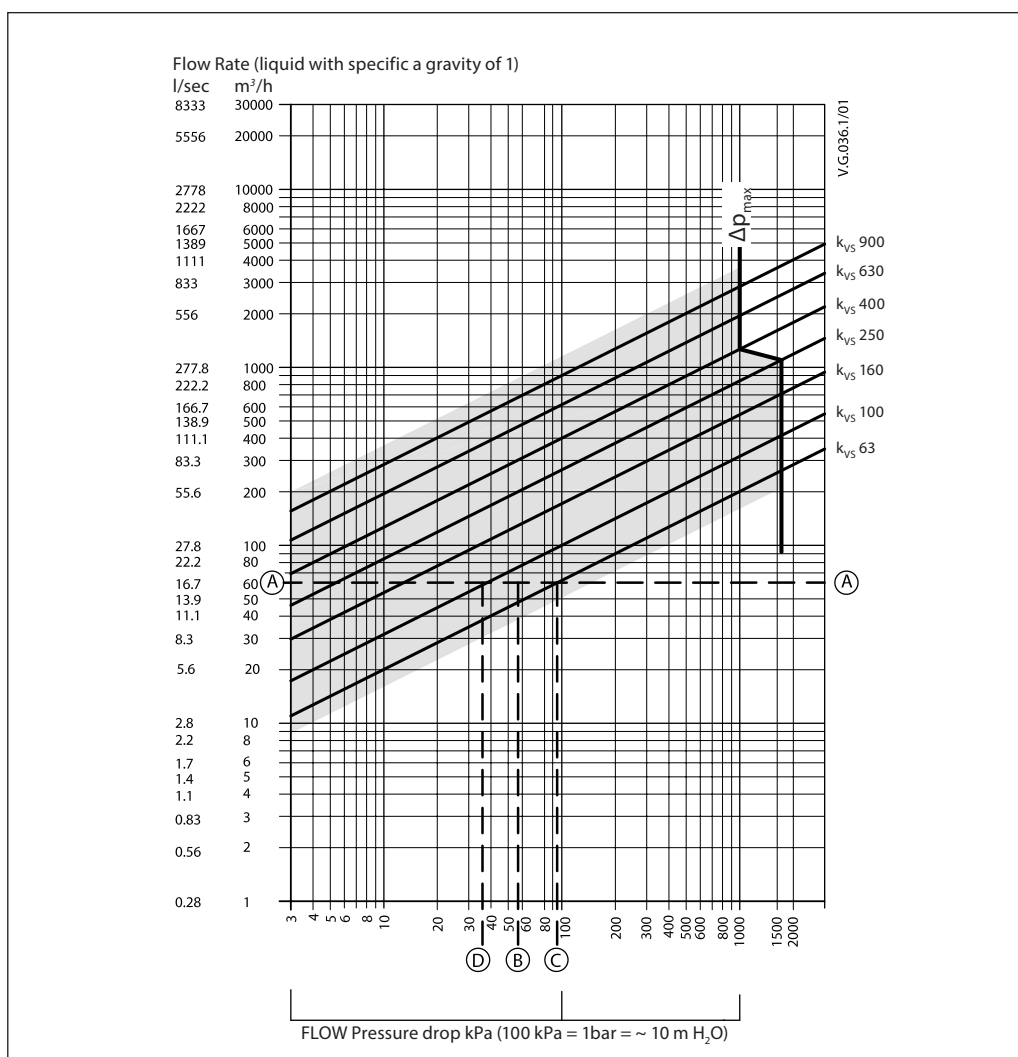

Example

Design data:

Flow rate: 60 m³/h

System pressure drop: 55 kPa

Locate the horizontal line representing a flow rate of 60 m³/h (line A-A). The valve authority is given by the equation:

$$\text{Valve authority, } a = \frac{\Delta p_1}{\Delta p_1 + \Delta p_2}$$

Where:

Δp₁ = pressure drop across the fully open valve

Δp₂ = pressure drop across the rest of the circuit with a full open valve

The ideal valve would give a pressure drop equal to the system pressure drop (i.e. an authority of 0,5)

if: Δp₁ = Δp₂

$$a = \frac{\Delta p_1}{2 \times \Delta p_1} = 0.5$$

In this example an authority of 0,5 would be given by a valve having a pressure drop of 55 kPa at that flow rate (point B). The intersection of line A-A with a vertical line drawn from B lies between two diagonal lines; this means that no ideally-sized valve is available.




The intersection of line A-A with the diagonal lines gives the pressure drops stated by real, rather than ideal, valves. In this case, a valve with k_{VS} 63 would give a pressure drop of 90,7 kPa (point C):

$$\text{hence valve authority} = \frac{90.7}{90.7 + 55} = 0.62$$

The second largest valve, with k_{VS} 100, would give a pressure drop of 36 kPa (point D):

$$\text{hence valve authority} = \frac{36}{36 + 55} = 0.395$$

Dimensions

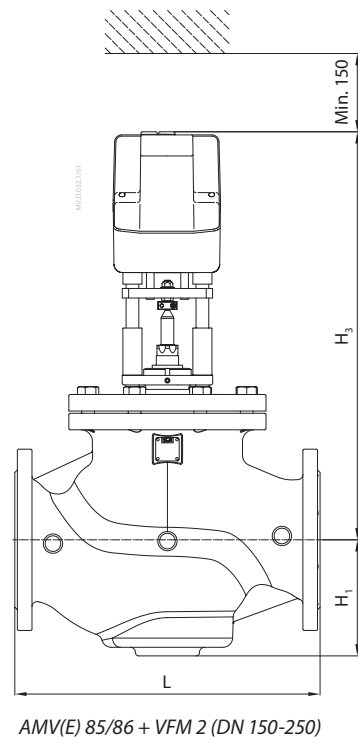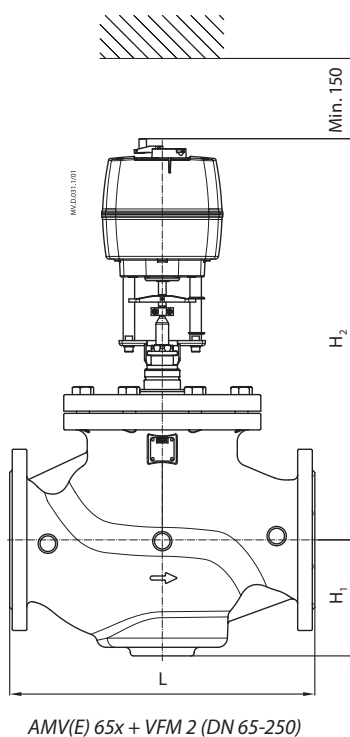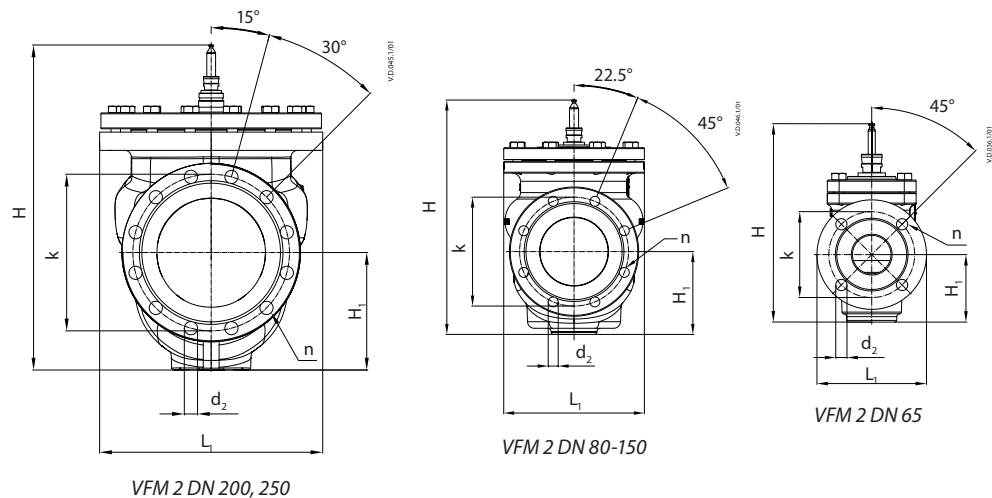

Type	DN	PN 16							PN 25							PN 16 & PN 25		
		L	L ₁	H	k	d ₂	n	Weight (kg)	L	L ₁	H	k	d ₂	n	Weight (kg)	H ₁	H ₂	H ₃
		mm							mm							mm		
VFM 2	65	290	185	336	145	19	4	25	290	185	336	145	19	8	23.5	114	493.5	-
	80	310	200	336	160	19	8	33	310	200	336	160	19	8	27	114	494.5	-
	100	350	242	414	180	19	8	48	350	242	414	190	23	8	46	148	528.5	-
	125	400	250	416	210	19	8	57	400	270	416	220	28	8	56	149	529.5	-
	150	480	310	516	240	22	8	101	480	320	516	250	28	8	102	182.5	628.5	639
	200	600	385	669	295	23	12	208	600	385	669	310	28	12	197	245	686	685
	250	730	500	728	355	26	12	348	730	500	728	370	31	12	334	267	732	732



Danfoss A/S

Climate Solutions • danfoss.com • +45 7488 2222

Any information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other technical data in product manuals, catalogues descriptions, advertisements, etc. and whether made available in writing, orally, electronically, online or via download, shall be considered informative, and is only binding if and to the extent, explicit reference is made in a quotation or order confirmation. Danfoss cannot accept any responsibility for possible errors in catalogues, brochures, videos and other material. Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered provided that such alterations can be made without changes to form, fit or function of the product.

All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.